



OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id
KAESER 8762297 (S/N 1874)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation
 No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear
 All component wear rates are normal.

Contamination
 There is a high amount of particulates present in the oil.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KC131637	KC124359	---
Sample Date	Client Info			12 Jun 2024	06 Dec 2023	---
Machine Age	hrs	Client Info		4853	3106	---
Oil Age	hrs	Client Info		4853	0	---
Oil Changed	Client Info			Not Chngd	N/A	---
Sample Status				ABNORMAL	ABNORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	---
Chromium	ppm	ASTM D5185m	>10	0	0	---
Nickel	ppm	ASTM D5185m	>3	0	0	---
Titanium	ppm	ASTM D5185m	>3	<1	0	---
Silver	ppm	ASTM D5185m	>2	0	0	---
Aluminum	ppm	ASTM D5185m	>10	<1	0	---
Lead	ppm	ASTM D5185m	>10	0	0	---
Copper	ppm	ASTM D5185m	>50	5	13	---
Tin	ppm	ASTM D5185m	>10	0	0	---
Vanadium	ppm	ASTM D5185m		<1	0	---
Cadmium	ppm	ASTM D5185m		0	0	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	---
Barium	ppm	ASTM D5185m	90	21	0	---
Molybdenum	ppm	ASTM D5185m	0	0	0	---
Manganese	ppm	ASTM D5185m		<1	0	---
Magnesium	ppm	ASTM D5185m	100	47	26	---
Calcium	ppm	ASTM D5185m	0	<1	<1	---
Phosphorus	ppm	ASTM D5185m	0	<1	1	---
Zinc	ppm	ASTM D5185m	0	11	24	---


CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	---
Sodium	ppm	ASTM D5185m		12	4	---
Potassium	ppm	ASTM D5185m	>20	3	3	---
Water	%	ASTM D6304	>0.05	0.023	0.007	---
ppm Water	ppm	ASTM D6304	>500	237	74	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		8716	32855	---
Particles >6µm		ASTM D7647	>1300	▲ 4148	▲ 14730	---
Particles >14µm		ASTM D7647	>80	▲ 456	▲ 1804	---
Particles >21µm		ASTM D7647	>20	▲ 78	▲ 435	---
Particles >38µm		ASTM D7647	>4	1	3	---
Particles >71µm		ASTM D7647	>3	0	1	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 20/19/16	▲ 22/21/18	---


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.36	0.35	---

OIL ANALYSIS REPORT


▲ Particle Trend

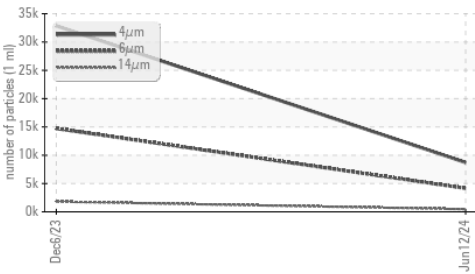


Water (KF)

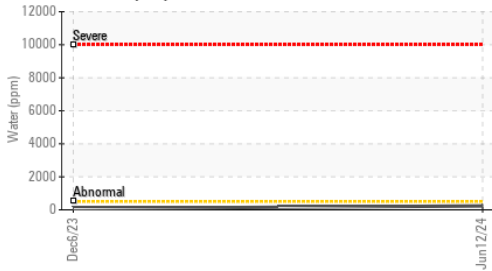


Acid Number

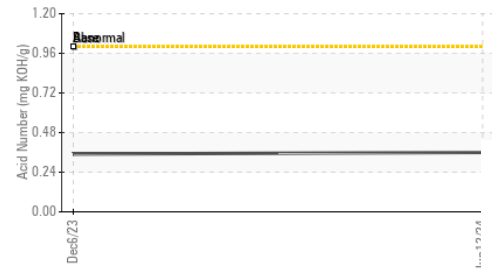

Water (KF)

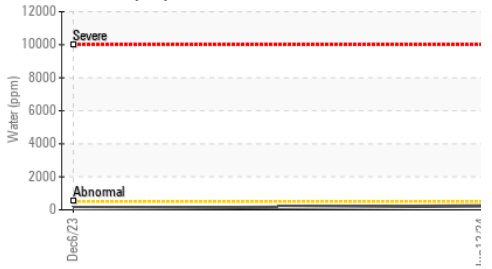


Viscosity @ 40°C

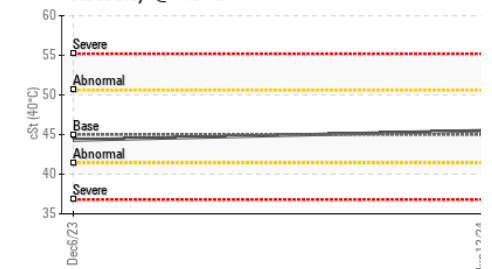






PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	44.3	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

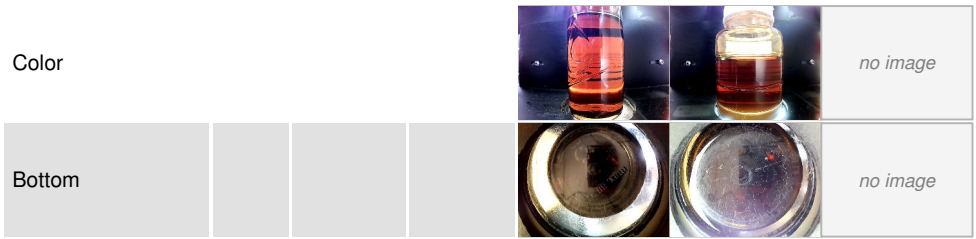

GRAPHS

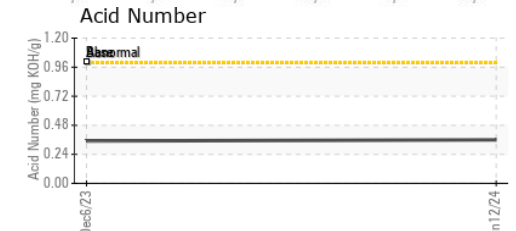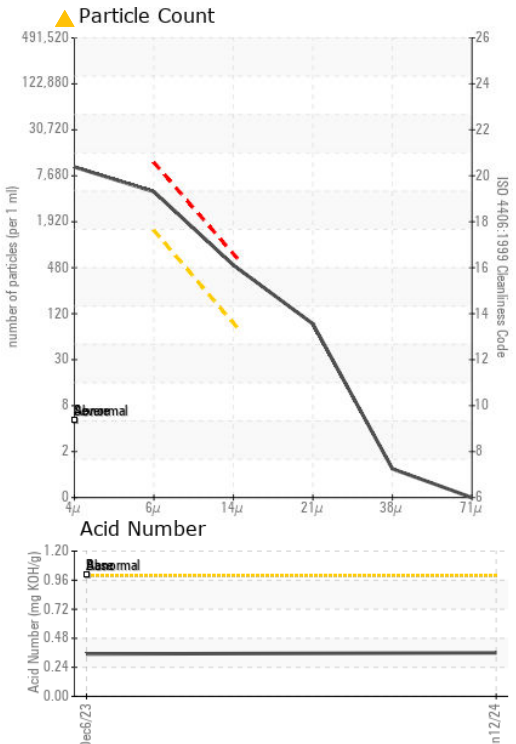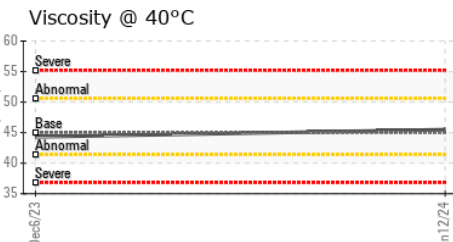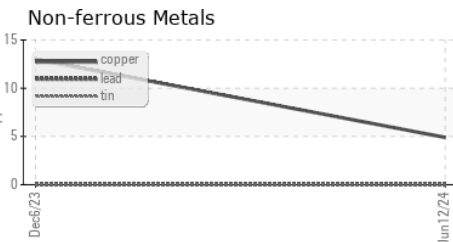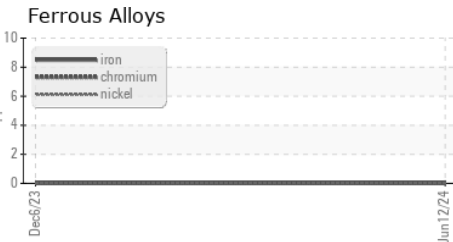

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC131637
Lab Number : 06212370
Unique Number : 11085234
Test Package : IND 2
Received : 17 Jun 2024
Tested : 19 Jun 2024
Diagnosed : 19 Jun 2024 - Don Baldrige

ROHRICH COLLISION
 2690 W LIBERTY AVE
 PITTSBURGH, PA
 US 15216
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)