

# **OIL ANALYSIS REPORT**

Sample Rating Trend



Machine Id

# KAESER AS 25T 8776184 (S/N 1960)

Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Mar <sup>2</sup> 023	May2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC108241	KC106333	
Sample Date		Client Info		30 May 2024	23 Mar 2023	
Machine Age	hrs	Client Info		11001	2588	
Oil Age	hrs	Client Info		0	2588	
Oil Changed		Client Info		N/A	Not Changd	
Sample Status				NORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	<1	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	0	<1	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	9	10	
Tin	ppm	ASTM D5185m	>10	0	0	
Vanadium	ppm	ASTM D5185m		<1	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	0	0	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		<1	0	
Magnesium	ppm	ASTM D5185m	90	0	25	
Calcium	ppm	ASTM D5185m	2	0	0	
Phosphorus	ppm	ASTM D5185m		1	5	
Zinc	ppm	ASTM D5185m		<1	21	
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	
Sodium	ppm	ASTM D5185m		2	8	
Potassium	ppm	ASTM D5185m	>20	0	5	
Water	%	ASTM D6304	>0.05	0.005	0.016	
ppm Water	ppm	ASTM D6304	>500	52	169.7	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		973	7571	
Particles >6µm		ASTM D7647	>1300	352	<u>^</u> 2800	
Particles >14µm		ASTM D7647	>80	29	<u>▲</u> 122	
Particles >21µm		ASTM D7647	>20	8	19	
Particles >38µm		ASTM D7647	>4	1	0	
Particles >71μm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	17/16/12	<u>^</u> 20/19/14	
FLUID DEGRADA	ATION _	method	limit/base	current	history1	history2
A sial Nivershau (ANI)		4.OTM D00.45	0.4	0.04	0.05	

Acid Number (AN)


mg KOH/g ASTM D8045 0.4

0.35

0.21



## OIL ANALYSIS REPORT

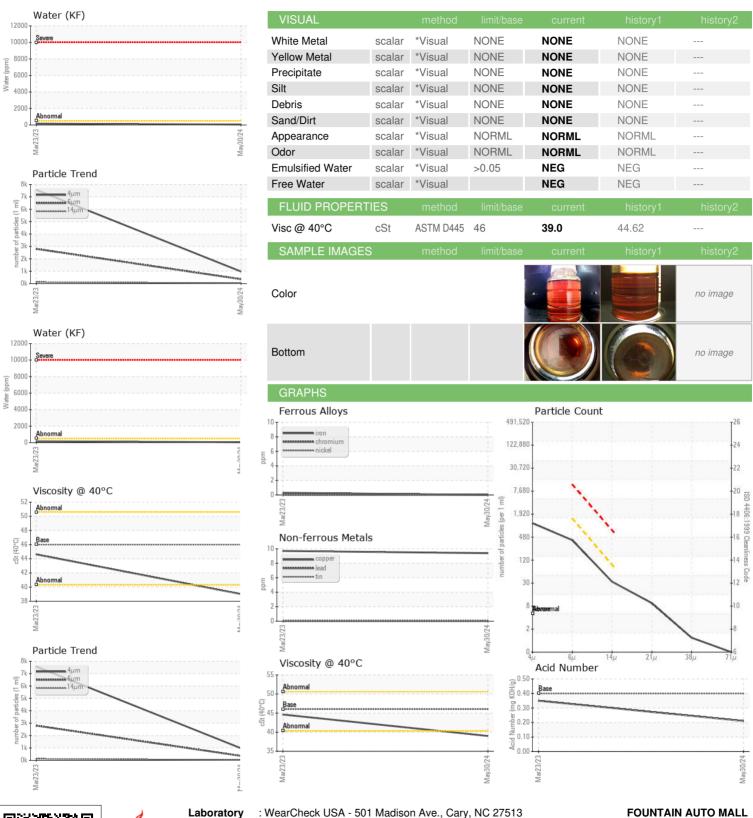





Certificate 12367

Laboratory Sample No. : KC108241 Lab Number : 06212386 Unique Number : 11085250

Received : 17 Jun 2024 **Tested** Diagnosed

: 19 Jun 2024 : 19 Jun 2024 - Don Baldridge

Test Package : IND 2 To discuss this sample report, contact Customer Service at 1-800-237-1369.

 $^st$  - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F:

8701 S IRABGE BLOSSOM TRAIL

Contact: SERVICE MANAGER

ORLANDO, FL

US 32809