




# OIL ANALYSIS REPORT

Sample Rating Trend

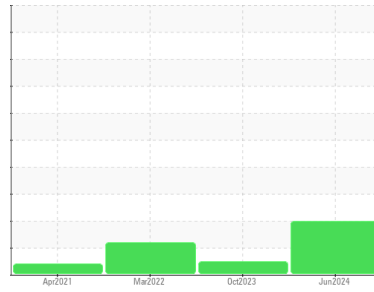

Area  
**[SV-OH-ORD002123]**  
 Machine Id  
**KAESER BSD 50T 7471615 (S/N 1068)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil. Moderate concentration of visible dirt/debris present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>KC129178</b>	KC125230	KC96535
Sample Date	Client Info	<b>04 Jun 2024</b>	09 Oct 2023	03 Mar 2022
Machine Age	hrs	<b>11768</b>	9227	4138
Oil Age	hrs	<b>2540</b>	0	2103
Oil Changed	Client Info	<b>Not Chngd</b>	N/A	Changed
Sample Status		<b>ABNORMAL</b>	NORMAL	ATTENTION

## WEAR METALS

method	limit/base	current	history1	history2
Iron ppm	ASTM D5185m >50	<b>0</b>	0	<1
Chromium ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel ppm	ASTM D5185m >3	<b>0</b>	0	0
Titanium ppm	ASTM D5185m >3	<b>&lt;1</b>	0	0
Silver ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum ppm	ASTM D5185m >10	<b>&lt;1</b>	0	<1
Lead ppm	ASTM D5185m >10	<b>0</b>	0	0
Copper ppm	ASTM D5185m >50	<b>3</b>	5	2
Tin ppm	ASTM D5185m >10	<b>0</b>	0	0
Antimony ppm	ASTM D5185m	<b>---</b>	---	---
Vanadium ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Cadmium ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2
Boron ppm	ASTM D5185m	<b>0</b>	0	0
Barium ppm	ASTM D5185m 90	<b>3</b>	0	0
Molybdenum ppm	ASTM D5185m	<b>0</b>	0	0
Manganese ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Magnesium ppm	ASTM D5185m 90	<b>37</b>	27	56
Calcium ppm	ASTM D5185m 2	<b>0</b>	0	<1
Phosphorus ppm	ASTM D5185m	<b>1</b>	<1	5
Zinc ppm	ASTM D5185m	<b>13</b>	18	7

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm	ASTM D5185m >25	<b>1</b>	<1	1
Sodium ppm	ASTM D5185m	<b>15</b>	15	12
Potassium ppm	ASTM D5185m >20	<b>3</b>	8	8
Water %	ASTM D6304 >0.05	<b>0.022</b>	0.021	0.013
ppm Water	ASTM D6304 >500	<b>226</b>	219.2	130.3






## FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	<b>16003</b>	378	5345
Particles >6µm	ASTM D7647 >1300	<b>▲ 4937</b>	114	● 1836
Particles >14µm	ASTM D7647 >80	<b>▲ 180</b>	11	● 133
Particles >21µm	ASTM D7647 >20	<b>▲ 31</b>	2	● 30
Particles >38µm	ASTM D7647 >4	<b>3</b>	0	1
Particles >71µm	ASTM D7647 >3	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c) >--/17/13	<b>▲ 21/19/15</b>	16/14/11	● 18/14

## FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g	ASTM D8045 0.4	<b>0.32</b>	0.32	0.36

# OIL ANALYSIS REPORT

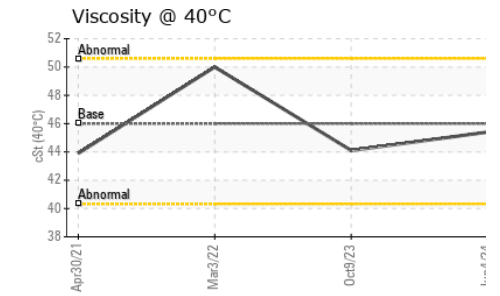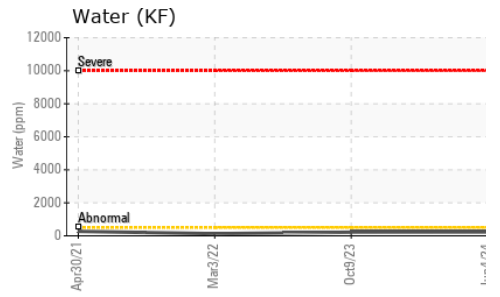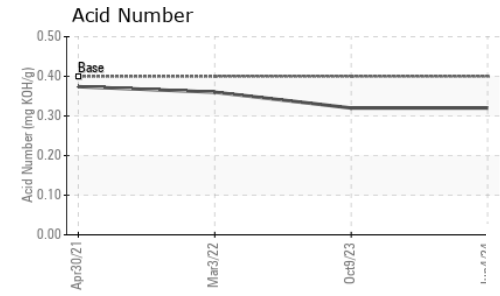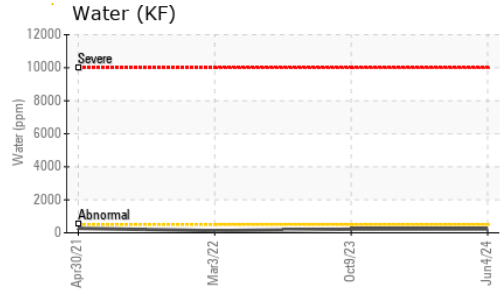
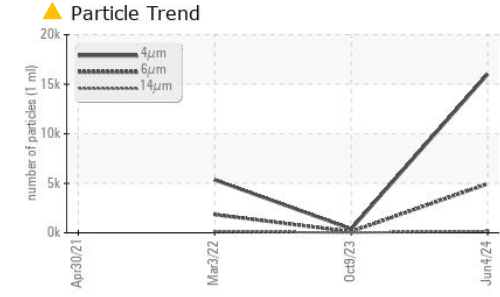


PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	▲ MODER	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	45.4	44.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

## GRAPHS

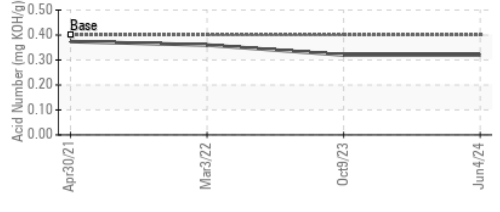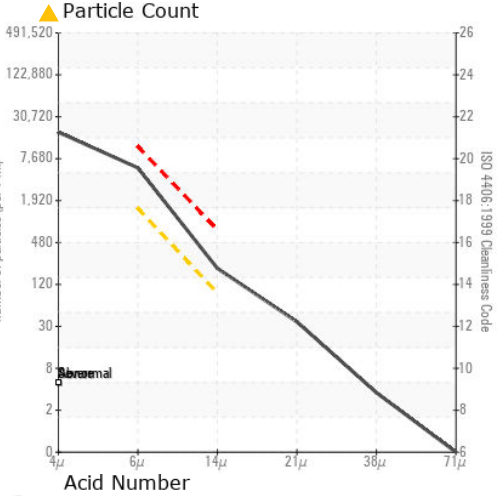

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC129178  
**Lab Number** : 06212409  
**Unique Number** : 11085273  
**Test Package** : IND 2  
**Received** : 17 Jun 2024  
**Tested** : 19 Jun 2024  
**Diagnosed** : 19 Jun 2024 - Don Baldrige

**GORILLA GLUE CO**  
 2101 E KEMPER RD  
 CINCINNATI, OH  
 US 45241  
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)