


# **OIL ANALYSIS REPORT**

Sample Rating Trend

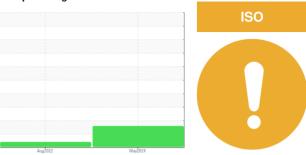

Machine Id

# 7950561 (S/N 1123)

Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

#### Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of particulates present in the oil.

#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Aug2022	May2024		
OAND E WEST						
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA018002	KC106004	
Sample Date		Client Info		30 May 2024	10 Aug 2022	
Machine Age	hrs	Client Info		9214	3138	
Oil Age	hrs	Client Info		3000	3138	
Oil Changed		Client Info		Changed	Changed	
Sample Status				ATTENTION	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	<1	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	0	1	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	5	8	
Tin	ppm	ASTM D5185m	>10	0	0	
Vanadium	ppm	ASTM D5185m		<1	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	0	0	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		<1	<1	
Magnesium	ppm	ASTM D5185m	90	2	7	
Calcium	ppm	ASTM D5185m	2	0	0	
Phosphorus	ppm	ASTM D5185m		<1	2	
Zinc	ppm	ASTM D5185m		<1	14	
Sulfur	ppm	ASTM D5185m		15901	20452	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	
Sodium	ppm	ASTM D5185m		2	2	
Potassium	ppm	ASTM D5185m	>20	0	2	
Water	%	ASTM D6304	>0.05	0.006	0.008	
ppm Water	ppm	ASTM D6304	>500	63	82.0	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		7585		
Particles >6µm		ASTM D7647	>1300	<u> </u>		
Particles >14μm		ASTM D7647	>80	<b>121</b>		
Particles >21µm		ASTM D7647	>20	<u> </u>		
Particles >38μm		ASTM D7647	>4	2		
Particles >71μm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<b>20/18/14</b>		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Asid Number (AN)	I/OII/-	ACTM DODAE	0.4	0.26	0.40	

Acid Number (AN)


mg KOH/g ASTM D8045 0.4

0.43

0.36



## **OIL ANALYSIS REPORT**

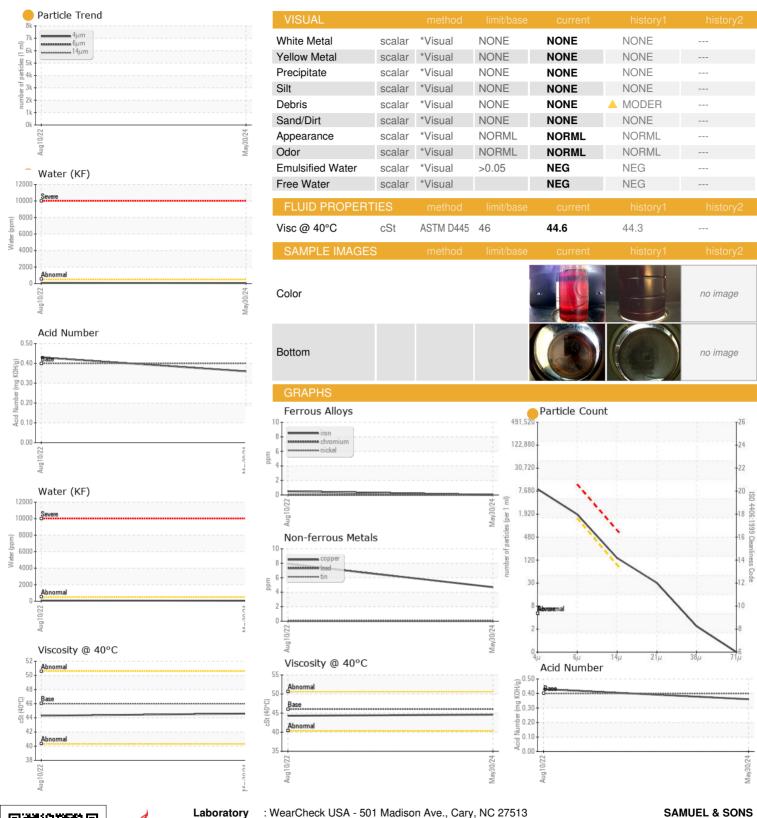



Certificate 12367

Laboratory Sample No.

: KCPA018002 Lab Number : 06212416

Received **Tested** Unique Number : 11085280 Diagnosed

: 17 Jun 2024 : 19 Jun 2024

: 19 Jun 2024 - Don Baldridge Test Package : IND 2 ( Additional Tests: KF, PrtCount )

US 54143 Contact: MIKE BERTAPELLE mike.bertapelle@samuel.com T:

2121 CLEVELAND AVE

MARINETTE, WI

To discuss this sample report, contact Customer Service at 1-800-237-1369. \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: