

OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

KAESER DSD 150T 9271384 (S/N 1104)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Jun2024		
				Jun2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC129482		
Sample Date		Client Info		07 Jun 2024		
Machine Age	hrs	Client Info		3959		
Oil Age	hrs	Client Info		2018		
Oil Changed		Client Info		Not Changd		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	<1		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	9		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm		>50	10		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m	7.0	<1		
Cadmium	ppm	ASTM D5185m		0		
	PP		11		la faction and	h'-1 O
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0.0	0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	90	8		
Calcium	ppm	ASTM D5185m	2	0		
Phosphorus	ppm	ASTM D5185m		27		
Zinc	ppm	ASTM D5185m		96		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	5		
Sodium	ppm	ASTM D5185m		5		
Potassium	ppm	ASTM D5185m		4		
Water	%	ASTM D6304	>0.05	0.010		
ppm Water	ppm	ASTM D6304	>500	103		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		526		
Particles >6µm		ASTM D7647	>1300	191		
Particles >14µm		ASTM D7647	>80	17		
Particles >21µm		ASTM D7647	>20	3		
Particles >38µm		ASTM D7647	>4	1		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	16/15/11		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2


Acid Number (AN)

mg KOH/g ASTM D8045 0.4

0.32



OIL ANALYSIS REPORT

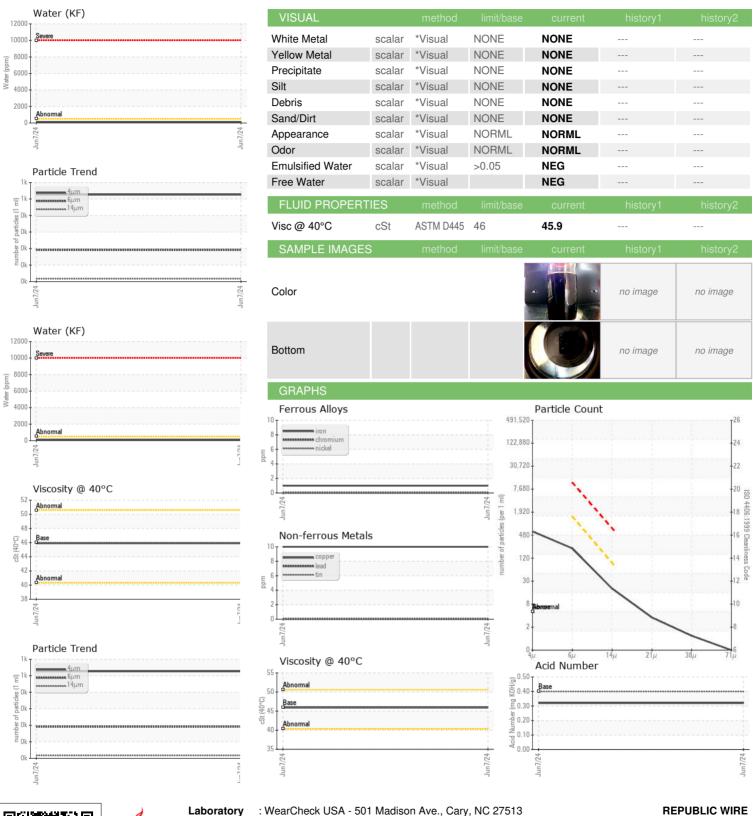



Certificate 12367

Sample No. Lab Number : 06212426 Unique Number : 11085290 Test Package : IND 2

: KC129482

Received : 17 Jun 2024 **Tested** : 19 Jun 2024

Diagnosed : 19 Jun 2024 - Don Baldridge

REPUBLIC WIRE 5525 UNION CENTER DR WESTCHESTER, OH US 45069

Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: REPWESKC [WUSCAR] 06212426 (Generated: 06/21/2024 21:03:36) Rev: 1

Contact/Location: SERVICE MANAGER ? - REPWESKC

T:

F: