


# **OIL ANALYSIS REPORT**

Sample Rating Trend

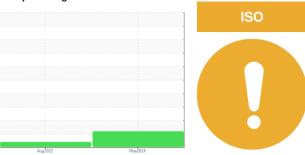

Machine Id

# **7976855 (S/N 1129)**Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

#### Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of particulates present in the oil.


#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Aug <sup>2</sup> 022	May2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA018017	KC106218	
Sample Date		Client Info		30 May 2024	10 Aug 2022	
Machine Age	hrs	Client Info		9251	3139	
Oil Age	hrs	Client Info		3000	3139	
Oil Changed	0	Client Info		Changed	Not Changd	
Sample Status				ATTENTION	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
					<1	111010172
Iron Chromium	ppm	ASTM D5185m	>50 >10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m		۰ <1	0	
Silver	ppm	ASTM D5185m	>3	0	0	
Aluminum	ppm				1	
	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	0 6	0	
Copper	ppm	ASTM D5185m ASTM D5185m				
Tin Vanadium	ppm		>10	0	<1	
	ppm	ASTM D5185m		<1	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	0	0	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		<1	<1	
Magnesium	ppm	ASTM D5185m	90	0	8	
Calcium	ppm	ASTM D5185m	2	0	0	
Phosphorus	ppm	ASTM D5185m		<1	2	
Zinc	ppm	ASTM D5185m		<1	8	
Sulfur	ppm	ASTM D5185m		16156	20154	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	2	
Sodium	ppm	ASTM D5185m		2	2	
Potassium	ppm	ASTM D5185m	>20	0	<1	
Water	%	ASTM D6304	>0.05	0.007	0.008	
ppm Water	ppm	ASTM D6304	>500	78	83.7	
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		9009		
Particles >6µm		ASTM D7647	>1300	<b>1986</b>		
Particles >14μm		ASTM D7647	>80	<u> </u>		
Particles >21µm		ASTM D7647	>20	18		
Particles >38µm		ASTM D7647	>4	1		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<b>20/18/14</b>		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.40	0.43	



## **OIL ANALYSIS REPORT**

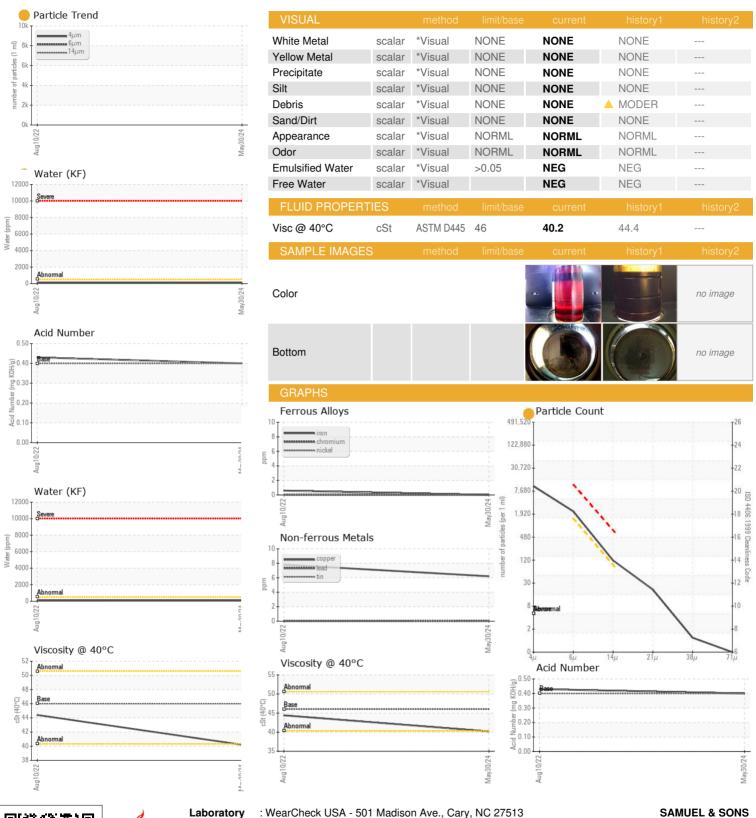



Certificate 12367

Laboratory

Sample No. Lab Number

: KCPA018017 : 06212438

Unique Number : 11085302

Received **Tested** Diagnosed

: 19 Jun 2024 - Don Baldridge Test Package : IND 2 ( Additional Tests: KF, PrtCount )

To discuss this sample report, contact Customer Service at 1-800-237-1369.  $^st$  - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

**SAMUEL & SONS** 2121 CLEVELAND AVE

MARINETTE, WI US 54143

Contact: MIKE BERTAPELLE mike.bertapelle@samuel.com T:

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

: 17 Jun 2024

: 19 Jun 2024

F: