


OIL ANALYSIS REPORT

Sample Rating Trend

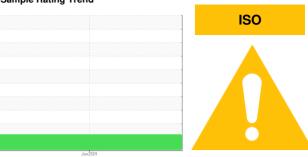

Machine Id

KAESER 9033007

Component Compressor

KAESER SIGMA (OEM) S-460 (--- LTR)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			,	Jun 2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC130271		
Sample Date		Client Info		13 Jun 2024		
Machine Age	hrs	Client Info		340		
Oil Age	hrs	Client Info		340		
Oil Changed		Client Info		Changed		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel		ASTM D5185m	>3	0		
Titanium	ppm			۰ <1		
Silver	ppm	ASTM D5185m	>3			
	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	2		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	9		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	90	66		
Calcium	ppm	ASTM D5185m	2	1		
Phosphorus	ppm	ASTM D5185m		4		
Zinc	ppm	ASTM D5185m		8		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		14		
Potassium	ppm	ASTM D5185m	>20	<1		
Water	%	ASTM D6304		0.022		
ppm Water	ppm	ASTM D6304	>500	228		
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		20531		
Particles >6µm		ASTM D7647	>1300	<u> 10145</u>		
Particles >14µm		ASTM D7647	>80	<u>▲</u> 413		
Particles >21µm		ASTM D7647	>20	16		
Particles >38μm		ASTM D7647	>4	0		
Particles >71μm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>A</u> 22/21/16		
	TION	()				
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
A - ! - A / A A \		A OTMA DOO 4F	0.4			


Acid Number (AN)

mg KOH/g ASTM D8045 0.4

0.34



OIL ANALYSIS REPORT

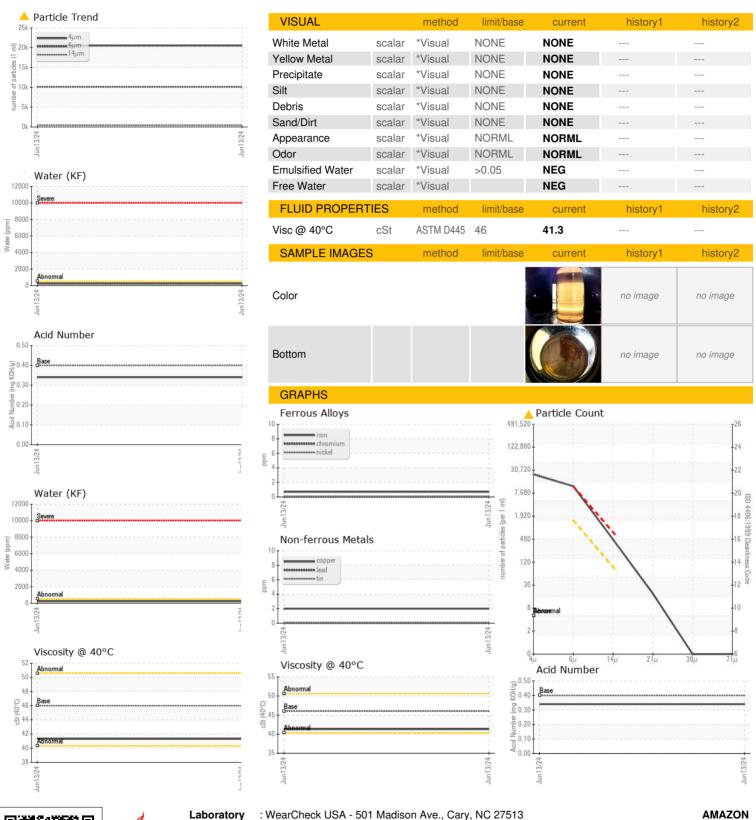



Certificate 12367

Sample No.

: KC130271 Lab Number : 06212440 Unique Number : 11085304 Test Package : IND 2

Received : 17 Jun 2024 **Tested** Diagnosed

: 19 Jun 2024 : 19 Jun 2024 - Don Baldridge

16604 INDUSTRIAL LN WILLIAMSPORT, MD US 21795 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: AMAWILMD [WUSCAR] 06212440 (Generated: 06/21/2024 20:53:34) Rev: 1

Contact/Location: Service Manager - AMAWILMD

T:

F: