




OIL ANALYSIS REPORT

Sample Rating Trend

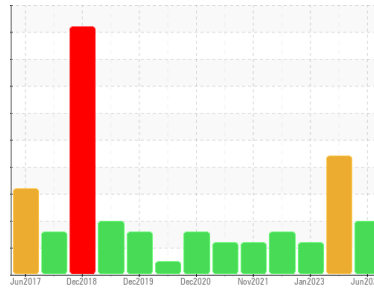

ISO



Machine Id

KAESER AS 20T 3404822 (S/N 1472)

Component

Compressor

Fluid

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KCPA012935	KCPA011902	KCP54943
Sample Date	Client Info	11 Jun 2024	28 Dec 2023	17 Jan 2023
Machine Age	hrs	40408	39350	37159
Oil Age	hrs	4000	0	800
Oil Changed	Client Info	Changed	N/A	Not Changd
Sample Status		ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	0	<1	<1
Chromium	ppm	ASTM D5185m >10	0	<1	0
Nickel	ppm	ASTM D5185m >3	0	<1	0
Titanium	ppm	ASTM D5185m >3	<1	<1	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	0	2	0
Lead	ppm	ASTM D5185m >10	0	<1	0
Copper	ppm	ASTM D5185m >50	4	4	2
Tin	ppm	ASTM D5185m >10	0	<1	0
Vanadium	ppm	ASTM D5185m	<1	0	0
Cadmium	ppm	ASTM D5185m	0	<1	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m 90	0	15	0
Molybdenum	ppm	ASTM D5185m	0	<1	0
Manganese	ppm	ASTM D5185m	<1	<1	0
Magnesium	ppm	ASTM D5185m 90	23	29	50
Calcium	ppm	ASTM D5185m 2	0	2	0
Phosphorus	ppm	ASTM D5185m	1	9	2
Zinc	ppm	ASTM D5185m	12	7	0
Sulfur	ppm	ASTM D5185m	20081	21350	20549

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	<1	0	0
Sodium	ppm	ASTM D5185m	12	0	22
Potassium	ppm	ASTM D5185m >20	<1	1	<1
Water	%	ASTM D6304 >0.05	0.013	▲ 0.212	0.018
ppm Water	ppm	ASTM D6304 >500	133	▲ 2120	184.8






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	12326	---	16375
Particles >6µm	ASTM D7647 >1300	▲ 5006	---	▲ 4481
Particles >14µm	ASTM D7647 >80	▲ 432	---	● 146
Particles >21µm	ASTM D7647 >20	▲ 100	---	17
Particles >38µm	ASTM D7647 >4	▲ 7	---	0
Particles >71µm	ASTM D7647 >3	0	---	0
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 21/20/16	---	▲ 21/19/14

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.30	0.34	0.32

OIL ANALYSIS REPORT

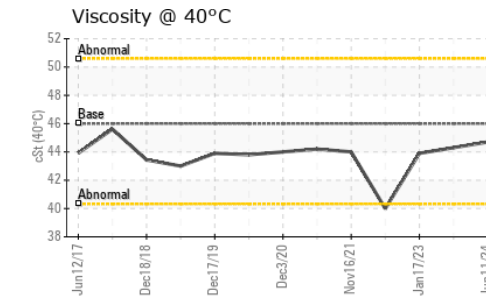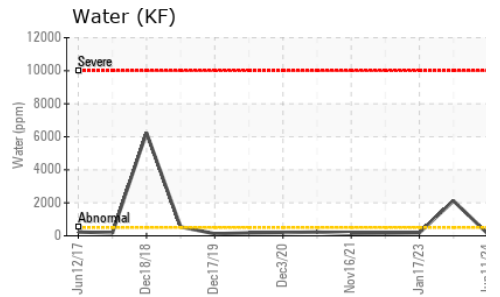
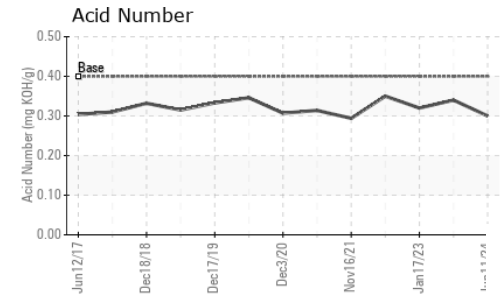
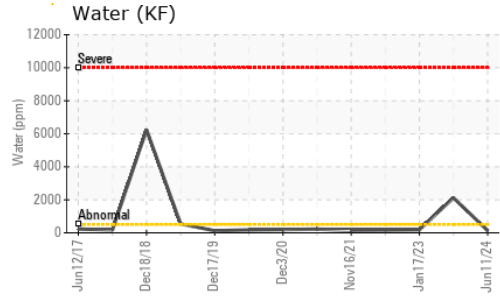
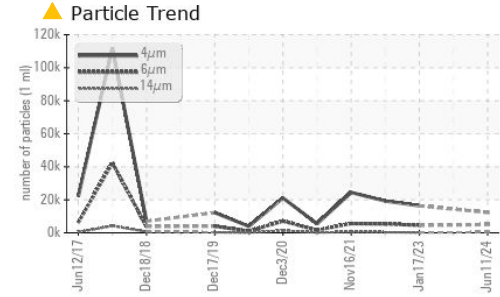


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	● HAZY
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	▲ 0.2%
Free Water	scalar	*Visual		NEG	● 10.0

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.7	44.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

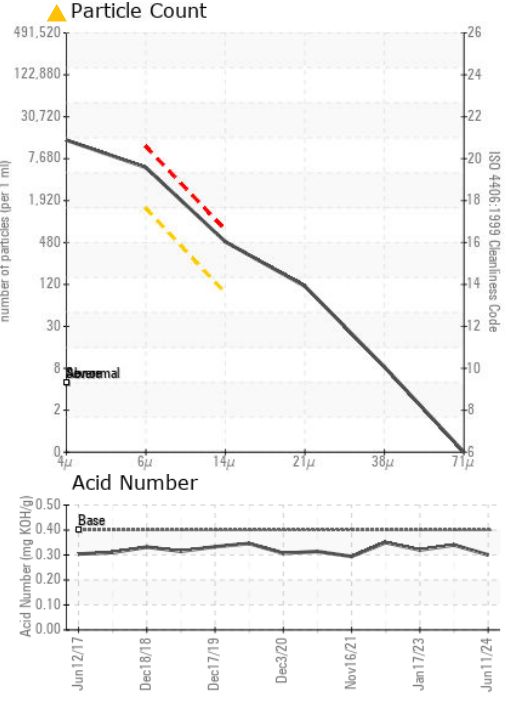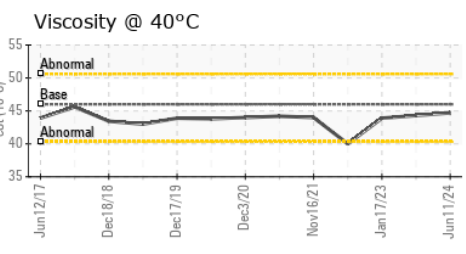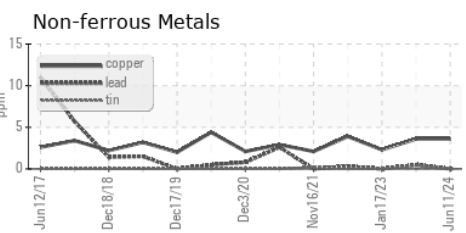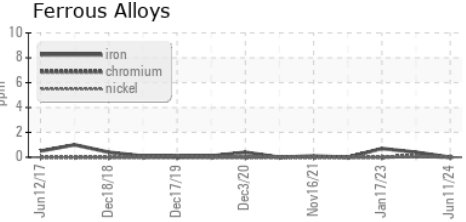

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA012935
Lab Number : 06212441
Unique Number : 11085305
Test Package : IND 2 (Additional Tests: KF, PrtCount)
Received : 17 Jun 2024
Tested : 19 Jun 2024
Diagnosed : 19 Jun 2024 - Don Baldrige

POMPS TIRE
 516 S SEYMOUR ST
 FOND DU LAC, WI
 US 54935
 Contact: C. KORB
 ckorb@pompstire.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)