

OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

KAESER ASD 40T 5409674 (S/N 2447)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Jun2021	Nov2021	Jun2022 Feb2023	Jun 2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA019266	KCP55052	KCP41386
Sample Date		Client Info		12 Jun 2024	02 Feb 2023	29 Jun 2022
Machine Age	hrs	Client Info		58431	52580	49091
Oil Age	hrs	Client Info		0	0	49091
Oil Changed		Client Info		Not Changd	Changed	Not Changd
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	1	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	<1	0
Titanium	ppm	ASTM D5185m	>3	<1	<1	<1
Silver	ppm	ASTM D5185m	>2	0	<1	0
Aluminum	ppm	ASTM D5185m	>10	0	3	0
Lead	ppm	ASTM D5185m	>10	0	1	0
Copper	ppm	ASTM D5185m	>50	5	25	10
Tin	ppm	ASTM D5185m	>10	0	<1	<1
Antimony	ppm	ASTM D5185m				
Vanadium	ppm	ASTM D5185m		<1	<1	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m		0	<1	0
Manganese	ppm	ASTM D5185m		<1	<1	0
Magnesium	ppm	ASTM D5185m	90	27	1	8
Calcium	ppm	ASTM D5185m	2	0	0	0
Phosphorus	ppm	ASTM D5185m		2	4	7
Zinc	ppm	ASTM D5185m		39	6	25
Sulfur	ppm	ASTM D5185m		20532	20145	20796
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	1	0
Sodium	ppm	ASTM D5185m		13	4	2
Potassium	ppm	ASTM D5185m	>20	2	2	0
Water	%	ASTM D6304	>0.05	0.016	0.003	△ 0.437
ppm Water	ppm	ASTM D6304	>500	166	33.4	▲ 4370
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		12804	187603	
Particles >6µm		ASTM D7647	>1300	4204	<u> </u>	
Particles >14μm		ASTM D7647	>80	<u> </u>	<u>▲</u> 8716	
Particles >21µm		ASTM D7647	>20	<u>^</u> 24	<u>\$898</u>	
Particles >38μm		ASTM D7647	>4	1	<u>17</u>	
Particles >71μm		ASTM D7647	>3	0	1	
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>21/19/14</u>	<u>△</u> 25/24/20	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2



OIL ANALYSIS REPORT

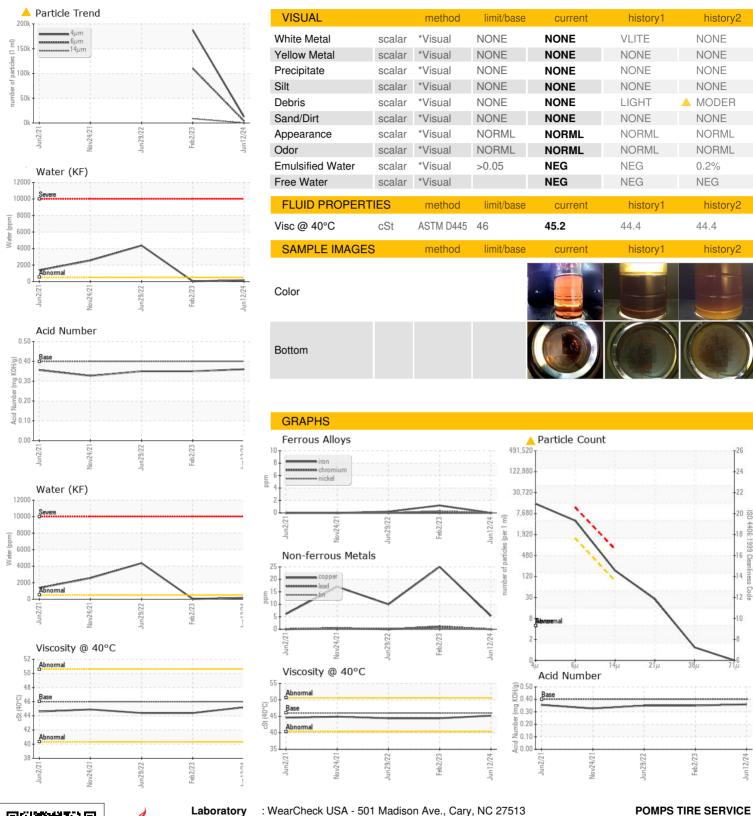





Certificate 12367

Laboratory Sample No.

Lab Number

: KCPA019266 : 06212467 Unique Number : 11085331

Received **Tested** Diagnosed

: 19 Jun 2024 : 19 Jun 2024 - Don Baldridge

: 17 Jun 2024

Test Package : IND 2 (Additional Tests: KF, PrtCount) To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

POMPS TIRE SERVICE 1301 BUSSE RD

ELK GROVE VILLAGE, IL

US 60007

Contact:

T:

F: