

OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

KAESER 7736730

Component Compressor

KAESER SIGMA (OEM) M-460 (--- QTS)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Jun 2024		
CAMPLE INFORM	AATION		11		la la dia sa sa sa sa	la la la marco
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA015373		
Sample Date		Client Info		01 Jun 2024		
Machine Age	hrs	Client Info		4920		
Oil Age	hrs	Client Info		4471		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	<1		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	<1		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	1		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m	710	<1		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES	ррпп	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	58		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	100	74		
Calcium	ppm	ASTM D5185m	0	2		
Phosphorus	ppm	ASTM D5185m	0	1		
Zinc	ppm	ASTM D5185m	0	6		
Sulfur	ppm	ASTM D5185m	23500	21890		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		21		
Potassium	ppm	ASTM D5185m	>20	5		
Water	%	ASTM D6304	>0.05	0.024		
ppm Water	ppm	ASTM D6304	>500	245		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1248		
Particles >6μm		ASTM D7647	>1300	325		
Particles >14µm		ASTM D7647	>80	18		
Particles >21µm		ASTM D7647	>20	3		
Particles >38µm		ASTM D7647	>4	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	17/16/11		
FLUID DEGRADA	TION _	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.36		



OIL ANALYSIS REPORT

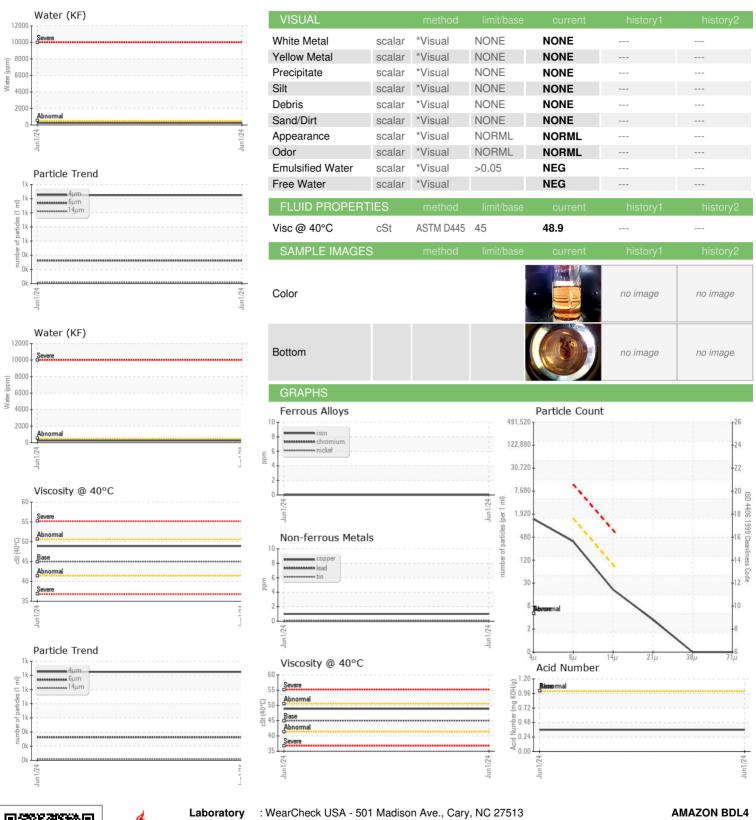



Certificate 12367

Sample No.

Lab Number : 06212468

: KCPA015373 Unique Number : 11085332

Received **Tested** Diagnosed Test Package : IND 2 (Additional Tests: KF, PrtCount)

: 17 Jun 2024 : 19 Jun 2024

: 19 Jun 2024 - Don Baldridge

1215 KENNEDY RD WINDSOR, CT US 06095 Contact: WESLEY PE wesley.pe@amazon.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: AMAWINCT [WUSCAR] 06212468 (Generated: 06/19/2024 18:52:43) Rev: 1

Contact/Location: WESLEY PE - AMAWINCT

T:

F: