




OIL ANALYSIS REPORT

Sample Rating Trend

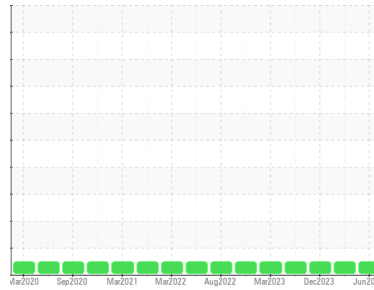

NORMAL



Machine Id
MNTL_B7 MNTL_B7_M7
 Component
Non-Drive End Bearing
 Fluid
MOBIL DTE EXCEL ISO 32 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	RP0032006	RP0032023	RP0031973
Sample Date	Client Info	06 Jun 2024	01 Mar 2024	05 Dec 2023
Machine Age	hrs Client Info	59241	57136	55584
Oil Age	hrs Client Info	59241	57136	55584
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		NORMAL	NORMAL	NORMAL

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >20	0	0	0
Chromium	ppm ASTM D5185m >20	0	<1	0
Nickel	ppm ASTM D5185m >20	<1	0	0
Titanium	ppm ASTM D5185m	0	<1	0
Silver	ppm ASTM D5185m	0	0	0
Aluminum	ppm ASTM D5185m >20	<1	2	0
Lead	ppm ASTM D5185m >20	0	0	0
Copper	ppm ASTM D5185m >20	<1	<1	0
Tin	ppm ASTM D5185m >20	0	<1	0
Vanadium	ppm ASTM D5185m	0	0	0
Cadmium	ppm ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m	0	0	0
Barium	ppm ASTM D5185m	0	0	0
Molybdenum	ppm ASTM D5185m	0	1	<1
Manganese	ppm ASTM D5185m	<1	0	0
Magnesium	ppm ASTM D5185m	4	3	<1
Calcium	ppm ASTM D5185m	2	8	5
Phosphorus	ppm ASTM D5185m	107	101	112
Zinc	ppm ASTM D5185m	73	76	74

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >15	<1	<1	0
Sodium	ppm ASTM D5185m	2	0	0
Potassium	ppm ASTM D5185m >20	2	1	0
Water	% ASTM D6304 >0.05	0.003	0.001	0.003
ppm Water	ppm ASTM D6304 >500	27	12	29




FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D8045 .2	0.16	0.111	0.15

VISUAL

method	limit/base	current	history1	history2
White Metal	scalar *Visual NONE	NONE	NONE	NONE
Yellow Metal	scalar *Visual NONE	NONE	NONE	NONE
Precipitate	scalar *Visual NONE	NONE	NONE	NONE
Silt	scalar *Visual NONE	NONE	NONE	NONE
Debris	scalar *Visual NONE	NONE	LIGHT	NONE
Sand/Dirt	scalar *Visual NONE	NONE	NONE	NONE
Appearance	scalar *Visual NORML	NORML	NORML	NORML
Odor	scalar *Visual NORML	NORML	NORML	NORML
Emulsified Water	scalar *Visual >0.05	NEG	NEG	NEG
Free Water	scalar *Visual	NEG	NEG	NEG

OIL ANALYSIS REPORT

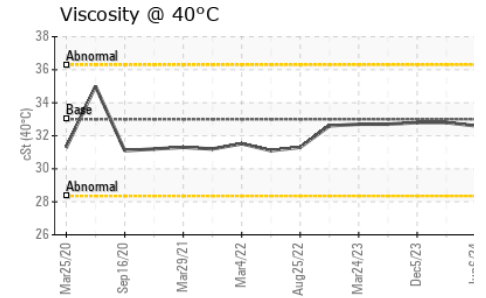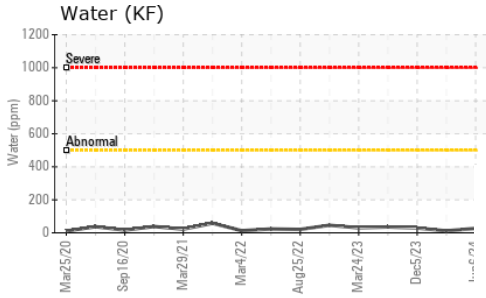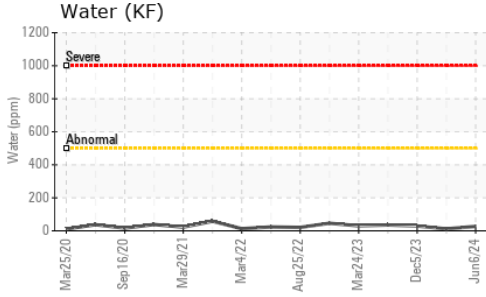

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	33.0	32.6	32.8	32.8





SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

Color



Bottom

GRAPHS

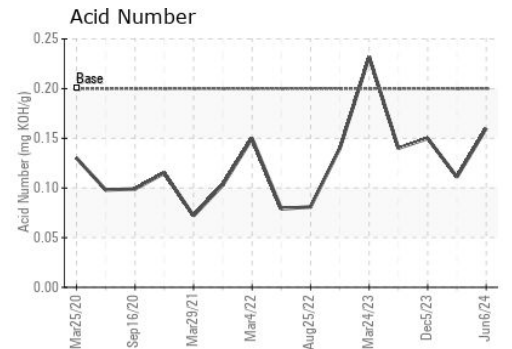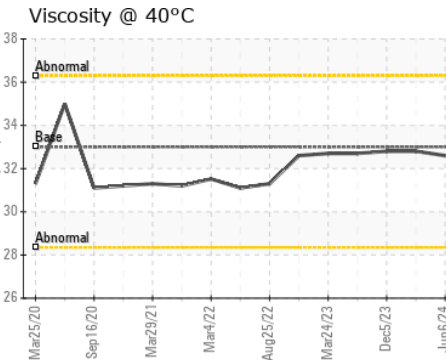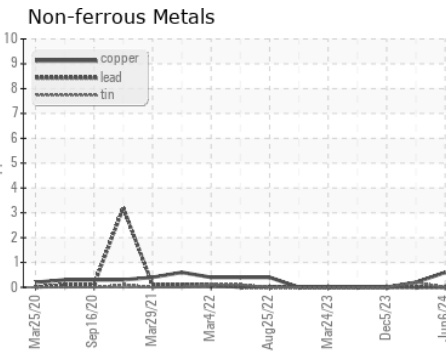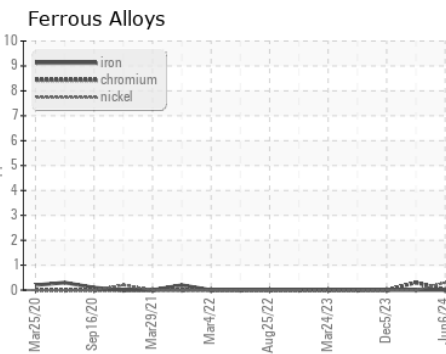

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : RP0032006
Lab Number : **06212490**
Unique Number : 11085354
Test Package : IND 2

Received : 17 Jun 2024
Tested : 19 Jun 2024
Diagnosed : 19 Jun 2024 - Angela Borella

ENERGY TRANSFER - MONTELLO
 535 FRITZTOWN RD
 SINKING SPRINGS, PA
 US 19608

Contact: JON FEDEROFF
 jonathan.federoff@energytransfer.com
 T: (215)669-3237

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: x: