




# OIL ANALYSIS REPORT

Sample Rating Trend

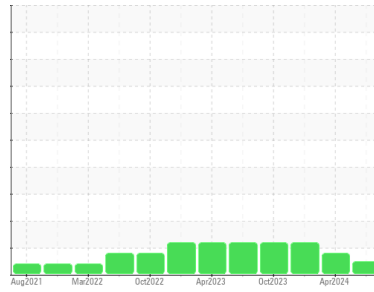

**NORMAL**



Area  
**Fermentation**  
 Machine Id  
**1304-B Seed Tank**  
 Component  
**Agitator Gearbox**  
 Fluid  
**Mobilgear 629 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0936684</b>	WC0928275	WC0881830
Sample Date	Client Info			<b>12 Jun 2024</b>	24 Apr 2024	22 Jan 2024
Machine Age	hrs	Client Info		<b>0</b>	0	0
Oil Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>150	<b>26</b>	47	42
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	<1	0
Nickel	ppm	ASTM D5185m	>10	<b>&lt;1</b>	<1	0
Titanium	ppm	ASTM D5185m		<b>0</b>	<1	<1
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>25	<b>&lt;1</b>	2	<1
Lead	ppm	ASTM D5185m	>100	<b>0</b>	1	<1
Copper	ppm	ASTM D5185m	>50	<b>1</b>	<1	<1
Tin	ppm	ASTM D5185m	>10	<b>&lt;1</b>	<1	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	<1	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	<1	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>7</b>	9	9
Barium	ppm	ASTM D5185m		<b>0</b>	<1	0
Molybdenum	ppm	ASTM D5185m		<b>2</b>	<1	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m		<b>12</b>	<1	<1
Calcium	ppm	ASTM D5185m		<b>65</b>	8	6
Phosphorus	ppm	ASTM D5185m		<b>346</b>	307	289
Zinc	ppm	ASTM D5185m		<b>54</b>	10	8
Sulfur	ppm	ASTM D5185m		<b>17860</b>	16113	13767





CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	<b>2</b>	3	2
Sodium	ppm	ASTM D5185m		<b>15</b>	12	14
Potassium	ppm	ASTM D5185m	>20	<b>6</b>	9	8
Water	%	ASTM D6304	>0.1	<b>0.009</b>	0.005	0.040
ppm Water	ppm	ASTM D6304	>1000	<b>94</b>	53	401

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>20000	<b>16076</b>	▲ 65973	▲ 92537
Particles >6µm		ASTM D7647	>5000	<b>1608</b>	4420	● 8776
Particles >14µm		ASTM D7647	>640	<b>16</b>	28	84
Particles >21µm		ASTM D7647	>160	<b>2</b>	6	16
Particles >38µm		ASTM D7647	>40	<b>0</b>	0	1
Particles >71µm		ASTM D7647	>10	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>21/19/16	<b>21/18/11</b>	▲ 23/19/12	▲ 24/20/14

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.53</b>	0.78	0.69








# OIL ANALYSIS REPORT

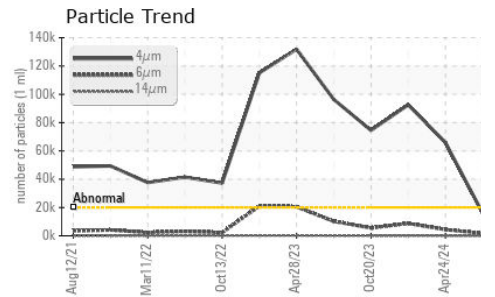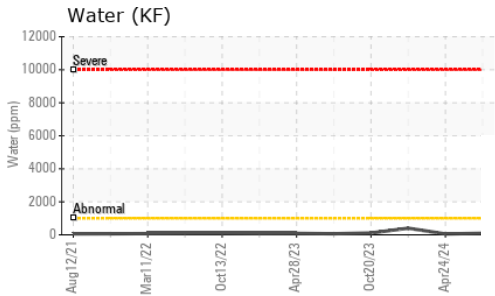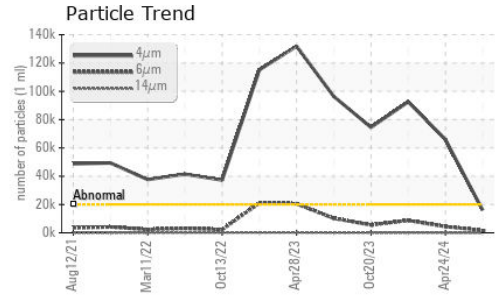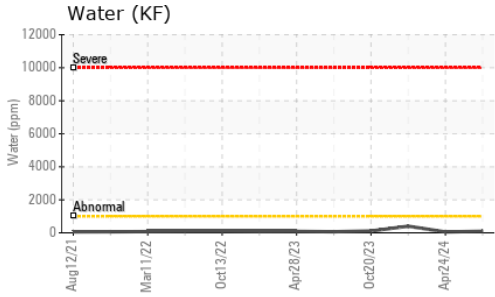

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	<b>LIGHT</b>	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color			no image		
Bottom			no image		

## GRAPHS

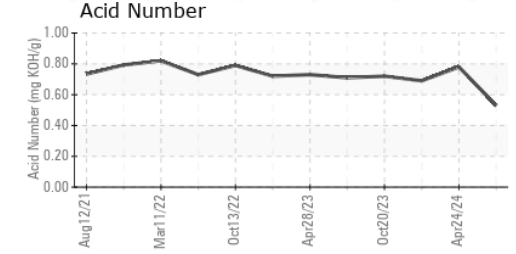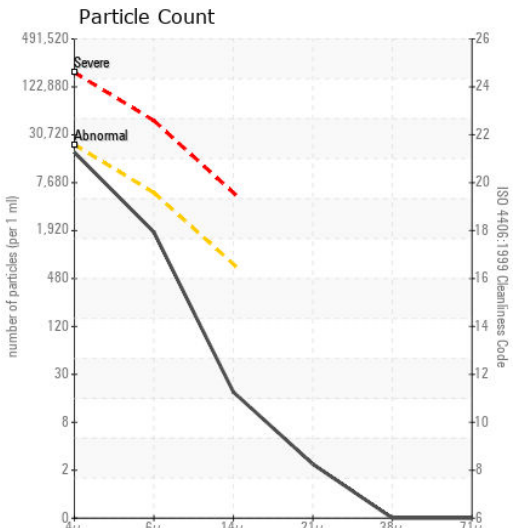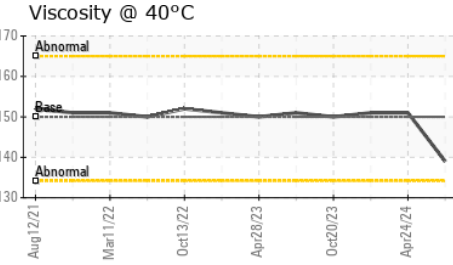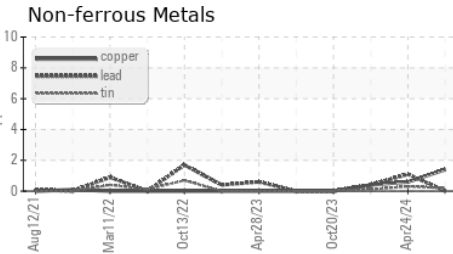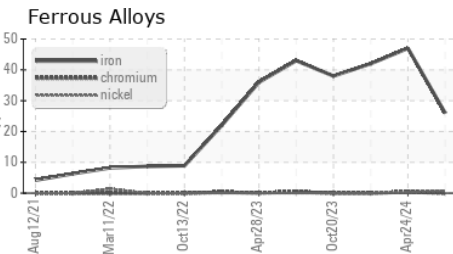

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0936684      **Received** : 17 Jun 2024  
**Lab Number** : **06212627**      **Tested** : 21 Jun 2024  
**Unique Number** : 11085491      **Diagnosed** : 21 Jun 2024 - Jonathan Hester  
**Test Package** : PLANT

**AJINOMOTO USA**  
 4020 AJINOMOTO DRIVE  
 RALEIGH, NC  
 US 27610  
 Contact: Michael Thompson  
 thompsonm@ajiusa.com  
 T: (919)723-2142  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)