




# OIL ANALYSIS REPORT

Sample Rating Trend

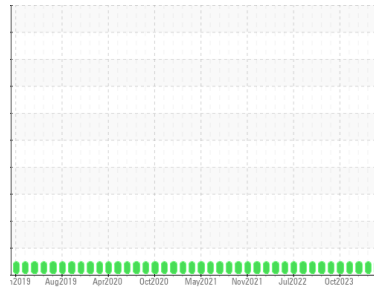

**NORMAL**



Area  
**DAVID K WILSON**  
 Machine Id  
**[DAVID K WILSON] 007 534110-7**  
 Component  
**Port Genset**  
 Fluid  
**CHEVRON DELO 400 XLE 15W40 (5 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>MW0018141</b>	MW0066213	MW0020482
Sample Date	Client Info			<b>31 May 2024</b>	01 Feb 2024	27 Dec 2023
Machine Age	hrs	Client Info		<b>40266</b>	38660	0
Oil Age	hrs	Client Info		<b>497</b>	305	396
Oil Changed	Client Info			<b>N/A</b>	Not Changd	Changed
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method	>4.0		<b>&lt;1.0</b>	<1.0	<1.0
Water	WC Method	>0.1		<b>NEG</b>	NEG	NEG
Glycol	WC Method			<b>NEG</b>	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>2</b>	5	3
Chromium	ppm	ASTM D5185m	>4	<b>0</b>	<1	<1
Nickel	ppm	ASTM D5185m	>2	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185m		<b>3</b>	4	3
Silver	ppm	ASTM D5185m	>5	<b>0</b>	<1	0
Aluminum	ppm	ASTM D5185m	>12	<b>3</b>	2	2
Lead	ppm	ASTM D5185m	>17	<b>0</b>	4	3
Copper	ppm	ASTM D5185m	>70	<b>2</b>	4	3
Tin	ppm	ASTM D5185m	>15	<b>0</b>	<1	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	<1	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	<1	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>171</b>	200	185
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>75</b>	78	74
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m		<b>495</b>	473	467
Calcium	ppm	ASTM D5185m		<b>2076</b>	1934	1901
Phosphorus	ppm	ASTM D5185m	760	<b>535</b>	461	536
Zinc	ppm	ASTM D5185m	830	<b>619</b>	602	593
Sulfur	ppm	ASTM D5185m	2770	<b>2912</b>	2737	2495

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>4</b>	7	4
Sodium	ppm	ASTM D5185m		<b>2</b>	0	2
Potassium	ppm	ASTM D5185m	>20	<b>3</b>	3	<1


INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		<b>0.2</b>	0.3	0.2
Nitration	Abs/cm	*ASTM D7624	>20	<b>7.6</b>	8.4	7.6
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>19.2</b>	20.2	19.8

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>14.3</b>	15.8	14.7
Base Number (BN)	mg KOH/g	ASTM D2896	10.7	<b>8.2</b>	7.7	8.0




# OIL ANALYSIS REPORT


FT-IR (Direct Trend)

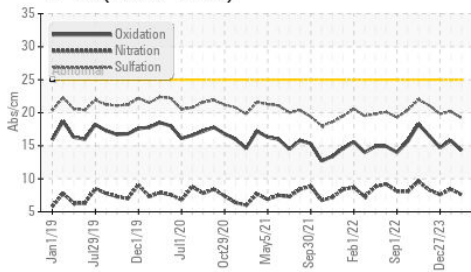

Base Number

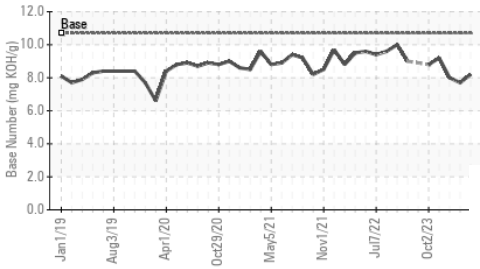

Viscosity @ 100°C

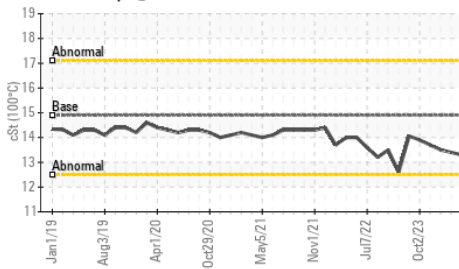


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	14.9	13.3	13.4

## GRAPHS


Ferrous Alloys

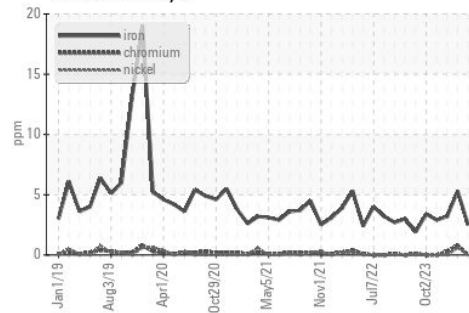


Non-ferrous Metals

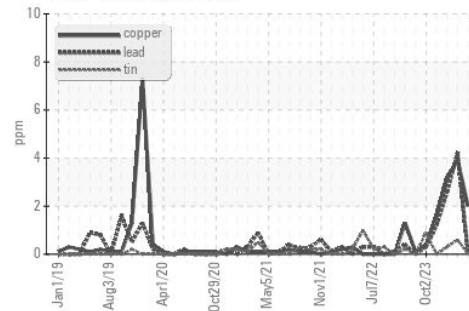

Viscosity @ 100°C

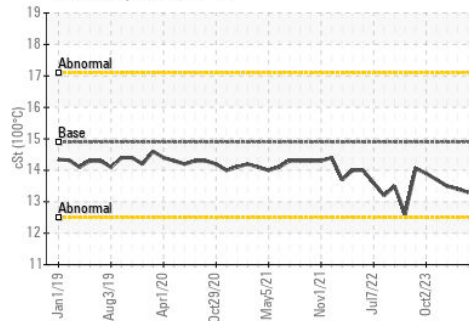

Base Number

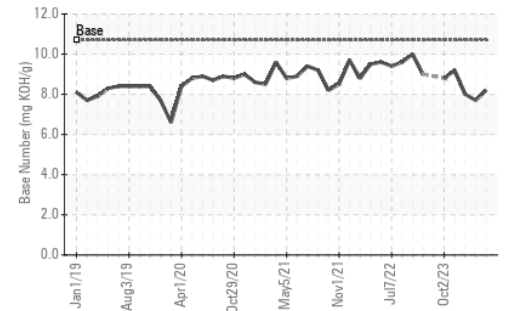

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : MW0018141  
 Lab Number : 06212785  
 Unique Number : 11085649  
 Test Package : MAR 2

Received : 17 Jun 2024  
 Tested : 19 Jun 2024  
 Diagnosed : 19 Jun 2024 - Angela Borella

INGRAM BARGE  
 900 S 3RD ST  
 PADUCAH, KY  
 US 42003

Contact: ANTHONY VAN CURA  
 anthony.vancura@ingrambarga.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (270)415-4467  
 F: (615)695-3697