




# OIL ANALYSIS REPORT

Sample Rating Trend

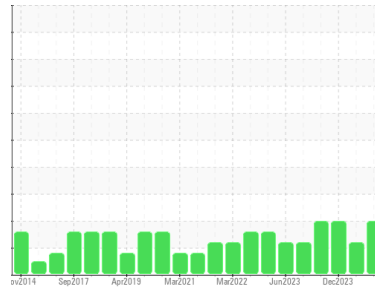

ISO



Area

**PRESS**

Machine Id

**PRESS BULK STORAGE TANK (S/N PR7)**

Component

**Bulk Fluid Tank**

Fluid

**AW HYDRAULIC OIL ISO 68 (--- GAL)**

## DIAGNOSIS

### Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC06213048</b>	WC0895033	WC0782930
Sample Date	Client Info		<b>13 Jun 2024</b>	07 Mar 2024	28 Dec 2023
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>ABNORMAL</b>	ABNORMAL	ABNORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	<b>0</b>	0	0
Lead	ppm	ASTM D5185m	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	<b>0</b>	<1	<1
Tin	ppm	ASTM D5185m	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	<1	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	5	<b>0</b>	0
Barium	ppm	ASTM D5185m	5	<b>0</b>	0
Molybdenum	ppm	ASTM D5185m	5	<b>&lt;1</b>	<1
Manganese	ppm	ASTM D5185m		<b>0</b>	0
Magnesium	ppm	ASTM D5185m	25	<b>1</b>	<1
Calcium	ppm	ASTM D5185m	200	<b>55</b>	57
Phosphorus	ppm	ASTM D5185m	300	<b>337</b>	327
Zinc	ppm	ASTM D5185m	370	<b>431</b>	425
Sulfur	ppm	ASTM D5185m	2500	<b>893</b>	817

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m		<b>&lt;1</b>	<1
Sodium	ppm	ASTM D5185m		<b>2</b>	<1
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	0
Water	%	ASTM D6304		<b>NEG</b>	NEG

## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>320	<b>▲ 572</b>	▲ 795	▲ 1064
Particles >6µm	ASTM D7647	>80	<b>▲ 169</b>	● 115	▲ 235
Particles >14µm	ASTM D7647	>10	<b>▲ 20</b>	8	▲ 18
Particles >21µm	ASTM D7647	>3	<b>▲ 7</b>	2	▲ 6
Particles >38µm	ASTM D7647	>3	<b>1</b>	0	1
Particles >71µm	ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>15/13/10	<b>▲ 16/15/11</b>	▲ 17/14/10	▲ 17/15/11


## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.57	<b>0.28</b>	0.22




# OIL ANALYSIS REPORT


## Particle Trend

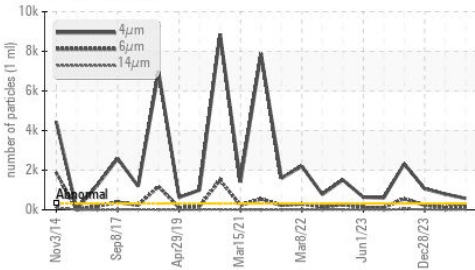


## Viscosity @ 100°C

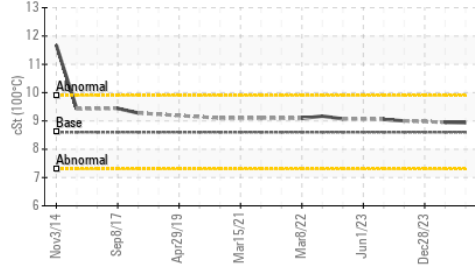


## Viscosity @ 100°C

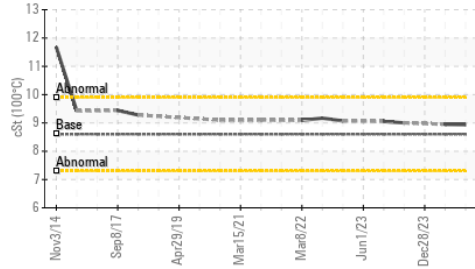

## Viscosity @ 40°C

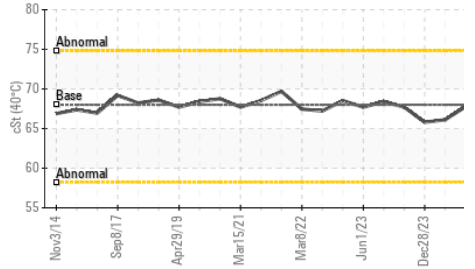


## Acid Number

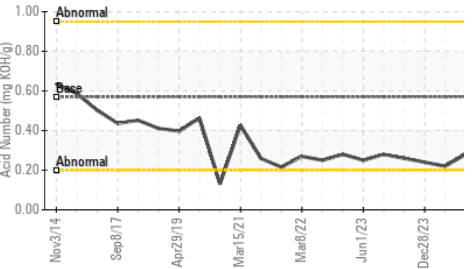





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	NEG	NEG	NEG
Free Water	scalar	*Visual	NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	68	67.76	66.11
Visc @ 100°C	cSt	ASTM D445	8.6	8.94	8.95
Viscosity Index (VI)	Scale	ASTM D2270	96	105	109

## SAMPLE IMAGES

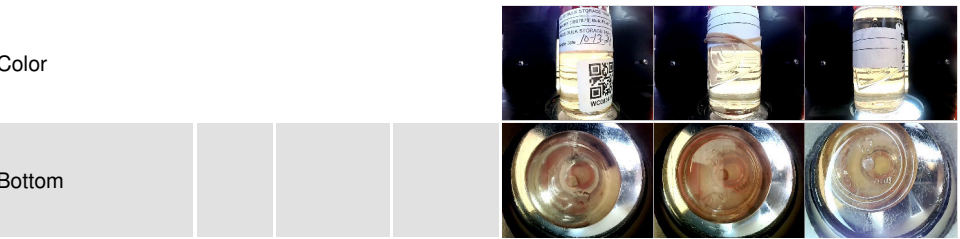

## GRAPHS

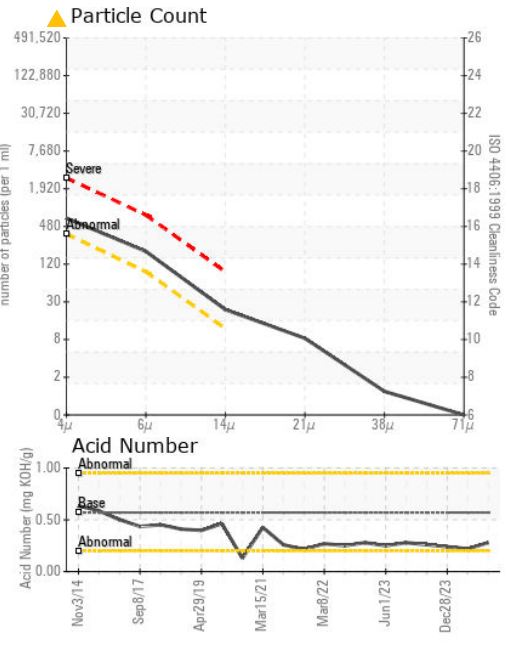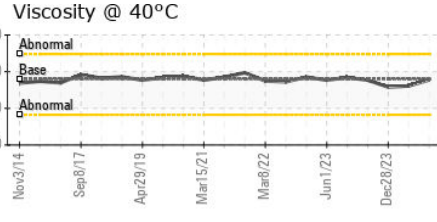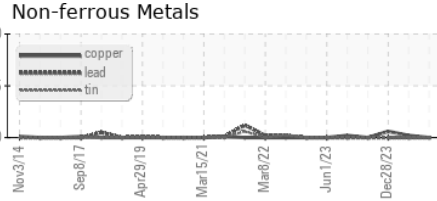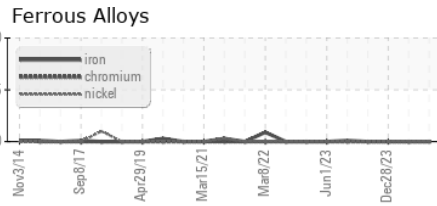

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC06213048 **Received** : 17 Jun 2024  
**Lab Number** : 06213048 **Tested** : 20 Jun 2024  
**Unique Number** : 11085912 **Diagnosed** : 20 Jun 2024 - Jonathan Hester  
**Test Package** : IND 2 ( Additional Tests: KF, KV100, PrtCount, VI )

**J.M. Huber Corporation**  
 PO BOX 38  
 CRYSTAL HILL, VA  
 US 24539  
 Contact: Ted Hudson  
 ted.hudson@huber.com  
 T: (434)476-6628  
 F: (434)476-8133

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)