




OIL ANALYSIS REPORT

Sample Rating Trend

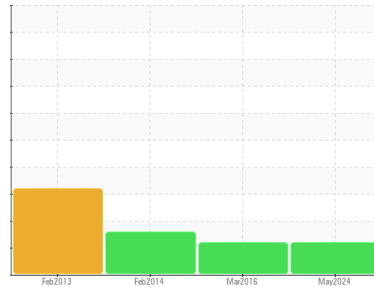

ISO



Machine Id
KAESER AIRCENTER SK 15 4418110 (S/N 1201)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- QTS)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCPA018152	KC57061	KC37461
Sample Date	Client Info			24 May 2024	01 Mar 2016	19 Feb 2014
Machine Age	hrs	Client Info		42780	9360	3111
Oil Age	hrs	Client Info		3000	2800	2470
Oil Changed	Client Info			Changed	Changed	Changed
Sample Status				ATTENTION	ATTENTION	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	<1
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	<1	0	<1
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	<1	0	0
Aluminum	ppm	ASTM D5185m	>10	2	<1	<1
Lead	ppm	ASTM D5185m	>10	<1	0	<1
Copper	ppm	ASTM D5185m	>50	4	4	1
Tin	ppm	ASTM D5185m	>10	<1	3	0
Antimony	ppm	ASTM D5185m		---	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	0
Barium	ppm	ASTM D5185m	90	27	1	7
Molybdenum	ppm	ASTM D5185m	0	<1	<1	0
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m	100	34	58	77
Calcium	ppm	ASTM D5185m	0	0	1	1
Phosphorus	ppm	ASTM D5185m	0	10	0	3
Zinc	ppm	ASTM D5185m	0	15	8	5
Sulfur	ppm	ASTM D5185m	23500	17659	18863	18303

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	2	2
Sodium	ppm	ASTM D5185m		13	18	15
Potassium	ppm	ASTM D5185m	>20	4	2	4
Water	%	ASTM D6304	>0.05	0.021	0.021	0.019
ppm Water	ppm	ASTM D6304	>500	211	210	190

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		7252	1589	2718
Particles >6µm		ASTM D7647	>1300	2350	866	▲ 1480
Particles >14µm		ASTM D7647	>80	109	● 147	▲ 252
Particles >21µm		ASTM D7647	>20	14	● 49	▲ 85
Particles >38µm		ASTM D7647	>4	0	● 7	▲ 13
Particles >71µm		ASTM D7647	>3	0	0	1
Oil Cleanliness		ISO 4406 (c)	>--/17/13	20/18/14	● 17/14	▲ 18/15

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.35	0.405	0.419


OIL ANALYSIS REPORT

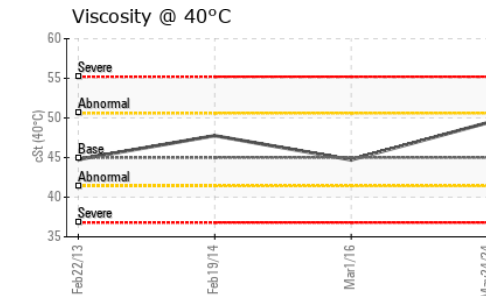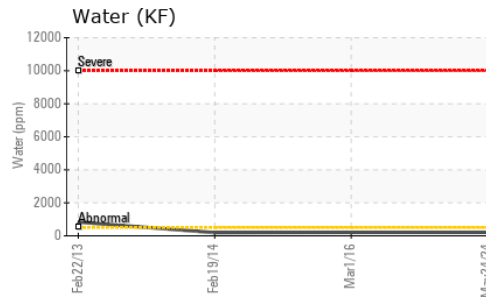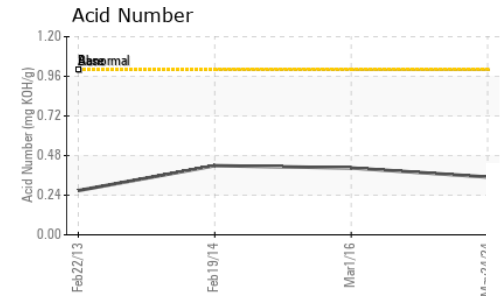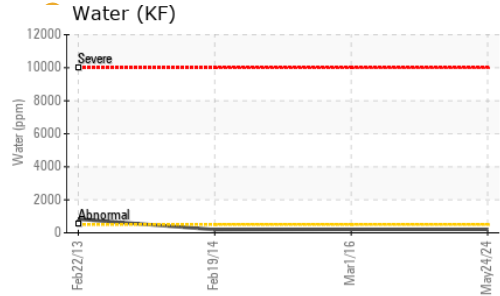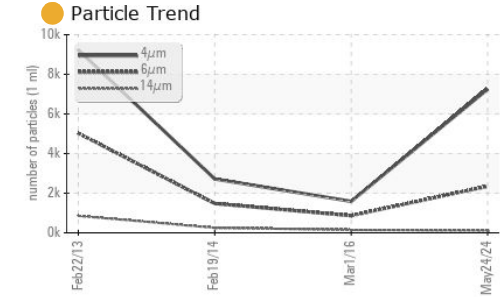






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	49.4	44.72

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

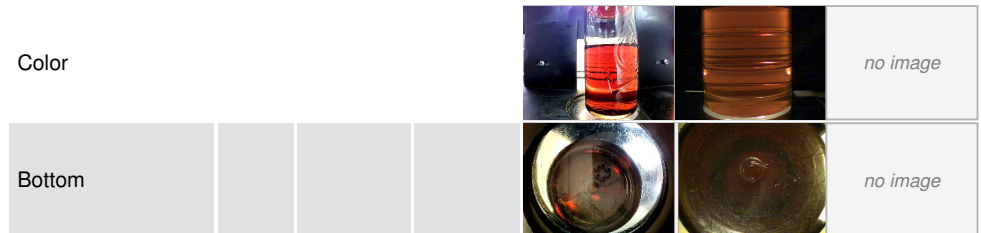

GRAPHS

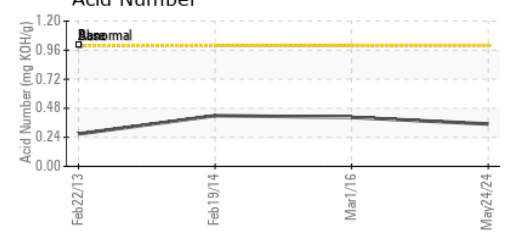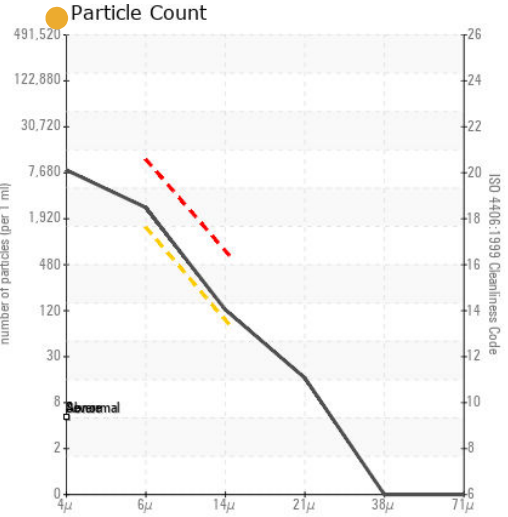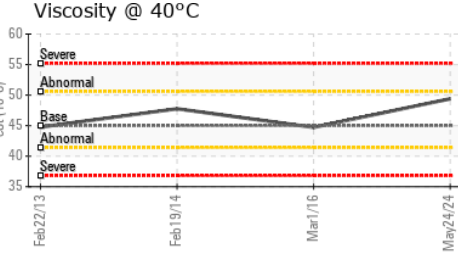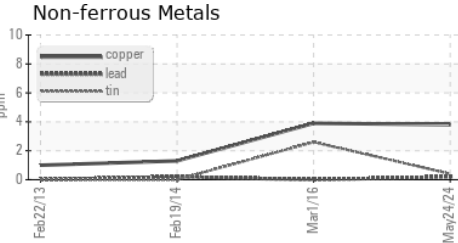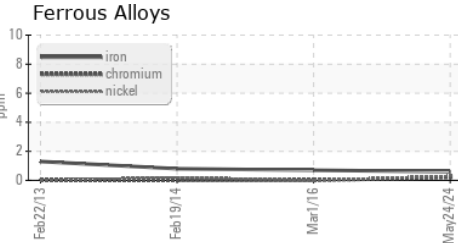

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA018152 **Received** : 18 Jun 2024
Lab Number : 06213461 **Tested** : 19 Jun 2024
Unique Number : 11086325 **Diagnosed** : 20 Jun 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

FOX RACING SHOX
 750 VERNON WAY
 EL CAJON, CA
 US 92021
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)