


OIL ANALYSIS REPORT

Sample Rating Trend

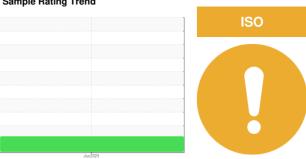

Machine Id

9112710 (S/N 1644)

Compressor

KAESER SIGMA (OEM) FG-460 (--- GAL)

Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Jun 2024		
CAMPLE INCOR	AATION		12 24 7		1111	1::-
SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA012339		
Sample Date		Client Info		12 Jun 2024		
Machine Age	hrs	Client Info		149		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		Changed		
Sample Status				ATTENTION		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	3		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m	>3	<1		
Titanium	ppm	ASTM D5185m	>3	<1		
Silver	ppm	ASTM D5185m	>2	<1		
Aluminum	ppm	ASTM D5185m	>10	2		
Lead	ppm	ASTM D5185m	>10	<1		
Copper	ppm	ASTM D5185m	>50	2		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		<1		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		<1		
Molybdenum	ppm	ASTM D5185m		<1		
Manganese	ppm	ASTM D5185m		2		
Magnesium	ppm	ASTM D5185m		12		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m	500	398		
Zinc	ppm	ASTM D5185m		56		
Sulfur	ppm	ASTM D5185m		4929		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		1		
Potassium	ppm	ASTM D5185m	>20	1		
Water	%	ASTM D6304	>0.05	0.007		
ppm Water	ppm	ASTM D6304	>500	75		
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		4553		
Particles >6µm		ASTM D7647	>1300	<u>2131</u>		
Particles >14µm		ASTM D7647	>80	89		
Particles >21µm		ASTM D7647	>20	9		
Particles >38µm		ASTM D7647	>4	1		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/18/14		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.5	1.33		



OIL ANALYSIS REPORT

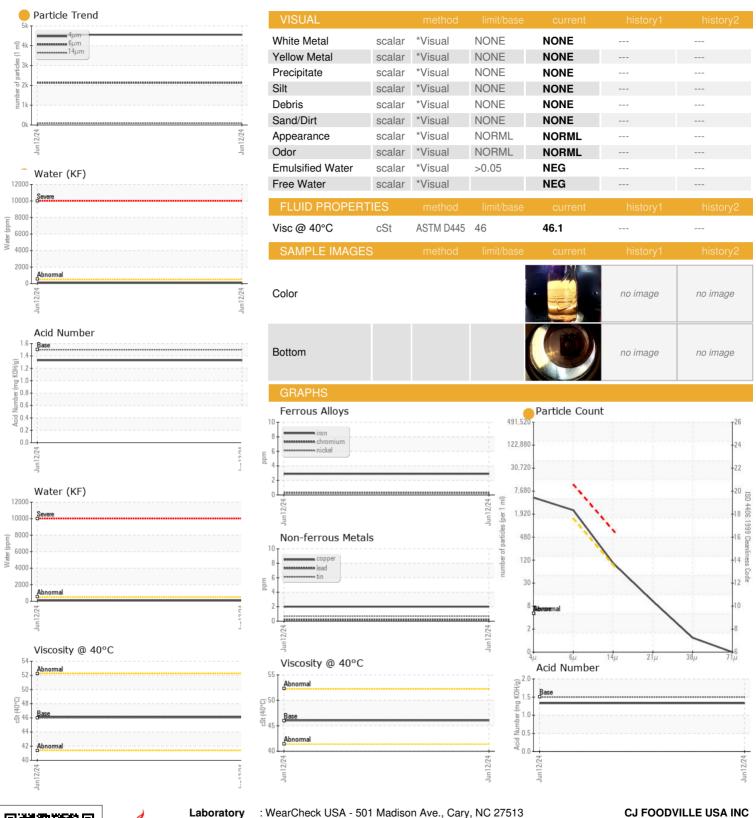



Laboratory Sample No.

Lab Number : 06213464

: KCPA012339 Unique Number : 11086328

Received : 18 Jun 2024 **Tested**

: 19 Jun 2024 Diagnosed

: 20 Jun 2024 - Don Baldridge

Test Package : IND 2 (Additional Tests: KF, PrtCount) Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: Contact/Location: Service Manager - CJFCOM

6834 E SLAUSON AVE

Contact: Service Manager

COMMERCE, CA

US 90040

T: