


# **OIL ANALYSIS REPORT**

Sample Rating Trend

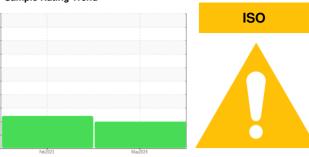

Machine Id

## **KAESER 7188704**

Component Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

### **DIAGNOSIS**

#### Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			F802U23	May2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA018014	KCP54277	
Sample Date		Client Info		23 May 2024	28 Feb 2023	
Machine Age	hrs	Client Info		9913	8100	
Oil Age	hrs	Client Info		3000	8100	
Oil Changed		Client Info		Changed	Changed	
Sample Status				ABNORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	0	
Chromium	ppm	ASTM D5185m	>10	<1	0	
Nickel	ppm	ASTM D5185m	>3	<1	0	
Titanium	ppm	ASTM D5185m	>3	<1	0	
Silver	ppm	ASTM D5185m	>2	<1	0	
Aluminum	ppm	ASTM D5185m	>10	2	<1	
Lead	ppm	ASTM D5185m	>10	<1	0	
Copper	ppm	ASTM D5185m	>50	19	6	
Tin	ppm	ASTM D5185m	>10	<1	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		<1	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	14	50	
Molybdenum	ppm	ASTM D5185m	0	<1	0	
Manganese	ppm	ASTM D5185m		<1	0	
Magnesium	ppm	ASTM D5185m	100	18	51	
Calcium	ppm	ASTM D5185m	0	0	2	
Phosphorus	ppm	ASTM D5185m	0	1	2	
Zinc	ppm	ASTM D5185m	0	29	11	
Sulfur	ppm	ASTM D5185m	23500	19615	20419	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	2	<1	
Sodium	ppm	ASTM D5185m		<1	2	
Potassium	ppm	ASTM D5185m	>20	1	0	
Water	%	ASTM D6304	>0.05	0.009	0.023	
ppm Water	ppm	ASTM D6304	>500	95	235.4	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		39581	78917	
Particles >6µm		ASTM D7647	>1300	<b>15324</b>	<b>46009</b>	
Particles >14µm		ASTM D7647	>80	<u> </u>	<b>△</b> 9378	
Particles >21µm		ASTM D7647	>20	<u> </u>	<u>^</u> 2687	
Particles >38µm		ASTM D7647	>4	<u>^</u> 5	<u>^</u> 210	
Particles >71μm		ASTM D7647	>3	1	<u></u> 5	
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>22/21/17</u>	<u>\$\text{23/23/20}\$</u>	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.34	0.37	



## **OIL ANALYSIS REPORT**







Laboratory Sample No.

Lab Number

: KCPA018014 : 06213471 Unique Number : 11086335

Received **Tested** Diagnosed

: 18 Jun 2024 : 19 Jun 2024

: 20 Jun 2024 - Don Baldridge

8710 VIA DE LA FUENTE SAN DIEGO, CA US 92154 Contact: Service Manager

Test Package : IND 2 ( Additional Tests: KF, PrtCount ) Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: Contact/Location: Service Manager - PENSANCAL

T: