


OIL ANALYSIS REPORT

Sample Rating Trend

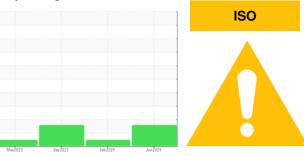

Machine Id

KAESER 6735678

Component Compressor Fluid KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA018242	KCP47404D	KCP40099D
Sample Date		Client Info		05 Jun 2024	01 Feb 2024	15 Sep 2023
Machine Age	hrs	Client Info		33415	31025	20157
Oil Age	hrs	Client Info		3000	3000	2200
Oil Changed		Client Info		Changed	Changed	Not Changd
Sample Status				ABNORMAL	NORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	0
Chromium	ppm	ASTM D5185m	>10	<1	<1	0
Nickel	ppm	ASTM D5185m	>3	<1	<1	0
Titanium	ppm	ASTM D5185m	>3	<1	<1	0
Silver	ppm	ASTM D5185m	>2	<1	<1	0
Aluminum	ppm	ASTM D5185m	>10	2	<1	<1
Lead	ppm	ASTM D5185m	>10	_ <1	<1	0
Copper	ppm	ASTM D5185m	>50	6	9	<1
Tin	ppm	ASTM D5185m	>10	<1	<1	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		<1	<1	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	0
Barium	ppm	ASTM D5185m	90	3	6	26
Molybdenum	ppm	ASTM D5185m	0	<1	<1	0
Manganese	ppm	ASTM D5185m		<1	<1	0
Magnesium	ppm	ASTM D5185m	100	13	2	83
Calcium	ppm	ASTM D5185m	0	0	0	5
Phosphorus	ppm	ASTM D5185m	0	0	0	3
Zinc	ppm	ASTM D5185m	0	50	45	14
Sulfur	ppm	ASTM D5185m	23500	19344	21879	19904
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	0
Sodium	ppm	ASTM D5185m		2	0	19
Potassium	ppm	ASTM D5185m	>20	2	<1	4
Water	%	ASTM D6304	>0.05	0.012	0.011	0.001
ppm Water	ppm	ASTM D6304	>500	127	111	11.8
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		25700	4477	13161
Particles >6µm		ASTM D7647		<u> </u>	1139	4568
Particles >14µm		ASTM D7647	>80	<u> </u>	66	464
Particles >21µm		ASTM D7647	>20	<u> </u>	12	🔺 116
Particles >38µm		ASTM D7647	>4	2	0	4
Particles >71µm		ASTM D7647	>3	1	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	A 22/20/15	19/17/13	1 /19/16
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.43	0.46	0.39


Contact/Location: Service Manager - EDCLEMCA Page 1 of 2



OIL ANALYSIS REPORT






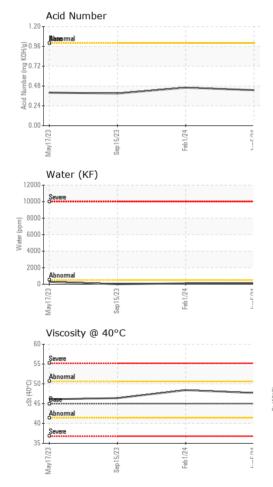

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT	IES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	47.7	48.4	46.4
SAMPLE IMAGES	3	method	limit/base	current	history1	history2
Color					•	•

Bottom

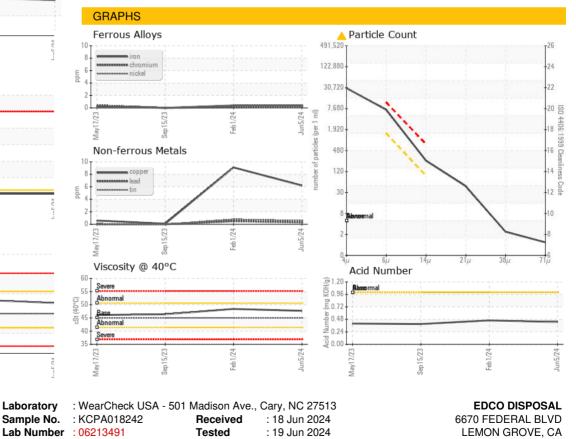

: 20 Jun 2024 - Don Baldridge

Diagnosed

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: EDCLEMCA [WUSCAR] 06213491 (Generated: 06/21/2024 17:43:49) Rev: 1

Certificate 12367

Laboratory

Sample No.

Unique Number : 11086355

Test Package : IND 2 (Additional Tests: KF, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Contact/Location: Service Manager - EDCLEMCA

US 91945

T:

F:

Contact: Service Manager