




# OIL ANALYSIS REPORT

## Sample Rating Trend

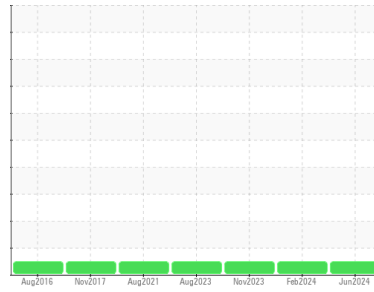

**NORMAL**



Area

**AIRLUBE 268 [CSA224]**

Machine Id

**ATLAS COPCO 100CA-CMP-100B - NRG SEWARD (S/N AIF118345)**

Component

**Compressor**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>UCH06213588</b>	UCH06097817	UCH06016591
Sample Date	Client Info		<b>07 Jun 2024</b>	16 Feb 2024	02 Nov 2023
Machine Age	hrs	Client Info	<b>131119</b>	0	125907
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>Changed</b>	N/A	Not Chngd
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

### CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	<b>NEG</b>	NEG	NEG

### WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m >5	<b>0</b>	<1	0
Nickel	ppm	ASTM D5185m	<b>0</b>	<1	<1
Titanium	ppm	ASTM D5185m	<b>0</b>	<1	0
Silver	ppm	ASTM D5185m	<b>0</b>	<1	0
Aluminum	ppm	ASTM D5185m >15	<b>0</b>	<1	0
Lead	ppm	ASTM D5185m >65	<b>0</b>	<1	0
Copper	ppm	ASTM D5185m >65	<b>0</b>	<1	0
Tin	ppm	ASTM D5185m >10	<b>0</b>	<1	<1
Vanadium	ppm	ASTM D5185m	<b>0</b>	<1	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	<1	0

### ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0.6	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 0.1	<b>0</b>	5	0
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	<1	0
Manganese	ppm	ASTM D5185m 0.4	<b>0</b>	<1	0
Magnesium	ppm	ASTM D5185m 0	<b>0</b>	0	<1
Calcium	ppm	ASTM D5185m 0	<b>0</b>	0	<1
Phosphorus	ppm	ASTM D5185m 337	<b>271</b>	203	269
Zinc	ppm	ASTM D5185m 0.1	<b>0</b>	2	0
Sulfur	ppm	ASTM D5185m 1096	<b>1427</b>	1053	1202

### CONTAMINANTS


	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >35	<b>2</b>	<1	2
Sodium	ppm	ASTM D5185m	<b>&lt;1</b>	0	<1
Potassium	ppm	ASTM D5185m >20	<b>0</b>	<1	<1

### FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.414	<b>0.06</b>	0.223	0.101




# OIL ANALYSIS REPORT

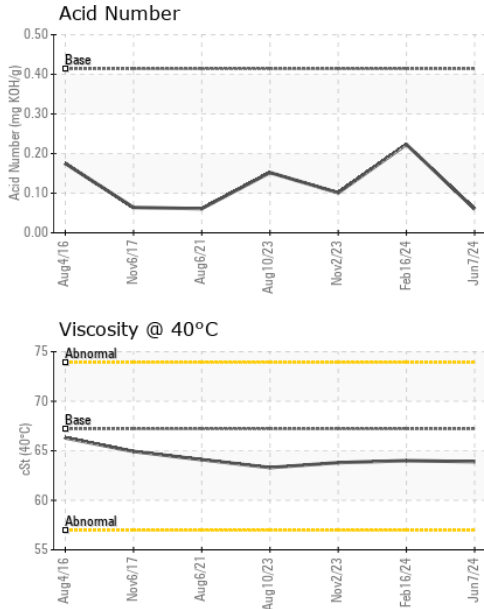



VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	67.21	63.9	64.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

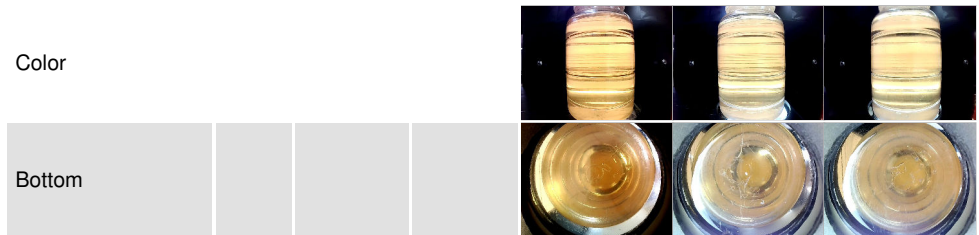

## GRAPHS

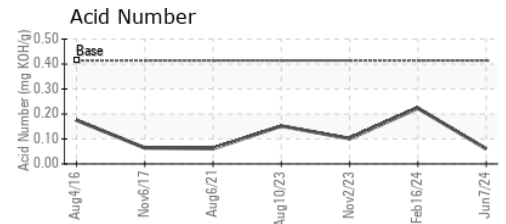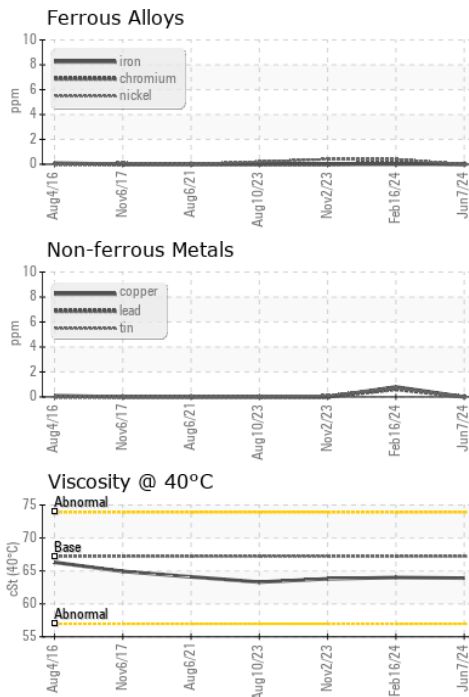

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH06213588  
**Lab Number** : 06213588  
**Unique Number** : 11086452  
**Test Package** : IND 2

**Received** : 18 Jun 2024  
**Tested** : 20 Jun 2024  
**Diagnosed** : 20 Jun 2024 - Wes Davis

**AIR TECHNOLOGIES INC (PIT)**  
 310 PLUM INDUSTRIAL CT  
 PITTSBURGH, PA  
 US 15239  
 Contact: MIKE STRAZZERA  
 mike.strazzera@aircompressors.com  
 T: (724)327-2818  
 F: (412)788-4799

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)