


# **FUEL REPORT**







#### Recommendation

No corrective action is recommended at this time. Comments noted but no contamination was found.

#### Corrosion

All metal levels are normal indicating no corrosion in the system.

### Contaminants

The water content is negligible. There is no indication of any contamination in the fuel.


#### **Fuel Condition**


The condition of the fuel is acceptable for the time in service.

Diesei Fuei Fluid							
No.2 DIESEL FUEL (UL1	(RALOW SULPHUR	( GAL)			Jun 2024		
	SAMPLE INFOR	RMATION	method	limit/base	current	history1	history2
	Sample Number		Client Info		VCP455238		
mmended at this time.	Sample Date		Client Info		14 Jun 2024		
ntamination was found.	Machine Age	hrs	Client Info		134		
	Sample Status				NORMAL		
ndicating no corrosion	PHYSICAL PRO	PERTIES	S method	limit/base	current	history1	history2
	Visc @ 40°C	cSt	ASTM D445	3.0	2.53		
ble. There is no tion in the fuel.	SULFUR CONT	ENT	method	limit/base	current	history1	history2
	Sulfur	ppm	ASTM D5185m	10	0		
acceptable for the time	CONTAMINANT	S	method	limit/base	current	history1	history2
	Silicon	ppm	ASTM D5185m	<1.0	0		
	Sodium	ppm	ASTM D5185m		1		
	Potassium	ppm	ASTM D5185m	<0.1	0		
	Water	%	ASTM D6304		0.003		
	ppm Water	ppm	ASTM D6304	<500	29		
	HEAVY METAL	S	method	limit/base	current	history1	history2
	Aluminum	ppm	ASTM D5185m	<0.1	0		
	Nickel	ppm	ASTM D5185m	< 0.1	0		
	Lead	ppm	ASTM D5185m	< 0.1	0		
	Vanadium	ppm	ASTM D5185m	< 0.1	0		
	Iron	ppm	ASTM D5185m	< 0.1	0		
	Calcium	ppm	ASTM D5185m	< 0.1	0		
	Magnesium	ppm	ASTM D5185m	< 0.1	0		
	Phosphorus	ppm	ASTM D5185m	< 0.1	0		
	Zinc	ppm	ASTM D5185m	<0.1	0		
	SAMPLE IMAGI	ΞS	method	limit/base	current	history1	history2
	Color					no image	no image
	Bottom					no image	no image

# VOLVO

### **FUEL REPORT**

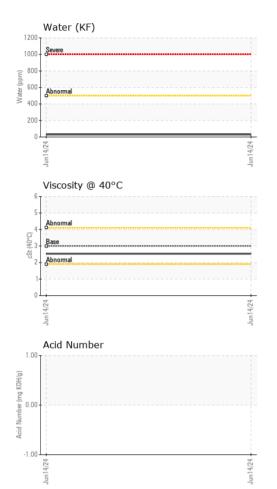





Certificate 12367

Laboratory Sample No.

Lab Number : 06213978 Unique Number : 11086842

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : VCP455238

Received **Tested** Diagnosed : 25 Jun 2024 - Doug Bogart

: 18 Jun 2024 : 25 Jun 2024

SCOTT EQUIPMENT COMPANY LLC - Lavergne 1231 BRIDGESTONE PARKWAY LAVERGNE, TN US 37086

Test Package : MOB 1 ( Additional Tests: KF ) To discuss this sample report, contact Customer Service at 1-800-237-1369. \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Contact: ANDY CHAMBERS achambers@scottcompanies.com T:

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) Report Id: VOLVO0129 [WUSCAR] 06213978 (Generated: 06/25/2024 18:17:27) Rev: 1

Contact/Location: ANDY CHAMBERS - VOLVO0129

F: (615)793-9655