



OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL



Area

EL SAUZ [200007686]

Machine Id


F04WEA90039 (S/N HR002708A-10022)

Component

Hydraulic System

Fluid

SHELL TELLUS S2 VX 32 (--- LTR)

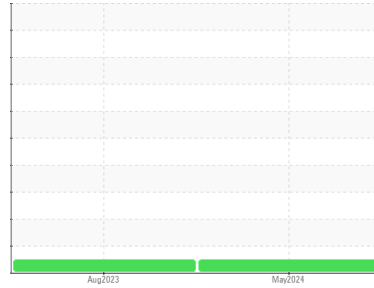

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		NX015020	NX014546	---
Sample Date	Client Info		18 May 2024	11 Aug 2023	---
Machine Age	hrs	Client Info	0	0	---
Oil Age	hrs	Client Info	0	0	---
Oil Changed	Client Info		N/A	N/A	---
Sample Status			NORMAL	NORMAL	---

WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184		14	13	---
Iron	ppm	ASTM D5185m >20	0	0	---
Chromium	ppm	ASTM D5185m >20	0	<1	---
Nickel	ppm	ASTM D5185m >20	<1	0	---
Titanium	ppm	ASTM D5185m	0	0	---
Silver	ppm	ASTM D5185m	0	0	---
Aluminum	ppm	ASTM D5185m >20	<1	2	---
Lead	ppm	ASTM D5185m >20	0	0	---
Copper	ppm	ASTM D5185m >20	3	2	---
Tin	ppm	ASTM D5185m >20	<1	0	---
Vanadium	ppm	ASTM D5185m	0	0	---
Cadmium	ppm	ASTM D5185m	0	0	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	---
Barium	ppm	ASTM D5185m	0	0	---
Molybdenum	ppm	ASTM D5185m	0	0	---
Manganese	ppm	ASTM D5185m	<1	0	---
Magnesium	ppm	ASTM D5185m	10	7	---
Calcium	ppm	ASTM D5185m	30	31	---
Phosphorus	ppm	ASTM D5185m	298	260	---
Zinc	ppm	ASTM D5185m	348	336	---
Sulfur	ppm	ASTM D5185m	1123	885	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	5	0	---
Sodium	ppm	ASTM D5185m	2	0	---
Potassium	ppm	ASTM D5185m >20	2	<1	---
Water	%	ASTM D6304 >0.05	0.003	0.008	---
ppm Water	ppm	ASTM D6304 >500	26	81	---

FLUID CLEANLINESS





	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	1718	6793	---
Particles >6µm	ASTM D7647	>2500	563	1530	---
Particles >14µm	ASTM D7647	>320	33	167	---
Particles >21µm	ASTM D7647	>80	6	26	---
Particles >38µm	ASTM D7647	>20	0	0	---
Particles >71µm	ASTM D7647	>4	0	0	---
Oil Cleanliness	ISO 4406 (c)	>21/18/15	18/16/12	20/18/15	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.33	0.33	---




OIL ANALYSIS REPORT

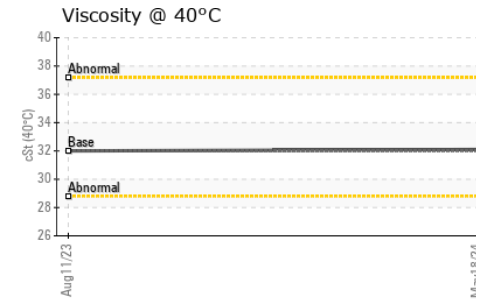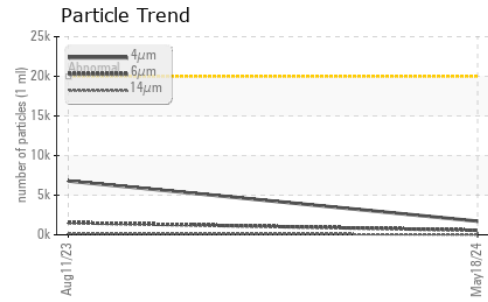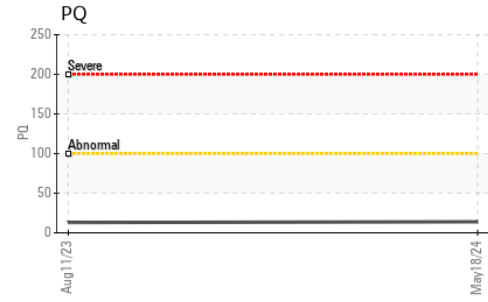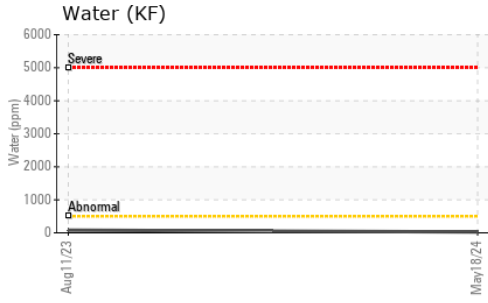






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	32	32.1	32.0	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

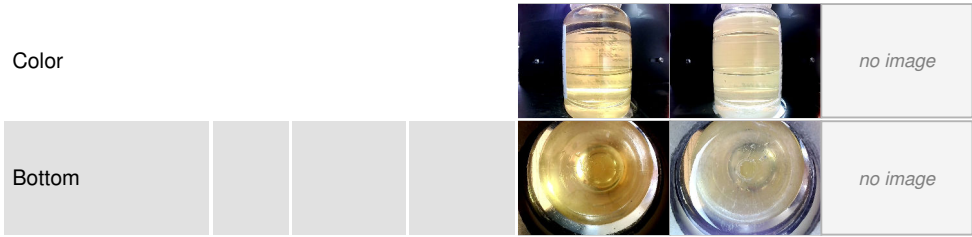

GRAPHS

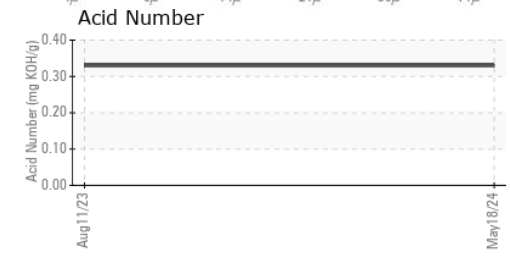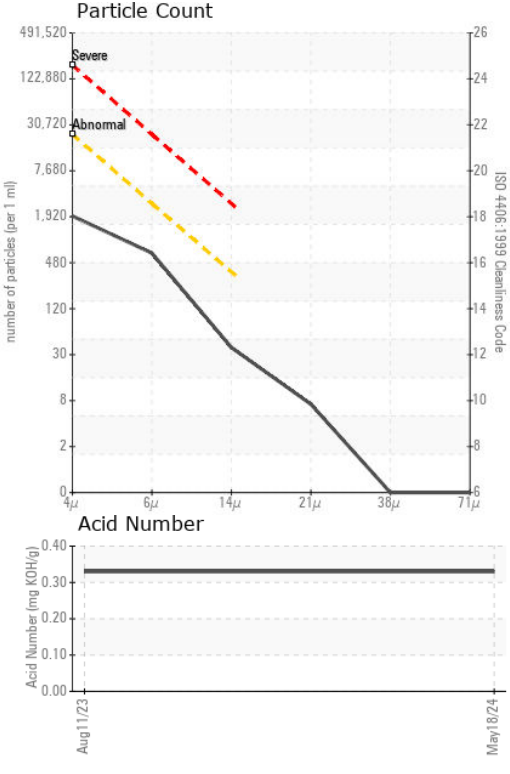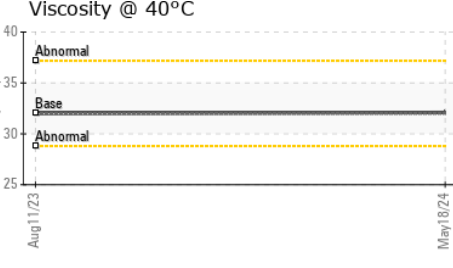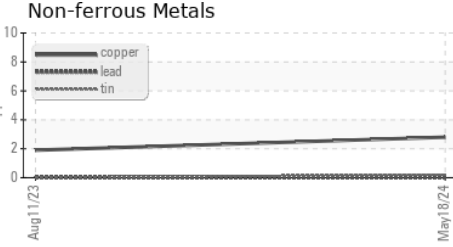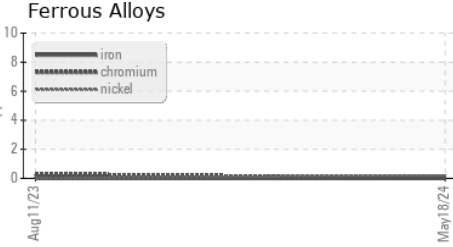

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : NX015020 **Received** : 18 Jun 2024
Lab Number : **06213994** **Tested** : 20 Jun 2024
Unique Number : 11086858 **Diagnosed** : 20 Jun 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PQ)

NORDEX USA - Chicago
 300 SOUTH WACKER DRIVE, SUITE 1500
 CHICAGO, IL
 US 60606

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact: DEVIN LINEHAN
 DLinehan@nordex-online.com
 T: (312)386-4124
 F: (312)386-7102