




# OIL ANALYSIS REPORT

Sample Rating Trend

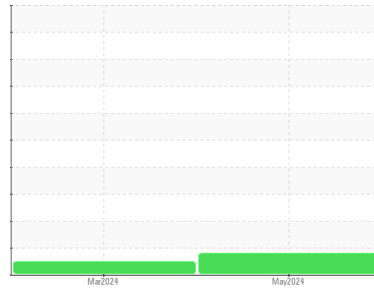

ISO



Area

**EL SAUZ [200007686]**

Machine Id

**P06WEA90080 (S/N EWP-03506)**

Component

**Wind Turbine Gearbox**

Fluid

**FUCHS RENOLIN UNISYN CLP 320 (--- LTR)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

|               | method      | limit/base  | current            | history1    | history2 |
|---------------|-------------|-------------|--------------------|-------------|----------|
| Sample Number | Client Info |             | <b>NX015082</b>    | NX015055    | ---      |
| Sample Date   | Client Info |             | <b>06 May 2024</b> | 08 Mar 2024 | ---      |
| Machine Age   | hrs         | Client Info | <b>0</b>           | 0           | ---      |
| Oil Age       | hrs         | Client Info | <b>0</b>           | 0           | ---      |
| Oil Changed   | Client Info |             | <b>N/A</b>         | N/A         | ---      |
| Sample Status |             |             | <b>ATTENTION</b>   | NORMAL      | ---      |

## WEAR METALS

|          | method     | limit/base  | current   | history1     | history2 |
|----------|------------|-------------|-----------|--------------|----------|
| PQ       | ASTM D8184 | >50         | <b>12</b> | 10           | ---      |
| Iron     | ppm        | ASTM D5185m | >30       | <b>7</b>     | 4        |
| Chromium | ppm        | ASTM D5185m | >3        | <b>0</b>     | 0        |
| Nickel   | ppm        | ASTM D5185m | >3        | <b>&lt;1</b> | 0        |
| Titanium | ppm        | ASTM D5185m | >10       | <b>0</b>     | 0        |
| Silver   | ppm        | ASTM D5185m |           | <b>0</b>     | 0        |
| Aluminum | ppm        | ASTM D5185m | >30       | <b>&lt;1</b> | 0        |
| Lead     | ppm        | ASTM D5185m | >15       | <b>2</b>     | 2        |
| Copper   | ppm        | ASTM D5185m | >10       | <b>1</b>     | 0        |
| Tin      | ppm        | ASTM D5185m | >10       | <b>&lt;1</b> | <1       |
| Vanadium | ppm        | ASTM D5185m |           | <b>0</b>     | 0        |
| Cadmium  | ppm        | ASTM D5185m |           | <b>0</b>     | 0        |

## ADDITIVES

|            | method | limit/base  | current | history1     | history2 |
|------------|--------|-------------|---------|--------------|----------|
| Boron      | ppm    | ASTM D5185m |         | <b>4</b>     | 3        |
| Barium     | ppm    | ASTM D5185m |         | <b>0</b>     | 0        |
| Molybdenum | ppm    | ASTM D5185m |         | <b>0</b>     | 0        |
| Manganese  | ppm    | ASTM D5185m |         | <b>&lt;1</b> | 0        |
| Magnesium  | ppm    | ASTM D5185m |         | <b>1</b>     | 0        |
| Calcium    | ppm    | ASTM D5185m |         | <b>20</b>    | 12       |
| Phosphorus | ppm    | ASTM D5185m |         | <b>238</b>   | 212      |
| Zinc       | ppm    | ASTM D5185m |         | <b>1</b>     | 0        |
| Sulfur     | ppm    | ASTM D5185m |         | <b>6132</b>  | 5879     |

## CONTAMINANTS

|           | method | limit/base  | current | history1     | history2 |
|-----------|--------|-------------|---------|--------------|----------|
| Silicon   | ppm    | ASTM D5185m | >+15    | <b>4</b>     | 3        |
| Sodium    | ppm    | ASTM D5185m |         | <b>3</b>     | 0        |
| Potassium | ppm    | ASTM D5185m | >20     | <b>4</b>     | 0        |
| Water     | %      | ASTM D6304  | >0.02   | <b>0.010</b> | 0.006    |
| ppm Water | ppm    | ASTM D6304  | >200    | <b>106</b>   | 62       |

## FLUID CLEANLINESS






|                 | method       | limit/base | current         | history1 | history2 |
|-----------------|--------------|------------|-----------------|----------|----------|
| Particles >4µm  | ASTM D7647   |            | <b>1807</b>     | 410      | ---      |
| Particles >6µm  | ASTM D7647   | >320       | <b>556</b>      | 109      | ---      |
| Particles >14µm | ASTM D7647   | >40        | <b>32</b>       | 8        | ---      |
| Particles >21µm | ASTM D7647   | >10        | <b>5</b>        | 3        | ---      |
| Particles >38µm | ASTM D7647   | >3         | <b>0</b>        | 0        | ---      |
| Particles >71µm | ASTM D7647   | >3         | <b>0</b>        | 0        | ---      |
| Oil Cleanliness | ISO 4406 (c) | >--/15/12  | <b>18/16/12</b> | 16/14/10 | ---      |

## FLUID DEGRADATION

|                  | method   | limit/base | current | history1    | history2 |
|------------------|----------|------------|---------|-------------|----------|
| Acid Number (AN) | mg KOH/g | ASTM D8045 | 0.6     | <b>0.40</b> | 0.36     |




# OIL ANALYSIS REPORT

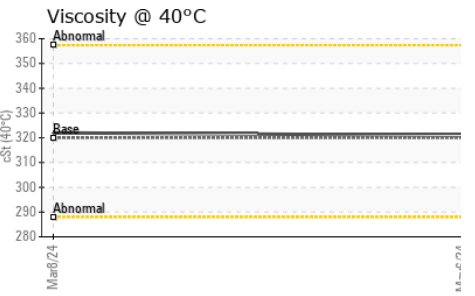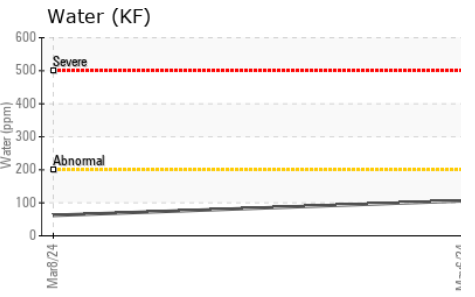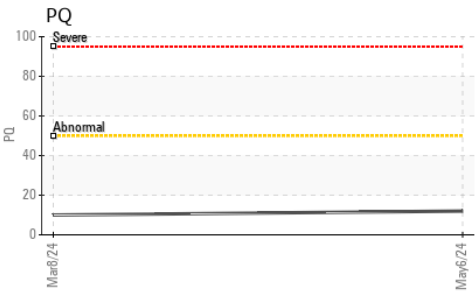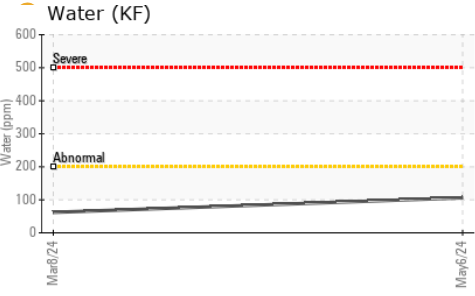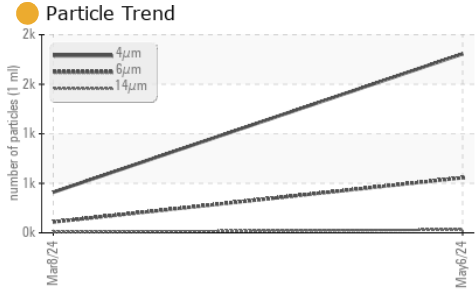






| VISUAL           | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal      | scalar | *Visual    | NONE    | NONE     | ---      |
| Yellow Metal     | scalar | *Visual    | NONE    | NONE     | ---      |
| Precipitate      | scalar | *Visual    | NONE    | NONE     | ---      |
| Silt             | scalar | *Visual    | NONE    | NONE     | ---      |
| Debris           | scalar | *Visual    | NONE    | NONE     | ---      |
| Sand/Dirt        | scalar | *Visual    | NONE    | NONE     | ---      |
| Appearance       | scalar | *Visual    | NORML   | NORML    | ---      |
| Odor             | scalar | *Visual    | NORML   | NORML    | ---      |
| Emulsified Water | scalar | *Visual    | >0.02   | NEG      | ---      |
| Free Water       | scalar | *Visual    |         | NEG      | ---      |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| Visc @ 40°C      | cSt    | ASTM D445  | 320     | 321      | 322      |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

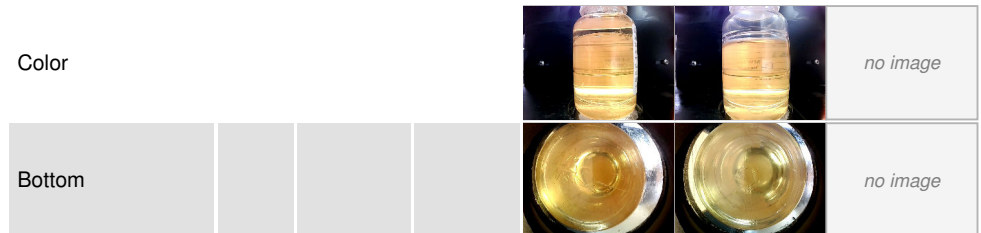

## GRAPHS

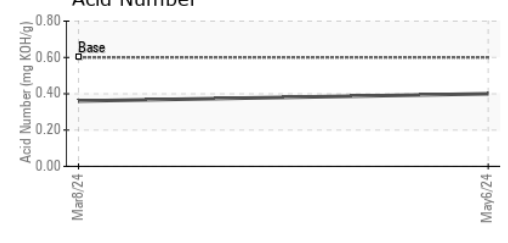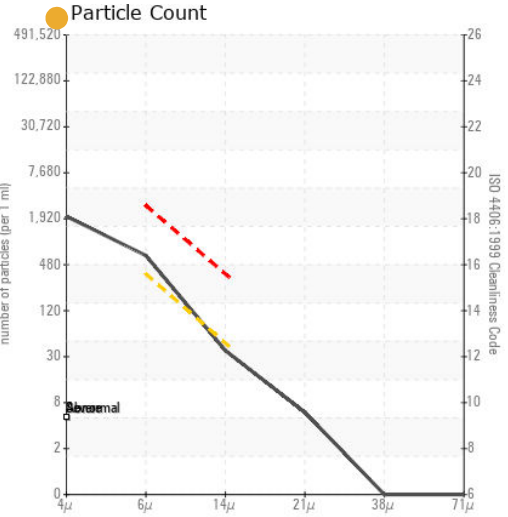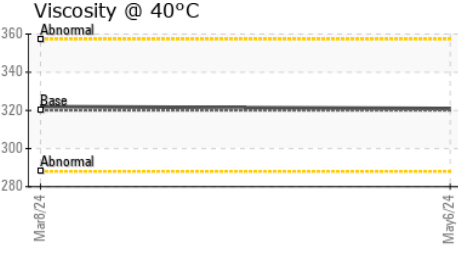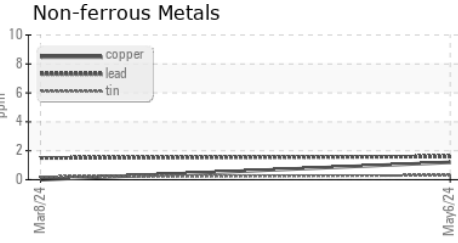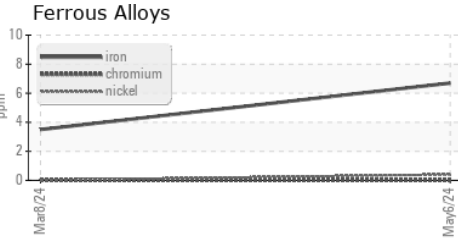

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : NX015082      **Received** : 18 Jun 2024  
**Lab Number** : **06213998**      **Tested** : 20 Jun 2024  
**Unique Number** : 11086862      **Diagnosed** : 20 Jun 2024 - Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PQ, PrtCount )

**NORDEX USA - Chicago**  
 300 SOUTH WACKER DRIVE, SUITE 1500  
 CHICAGO, IL 60606  
 Contact: DEVIN LINEHAN  
 DLinehan@nordex-online.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)