




OIL ANALYSIS REPORT

Sample Rating Trend

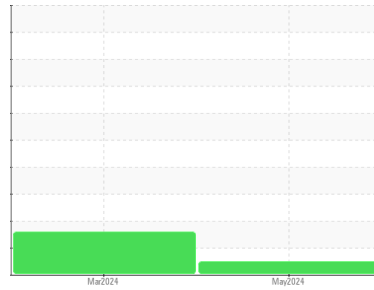

NORMAL



Area

EL SAUZ [200007686]

Machine Id

P10-19WEA90069 (S/N EWP-03446)

Component

Wind Turbine Gearbox

Fluid

FUCHS RENOLIN UNISYN CLP 320 (--- LTR)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			NX015986	NX012713	---
Sample Date	Client Info			06 May 2024	11 Mar 2024	---
Machine Age	hrs	Client Info		0	0	---
Oil Age	hrs	Client Info		0	0	---
Oil Changed	Client Info			N/A	N/A	---
Sample Status				NORMAL	ABNORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184	>50	16	19	---
Iron	ppm	ASTM D5185m	>30	9	6	---
Chromium	ppm	ASTM D5185m	>3	0	0	---
Nickel	ppm	ASTM D5185m	>3	<1	0	---
Titanium	ppm	ASTM D5185m	>10	0	0	---
Silver	ppm	ASTM D5185m		0	0	---
Aluminum	ppm	ASTM D5185m	>30	<1	<1	---
Lead	ppm	ASTM D5185m	>15	1	1	---
Copper	ppm	ASTM D5185m	>10	<1	0	---
Tin	ppm	ASTM D5185m	>10	<1	<1	---
Vanadium	ppm	ASTM D5185m		0	0	---
Cadmium	ppm	ASTM D5185m		0	0	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		4	1	---
Barium	ppm	ASTM D5185m		0	0	---
Molybdenum	ppm	ASTM D5185m		0	0	---
Manganese	ppm	ASTM D5185m		<1	<1	---
Magnesium	ppm	ASTM D5185m		<1	0	---
Calcium	ppm	ASTM D5185m		19	12	---
Phosphorus	ppm	ASTM D5185m		234	205	---
Zinc	ppm	ASTM D5185m		0	0	---
Sulfur	ppm	ASTM D5185m		6049	5932	---





CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>+15	4	3	---
Sodium	ppm	ASTM D5185m		3	0	---
Potassium	ppm	ASTM D5185m	>20	3	0	---
Water	%	ASTM D6304	>0.02	0.009	0.007	---
ppm Water	ppm	ASTM D6304	>200	96	74	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		2113	4168	---
Particles >6µm		ASTM D7647	>320	287	▲ 1481	---
Particles >14µm		ASTM D7647	>40	16	▲ 169	---
Particles >21µm		ASTM D7647	>10	2	▲ 41	---
Particles >38µm		ASTM D7647	>3	0	1	---
Particles >71µm		ASTM D7647	>3	0	0	---
Oil Cleanliness		ISO 4406 (c)	>--/15/12	18/15/11	▲ 19/18/15	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.6	0.39	0.36	---




OIL ANALYSIS REPORT

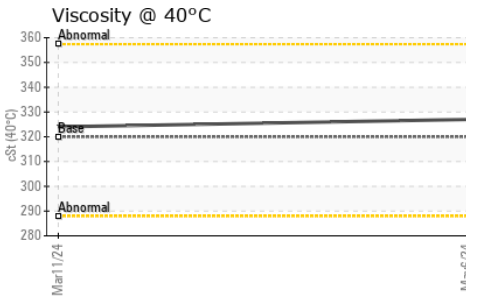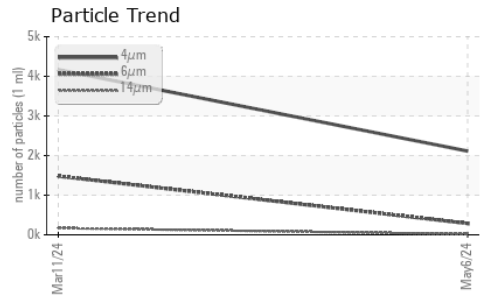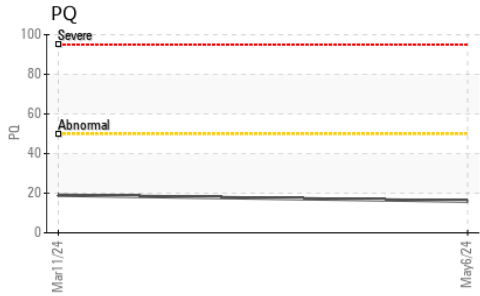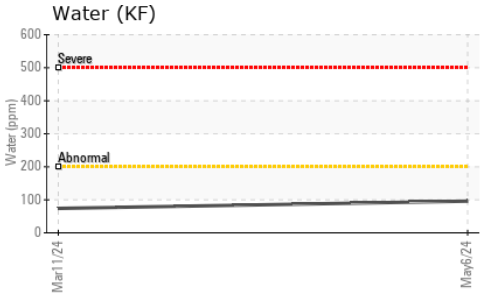






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.02	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	320	327	324

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

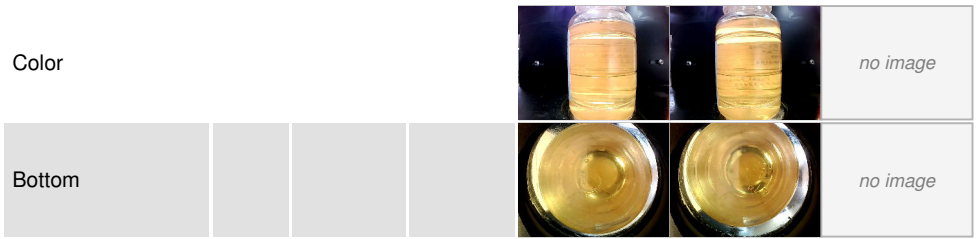

GRAPHS

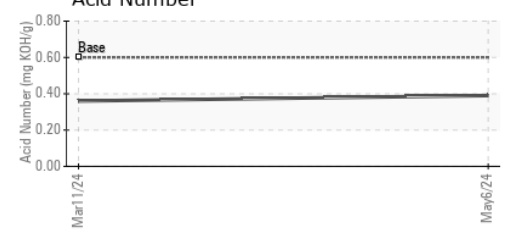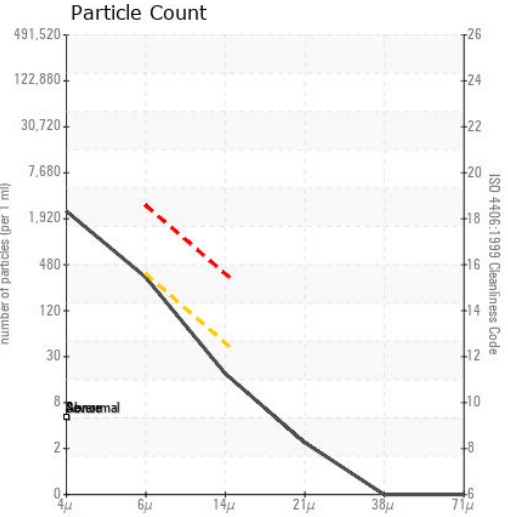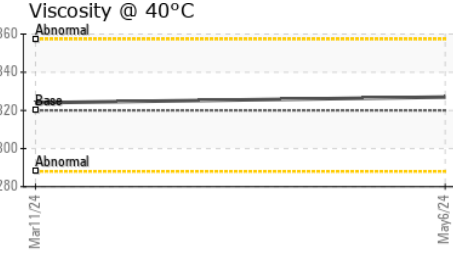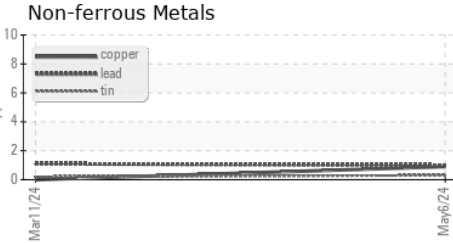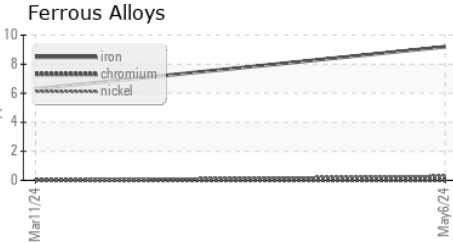

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : NX015986

Lab Number : 06214005

Unique Number : 11086869

Test Package : IND 2 (Additional Tests: KF, PQ, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Received : 18 Jun 2024

Tested : 20 Jun 2024

Diagnosed : 20 Jun 2024 - Don Baldrige

NORDEX USA - Chicago

300 SOUTH WACKER DRIVE, SUITE 1500

CHICAGO, IL

US 60606

Contact: DEVIN LINEHAN

DLinehan@nordex-online.com

T: (312)386-4124

F: (312)386-7102