




# OIL ANALYSIS REPORT

## Sample Rating Trend

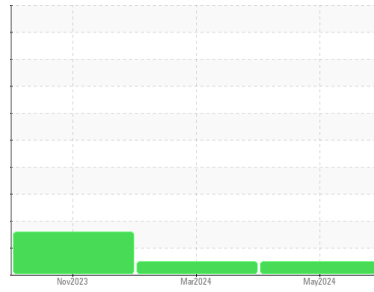

**NORMAL**



Area

**EL SAUZ [200007686]**

Machine Id

**M08-24WEA90086 (S/N 8019633-01)**

Component

**Wind Turbine Gearbox**

Fluid

**FUCHS RENOLIN UNISYN CLP 320 (--- LTR)**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>NX012739</b>	NX015071	NX014595
Sample Date	Client Info			<b>07 May 2024</b>	11 Mar 2024	13 Nov 2023
Machine Age	hrs	Client Info		<b>0</b>	0	0
Oil Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184	>50	<b>14</b>	13	20
Iron	ppm	ASTM D5185m	>30	<b>7</b>	4	10
Chromium	ppm	ASTM D5185m	>3	<b>0</b>	0	<1
Nickel	ppm	ASTM D5185m	>3	<b>&lt;1</b>	0	<1
Titanium	ppm	ASTM D5185m	>10	<b>0</b>	0	<1
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>30	<b>&lt;1</b>	0	2
Lead	ppm	ASTM D5185m	>15	<b>&lt;1</b>	<1	<1
Copper	ppm	ASTM D5185m	>10	<b>1</b>	<1	1
Tin	ppm	ASTM D5185m	>10	<b>&lt;1</b>	<1	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	<1

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>4</b>	2	4
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	<1
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1
Magnesium	ppm	ASTM D5185m		<b>1</b>	0	<1
Calcium	ppm	ASTM D5185m		<b>16</b>	8	21
Phosphorus	ppm	ASTM D5185m		<b>242</b>	206	215
Zinc	ppm	ASTM D5185m		<b>8</b>	0	0
Sulfur	ppm	ASTM D5185m		<b>6175</b>	5949	5419






CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>+15	<b>3</b>	2	4
Sodium	ppm	ASTM D5185m		<b>3</b>	0	2
Potassium	ppm	ASTM D5185m	>20	<b>3</b>	0	<1
Water	%	ASTM D6304	>0.02	<b>0.006</b>	0.005	0.008
ppm Water	ppm	ASTM D6304	>200	<b>69</b>	57	89

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>6750</b>	4791	34221
Particles >6µm		ASTM D7647	>320	<b>128</b>	102	▲ 1107
Particles >14µm		ASTM D7647	>40	<b>3</b>	8	▲ 69
Particles >21µm		ASTM D7647	>10	<b>1</b>	3	▲ 22
Particles >38µm		ASTM D7647	>3	<b>0</b>	1	1
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/15/12	<b>20/14/9</b>	19/14/10	▲ 22/17/13

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.6	<b>0.34</b>	0.33	0.34




# OIL ANALYSIS REPORT

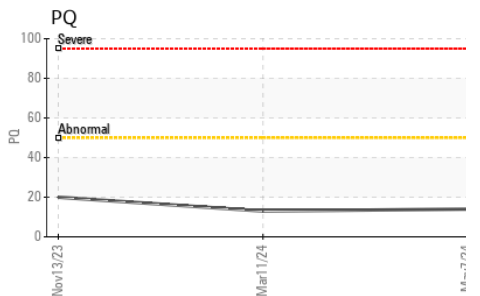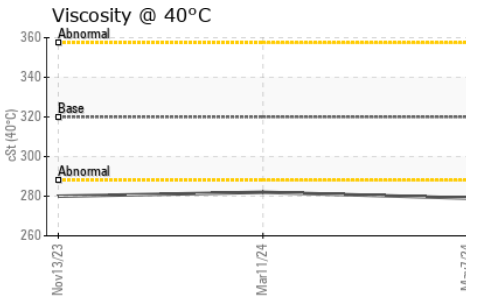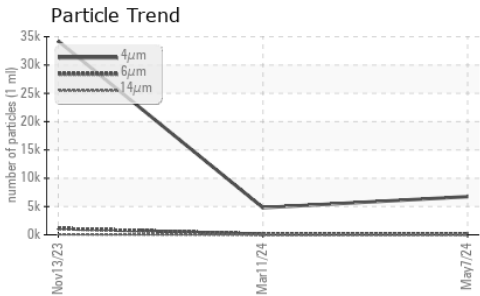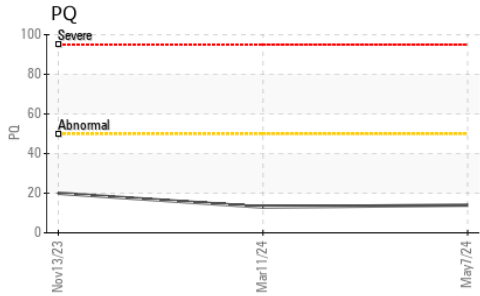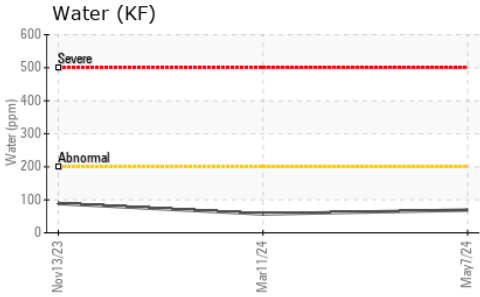





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.02	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 320	279	282	280

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

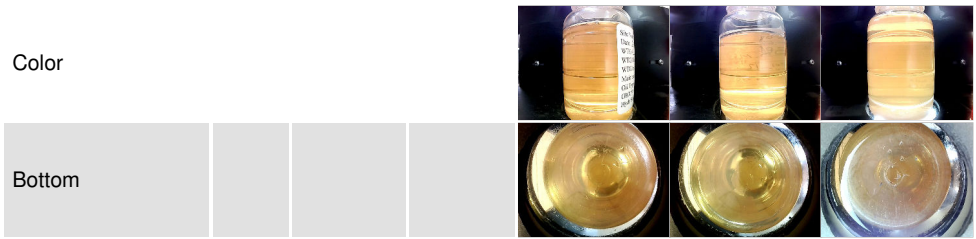

## GRAPHS

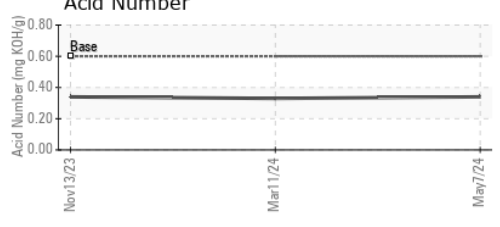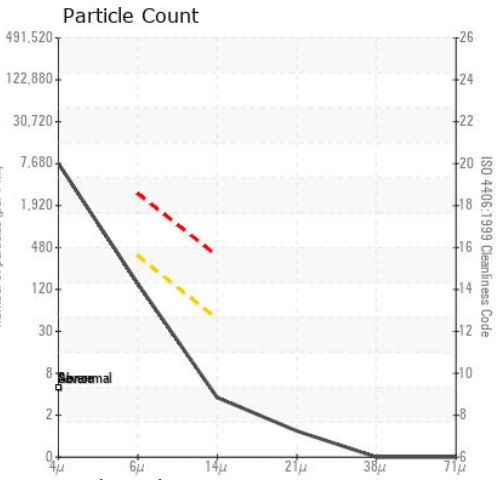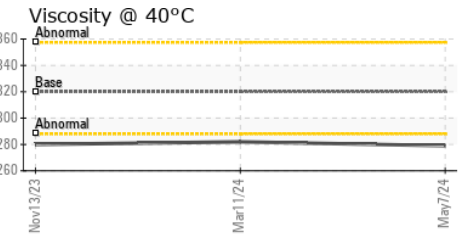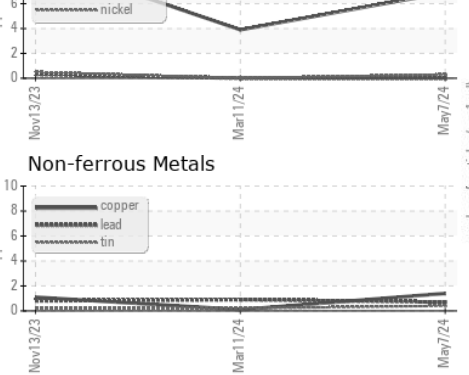

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : NX012739  
**Lab Number** : 06214008  
**Unique Number** : 11086872  
**Test Package** : IND 2 ( Additional Tests: KF, PQ, PrtCount )

**NORDEX USA - Chicago**  
 300 SOUTH WACKER DRIVE, SUITE 1500  
 CHICAGO, IL  
 US 60606  
 Contact: DEVIN LINEHAN  
 DLinehan@nordex-online.com

Received : 18 Jun 2024  
 Tested : 20 Jun 2024  
 Diagnosed : 20 Jun 2024 - Don Baldrige  
 T: (312)386-4124  
 F: (312)386-7102