

### **OIL ANALYSIS REPORT**

Sample Rating Trend

# ISO

Machine Id

# BUSCH PR5-501 P1 (S/N 200002792)

Component Pump Fluid

**USPI VAC 100 (--- GAL)** 

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USPM37805		
Sample Date		Client Info		01 Jun 2024		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ATTENTION		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>90	<1		
Chromium	ppm	ASTM D5185m	>5	0		
Nickel	ppm	ASTM D5185m	>5	<1		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>3	0		
Aluminum	ppm	ASTM D5185m	>7	1		
Lead	ppm	ASTM D5185m	>12	0		
Copper	ppm	ASTM D5185m	>30	<1		
Tin	ppm	ASTM D5185m	>9	1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	0	0		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	0	<1		
Calcium	ppm	ASTM D5185m	0	0		
Phosphorus	ppm	ASTM D5185m	1800	1161		
Zinc	ppm	ASTM D5185m	0	0		
Sulfur	ppm	ASTM D5185m	0	13		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>60	2		
Sodium	ppm	ASTM D5185m		1		
Potassium	ppm	ASTM D5185m	>20	3		
Water	%	ASTM D6304	>.1	0.088		
ppm Water	ppm	ASTM D6304	>1000	886		
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	<b>5582</b>		
Particles >6µm		ASTM D7647	>1300	<mark> </mark> 1761		
Particles >14µm		ASTM D7647	>160	85		
Particles >21µm		ASTM D7647	>40	14		
Particles >38µm		ASTM D7647	>10	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>19/17/14	<b>e</b> 20/18/14		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.05	0.139		



220

200

180


(<del>)</del> 160 ද ද (40


120

100 Base Abnorma

81

## **OIL ANALYSIS REPORT**

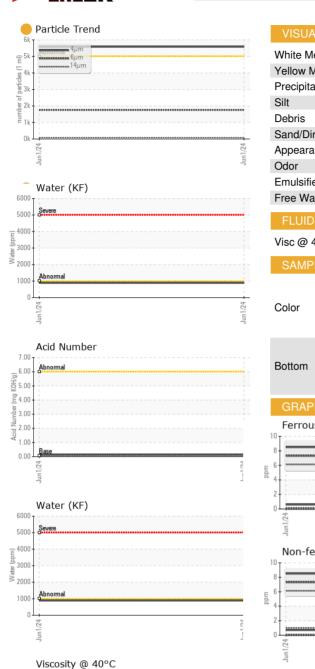

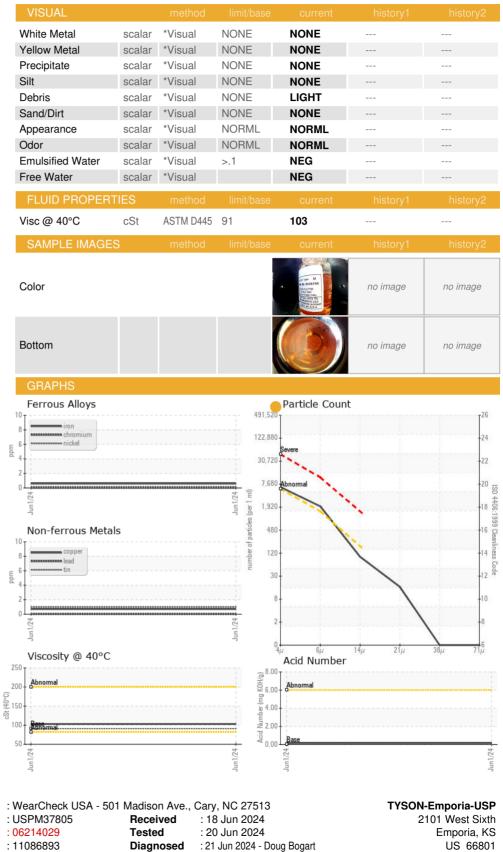

Unique Number : 11086893 Test Package : IND 2

Laboratory

Sample No.

Lab Number

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (620)343-3640 F: (620)340-1253

Contact: SERVICE MANAGER

Certificate 12367

Contact/Location: SERVICE MANAGER - IBPEMP01