


# **OIL ANALYSIS REPORT**

# Area CO GEN **BRAVO GAS COMPRESSOR**

Component Compressor

{not provided} (--- GAL)





## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

## **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM						
GANNI EE IN GIN	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0893666	WC0892862	WC0828835
Sample Date		Client Info		17 Jun 2024	08 Feb 2024	15 Oct 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL
CONTAMINATION	1	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG	NEG	NEG
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	16
Chromium	ppm	ASTM D5185m	>10	0	0	6
Nickel	ppm	ASTM D5185m		0	0	<1
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>25	<1	0	14
Lead	ppm	ASTM D5185m	>25	0	0	0
Copper	ppm	ASTM D5185m	>50	2	2	6
Tin	ppm	ASTM D5185m	>15	<1	0	<1
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	49
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	48
Manganese	ppm	ASTM D5185m		<1	0	<1
Magnesium	ppm	ASTM D5185m		<1	0	548
Calcium	ppm	ASTM D5185m		274	260	1649
Phosphorus	ppm	ASTM D5185m		1122	981	717
Zinc	ppm	ASTM D5185m		1238	1161	995
Sulfur	ppm	ASTM D5185m		3448	2916	2866
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1	<1	9
Sodium	ppm	ASTM D5185m		1	<1	6
Potassium	ppm	ASTM D5185m	>20	2	0	31
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	137	404	420
Particles >6µm		ASTM D7647	>2500	41	75	113
Particles >14µm		ASTM D7647	>320	5	9	6
Particles >21µm		ASTM D7647	>80	3	3	2
Particles >38µm		ASTM D7647	>20	1	0	0
		AOTAL DZO4Z	A	4	0	0
Particles >71µm		ASTM D7647	>4	1		U
		ISO 4406 (c)	>20/18/15	14/13/10	16/13/10	16/14/10

Acid Number (AN)

mg KOH/g ASTM D8045


1.18


Report Id: TROBRA [WUSCAR] 06214095 (Generated: 06/24/2024 17:17:10) Rev: 1


Contact/Location: STEVE RIEDEL - TROBRA




# **OIL ANALYSIS REPORT**










VISUAL		method				history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
<b>Emulsified Water</b>	scalar	*Visual	>0.1	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FILLID DDODED						


FLUID PROPER	HES	method		history1	history2
Visc @ 40°C	cSt	ASTM D445	150	151	149

SAMPLE IMAGES	method	limit/base	current	history1	history2

Color





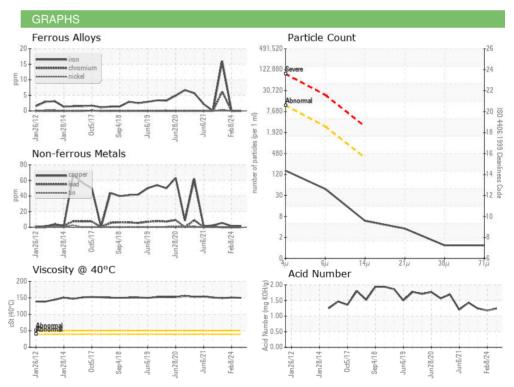





Certificate 12367

Laboratory Sample No.

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : WC0893666 Lab Number : 06214095 Unique Number : 11086959

Received : 18 Jun 2024 **Tested** 

: 24 Jun 2024 Diagnosed : 24 Jun 2024 - Jonathan Hester

Test Package : IND 2 ( Additional Tests: PRTCOUNT ) To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact: STEVE RIEDEL steven.riedel@tropicana.com T: (941)742-2992

F: (941)749-3980 Contact/Location: STEVE RIEDEL - TROBRA

TROPICANA PRODUCTS INC

1001 13TH AVE EAST

BRADENTON, FL

US 34208