




OIL ANALYSIS REPORT

Sample Rating Trend

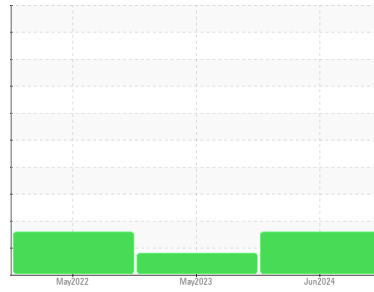

Machine Id
KAESER ASD 30T 8217097 (S/N 1126)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation
 No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear
 All component wear rates are normal.

Contamination
 There is a high amount of particulates present in the oil.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KC128591	KC101346	KC96204
Sample Date	Client Info			11 Jun 2024	23 May 2023	25 May 2022
Machine Age	hrs	Client Info		7714	4545	1425
Oil Age	hrs	Client Info		3200	3100	1425
Oil Changed	Client Info			Changed	Changed	Changed
Sample Status				ABNORMAL	ATTENTION	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	1
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	2	0	<1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	8	8	2
Tin	ppm	ASTM D5185m	>10	0	<1	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	<1
Barium	ppm	ASTM D5185m	90	1	0	7
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	<1	<1
Magnesium	ppm	ASTM D5185m	90	26	18	50
Calcium	ppm	ASTM D5185m	2	0	0	1
Phosphorus	ppm	ASTM D5185m		0	<1	4
Zinc	ppm	ASTM D5185m		37	38	13

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	4	<1	1
Sodium	ppm	ASTM D5185m		14	4	13
Potassium	ppm	ASTM D5185m	>20	8	4	4
Water	%	ASTM D6304	>0.05	0.019	0.011	0.020
ppm Water	ppm	ASTM D6304	>500	197	119.8	200.5

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		4045	4644	31947
Particles >6µm		ASTM D7647	>1300	▲ 1929	● 1562	▲ 8969
Particles >14µm		ASTM D7647	>80	▲ 229	62	▲ 514
Particles >21µm		ASTM D7647	>20	▲ 53	17	▲ 110
Particles >38µm		ASTM D7647	>4	2	1	2
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 19/18/15	● 19/18/13	▲ 22/20/16

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.35	0.36	0.47


OIL ANALYSIS REPORT

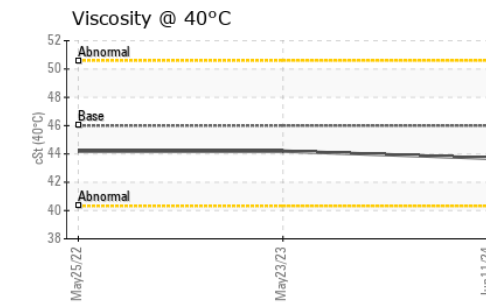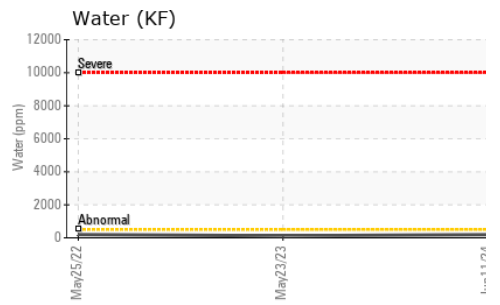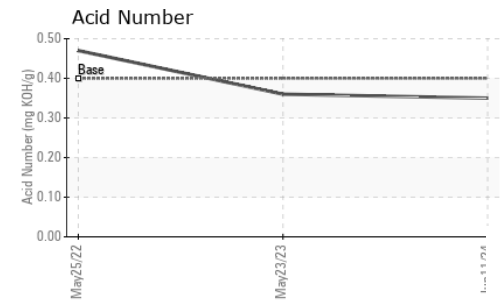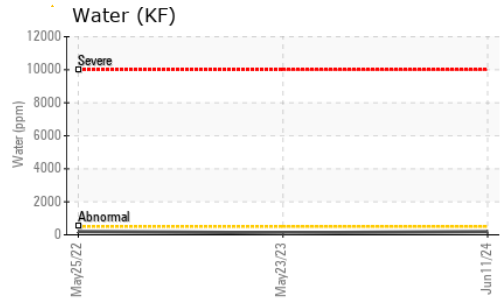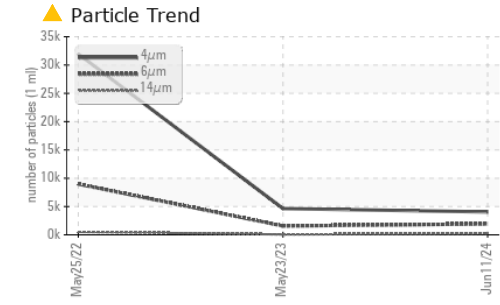





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	VLITE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	43.7	44.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

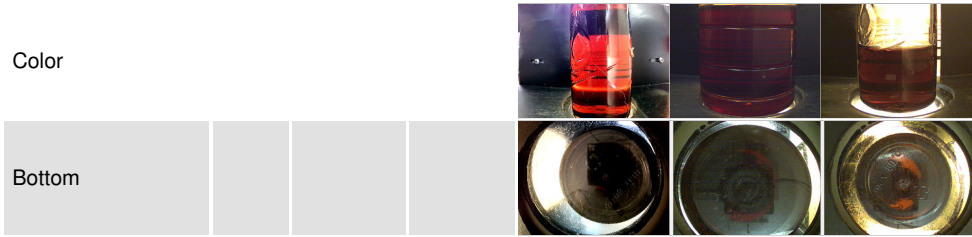

GRAPHS

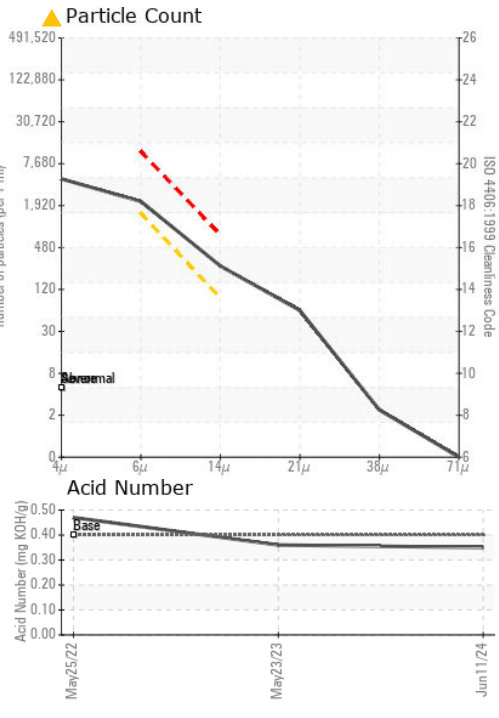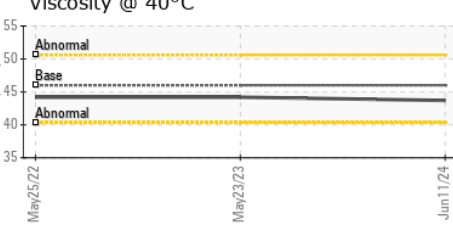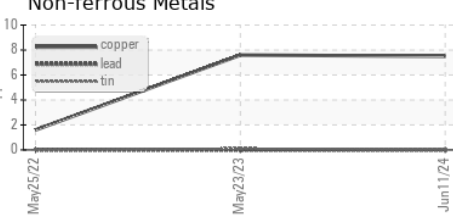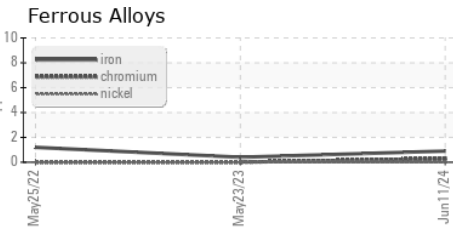

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC128591
Lab Number : 06214667
Unique Number : 11087531
Test Package : IND 2

Received : 19 Jun 2024
Tested : 20 Jun 2024
Diagnosed : 21 Jun 2024 - Don Baldrige

SOUTHWOOD LUMBER
 8849 E LINCOLN WAY
 ORRVILLE, OH
 US 44667
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)