




# OIL ANALYSIS REPORT

Sample Rating Trend

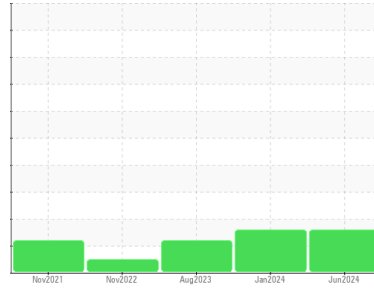

ISO



Machine Id

**KAESER 7477721**

Component

**Compressor**

Fluid

**KAESER SIGMA (OEM) S-460 (--- QTS)**

## DIAGNOSIS

### Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KC129190</b>	KC126518	KC121437
Sample Date	Client Info		<b>13 Jun 2024</b>	16 Jan 2024	23 Aug 2023
Machine Age	hrs	Client Info	<b>14759</b>	12728	10655
Oil Age	hrs	Client Info	<b>2000</b>	0	0
Oil Changed	Client Info		<b>Not Chngd</b>	N/A	N/A
Sample Status			<b>ABNORMAL</b>	ATTENTION	ABNORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>&lt;1</b>	0	0
Chromium	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>2</b>	0	<1
Lead	ppm	ASTM D5185m >10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >50	<b>13</b>	6	9
Tin	ppm	ASTM D5185m >10	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 90	<b>0</b>	13	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185m 90	<b>&lt;1</b>	27	0
Calcium	ppm	ASTM D5185m 2	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	<b>0</b>	0	<1
Zinc	ppm	ASTM D5185m	<b>0</b>	0	0

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>2</b>	1	<1
Sodium	ppm	ASTM D5185m	<b>0</b>	20	0
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	9	0
Water	%	ASTM D6304 >0.05	<b>0.008</b>	0.009	0.006
ppm Water	ppm	ASTM D6304 >500	<b>80</b>	91	65.4






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>9930</b>	4297	26162
Particles >6µm	ASTM D7647	>1300	<b>▲ 3548</b>	● 1600	▲ 12987
Particles >14µm	ASTM D7647	>80	<b>▲ 279</b>	● 128	▲ 217
Particles >21µm	ASTM D7647	>20	<b>▲ 63</b>	● 29	10
Particles >38µm	ASTM D7647	>4	<b>2</b>	1	1
Particles >71µm	ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	<b>▲ 20/19/15</b>	● 19/18/14	▲ 22/21/15

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	<b>0.42</b>	0.34	0.35

# OIL ANALYSIS REPORT

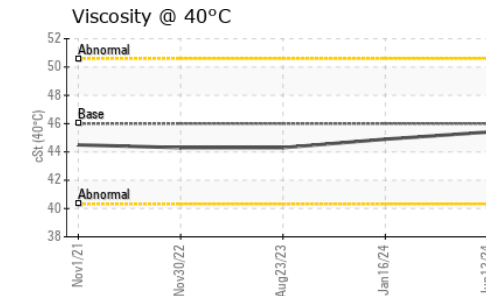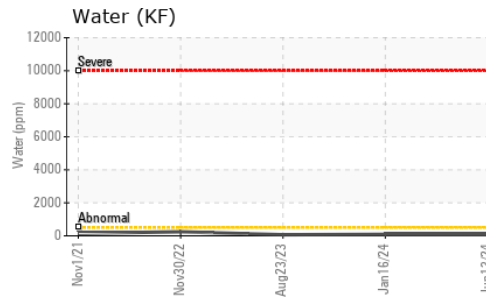
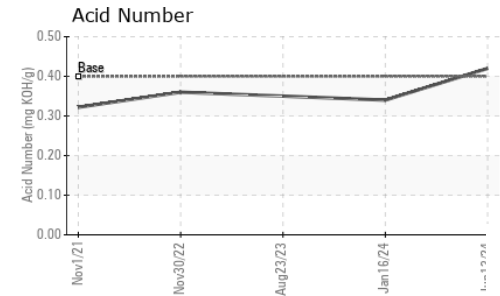
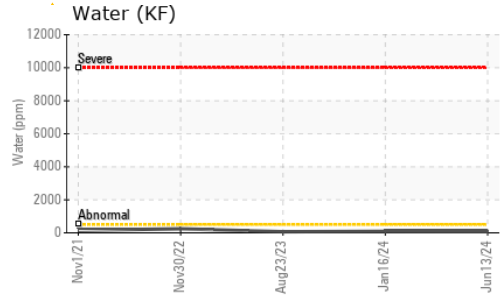
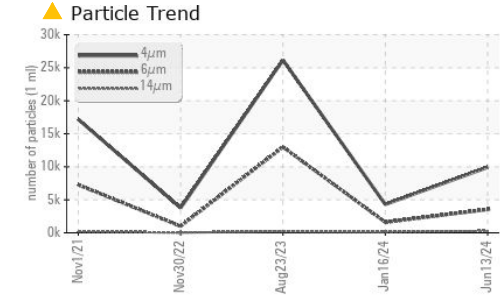


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	45.4	44.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

## GRAPHS

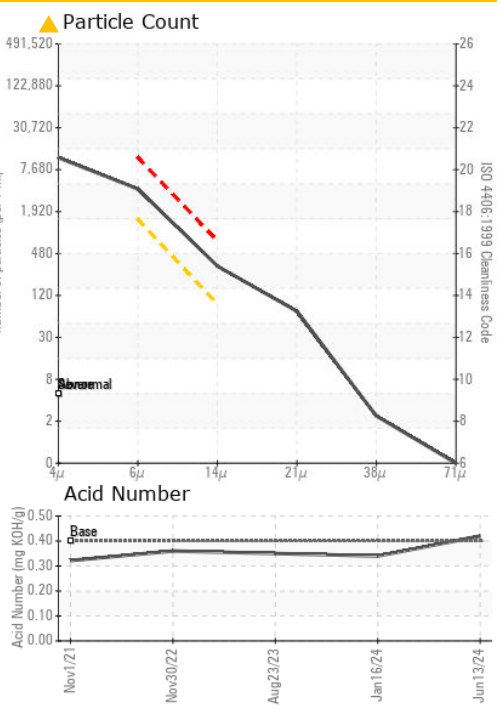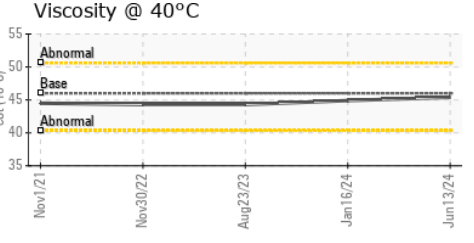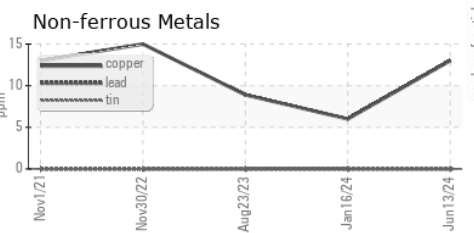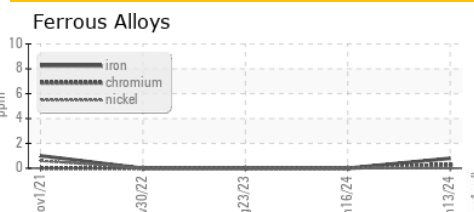

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC129190  
**Lab Number** : 06214671  
**Unique Number** : 11087535  
**Test Package** : IND 2  
**Received** : 19 Jun 2024  
**Tested** : 20 Jun 2024  
**Diagnosed** : 21 Jun 2024 - Don Baldrige

**CORR CHOICE**  
 777 THIRD ST  
 MASSILLON, OH  
 US 44647  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)