

### **OIL ANALYSIS REPORT**

Sample Rating Trend



Machine Id

# KAESER 9104198 (S/N 1045)

Component Compressor Fluid

KAESER SIGMA (OEM) M-460 (--- GAL)

#### DIAGNOSIS

#### Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is a high amount of particulates present in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	<b>MATION</b>	method	limit/base	current	history1	history2
Sample Number		Client Info		KC129862		
Sample Date		Client Info		14 Jun 2024		
Machine Age	hrs	Client Info		4620		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		Not Changd		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	2		
Chromium	ppm	ASTM D5185m		<1		
Nickel		ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m	>2	0		
	ppm					
Aluminum	ppm	ASTM D5185m		8		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m		2		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	100	1		
Calcium	ppm	ASTM D5185m	0	0		
Phosphorus	ppm	ASTM D5185m	0	42		
Zinc	ppm	ASTM D5185m	0	6		
CONTAMINANTS	6	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	2		
Sodium	ppm	ASTM D5185m		0		
Potassium	ppm	ASTM D5185m	>20	2		
Water	%	ASTM D6304	>0.05	0.003		
ppm Water	ppm	ASTM D6304	>500	31		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		32446		
Particles >6µm		ASTM D7647	>1300	<u> </u>		
Particles >14µm		ASTM D7647	>80	<u> </u>		
Particles >21µm		ASTM D7647	>20	<u> </u>		
Particles >38µm		ASTM D7647	>4	2		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<b>A</b> 22/21/16		
FLUID DEGRADA		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.10		




(maa)

Water

Water (

Built for a lifetime

## **OIL ANALYSIS REPORT**

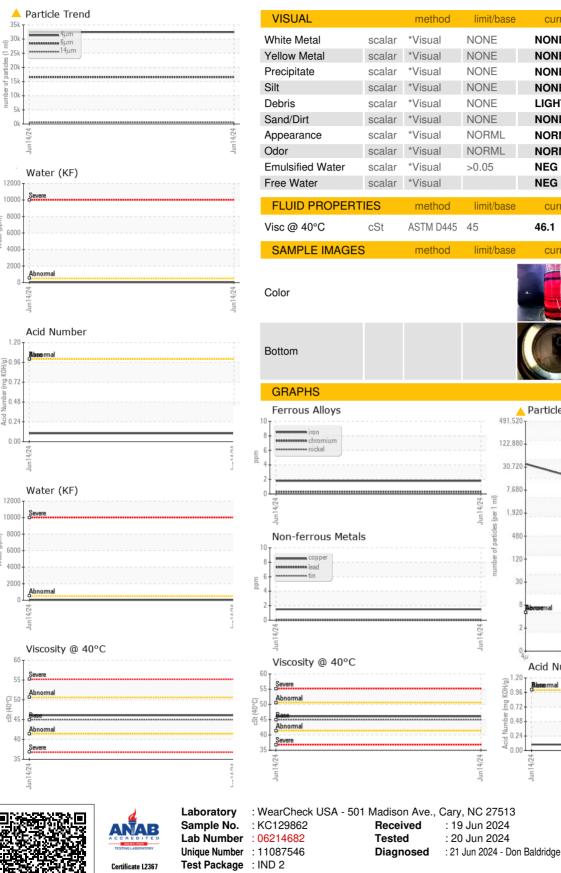

To discuss this sample report, contact Customer Service at 1-800-237-1369.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F:


EUCLID, OH

Contact: Service Manager

US 44132

Contact/Location: Service Manager - AMAEUC Page 2 of 2

28

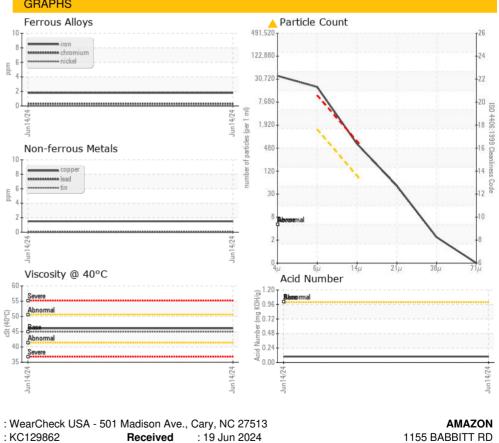

limit/base

limit/base

limit/base

current

NONE

NONE

NONE

NONE

LIGHT

NONE

NORML

NORML

current

current

NEG

NEG

46.1

history1

history

history1

no image

no image

history2

history

history2

no image

no imade

<sup>\* -</sup> Denotes test methods that are outside of the ISO 17025 scope of accreditation.