OIL ANALYSIS REPORT

Sample Rating Trend

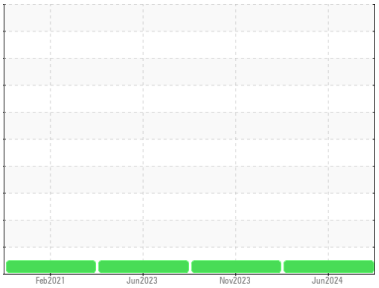

NORMAL

Area
S-460 [9696]
Machine Id
KAESER 7600876 - IMTT
Component
Compressor

DIAGNOSIS

Recommendation
Resample at the next service interval to monitor.

Wear
All component wear rates are normal.

Contamination
There is no indication of any contamination in the oil.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**UDI0000319**	UCH06025271	UCH05885713
Sample Date		Client Info		**04 Jun 2024**	27 Nov 2023	09 Jun 2023
Machine Age	hrs	Client Info		**99999**	97678	95611
Oil Age	hrs	Client Info		**3000**	2067	3933
Oil Changed		Client Info		**Changed**	Changed	Changed
Sample Status				**NORMAL**	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water		WC Method	>0.05	**NEG**	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	**0**	0	6
Chromium	ppm	ASTM D5185m	>10	**0**	0	2
Nickel	ppm	ASTM D5185m	>3	**0**	<1	2
Titanium	ppm	ASTM D5185m	>3	**0**	0	2
Silver	ppm	ASTM D5185m	>2	**0**	0	1
Aluminum	ppm	ASTM D5185m	>10	**<1**	1	7
Lead	ppm	ASTM D5185m	>10	**0**	0	5
Copper	ppm	ASTM D5185m	>50	**<1**	2	2
Tin	ppm	ASTM D5185m	>10	**0**	10	2
Antimony	ppm	ASTM D5185m		**---**	---	---
Vanadium	ppm	ASTM D5185m		**0**	0	1
Cadmium	ppm	ASTM D5185m		**0**	0	2

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		**0**	0	0
Barium	ppm	ASTM D5185m	90	**4**	0	8
Molybdenum	ppm	ASTM D5185m		**0**	0	2
Manganese	ppm	ASTM D5185m		**<1**	<1	2
Magnesium	ppm	ASTM D5185m	90	**18**	0	9
Calcium	ppm	ASTM D5185m	2	**0**	0	1
Phosphorus	ppm	ASTM D5185m		**28**	249	294
Zinc	ppm	ASTM D5185m		**9**	53	107
Sulfur	ppm	ASTM D5185m		**20109**	903	361

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	**0**	0	2
Sodium	ppm	ASTM D5185m		**6**	2	3
Potassium	ppm	ASTM D5185m	>20	**2**	0	7

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	**0.36**	0.34	0.34

OIL ANALYSIS REPORT

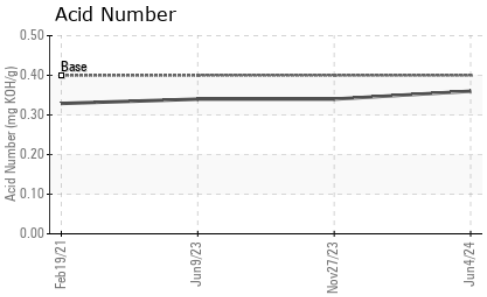

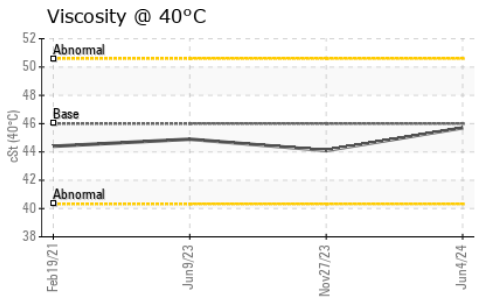

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	NONE
Silt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Debris	scalar	*Visual	NONE	**NONE**	NONE	MODER
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Appearance	scalar	*Visual	NORML	**NORML**	NORML	NORML
Odor	scalar	*Visual	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	**NEG**	NEG	NEG
Free Water	scalar	*Visual		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	**45.7**	44.1	44.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

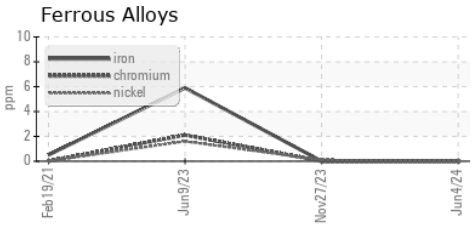

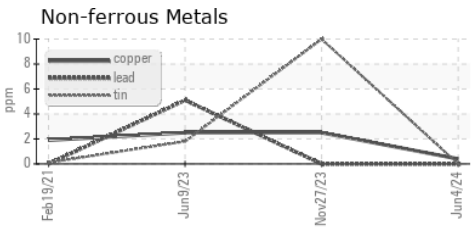

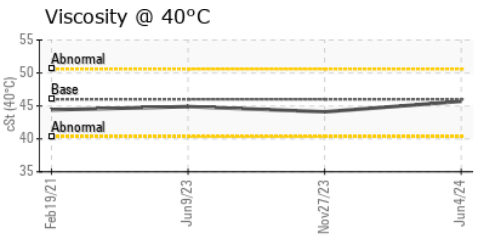

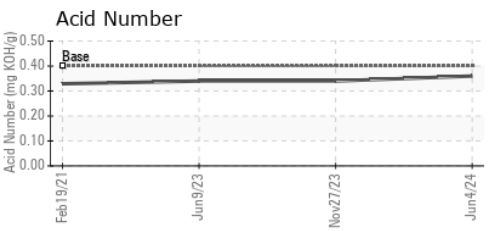

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : UDI0000319
Lab Number : 06214769
Unique Number : 11087633
Test Package : IND 2

Received : 19 Jun 2024
Tested : 20 Jun 2024
Diagnosed : 20 Jun 2024 - Wes Davis

DELTA INDUSTRIES - DOWNERS GROVE
2201 CURTISS STREET
DOWNERS GROVE, IL
US 60515
Contact: MICHAEL FERRIS

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: (630)960-3931