

Area


PALLUBE 32

Machine Id

SULLIVAN PALATEK 23GE004271 - SCHNEIDER

Component

Compressor

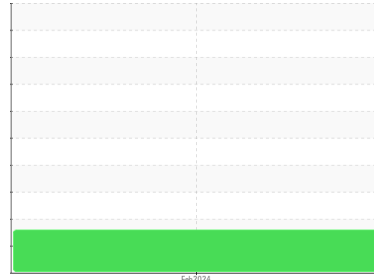

DIAGNOSIS

● **Recommendation**

We advise that you follow the water drain-off procedure for this component. We recommend an early resample to monitor this condition.

Wear

All component wear rates are normal.

● **Contamination**

There is a high concentration of water present in the oil.

Fluid Condition

The AN level is acceptable for this fluid.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			UCS06214824	---	---
Sample Date	Client Info			01 Feb 2024	---	---
Machine Age	hrs	Client Info		434	---	---
Oil Age	hrs	Client Info		434	---	---
Oil Changed	Client Info			Not Chngd	---	---
Sample Status				ATTENTION	---	---




WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	---	---
Chromium	ppm	ASTM D5185m	>10	0	---	---
Nickel	ppm	ASTM D5185m		0	---	---
Titanium	ppm	ASTM D5185m		0	---	---
Silver	ppm	ASTM D5185m		0	---	---
Aluminum	ppm	ASTM D5185m	>25	<1	---	---
Lead	ppm	ASTM D5185m	>25	0	---	---
Copper	ppm	ASTM D5185m	>50	0	---	---
Tin	ppm	ASTM D5185m	>15	1	---	---
Vanadium	ppm	ASTM D5185m		0	---	---
Cadmium	ppm	ASTM D5185m		0	---	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	1	<1	---	---
Barium	ppm	ASTM D5185m	730	159	---	---
Molybdenum	ppm	ASTM D5185m	0	0	---	---
Manganese	ppm	ASTM D5185m	0.0	<1	---	---
Magnesium	ppm	ASTM D5185m	0	<1	---	---
Calcium	ppm	ASTM D5185m	0	2	---	---
Phosphorus	ppm	ASTM D5185m	0	11	---	---
Zinc	ppm	ASTM D5185m	0	0	---	---
Sulfur	ppm	ASTM D5185m	590	845	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1	---	---
Sodium	ppm	ASTM D5185m		42	---	---
Potassium	ppm	ASTM D5185m	>20	5	---	---
Water	%	ASTM D6304	>0.1	● 1.09	---	---
ppm Water	ppm	ASTM D6304	>1000	● 10900	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.14	0.137	---	---

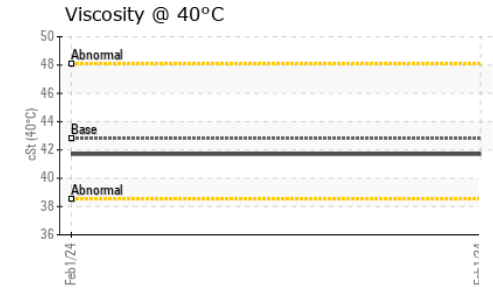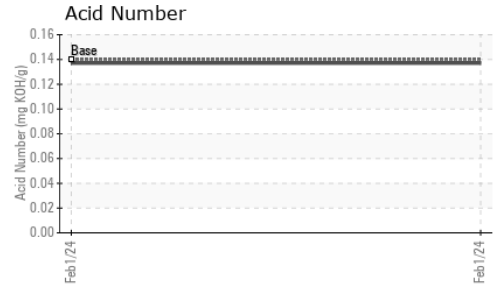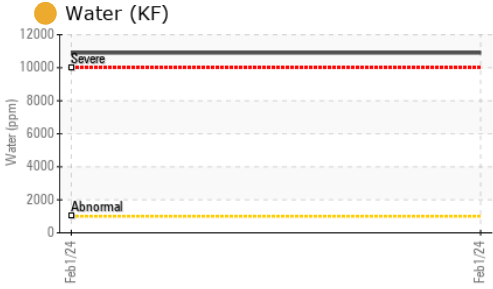

OIL ANALYSIS REPORT







VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.1	0.2%	---	---
Free Water	scalar	*Visual		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	42.8	41.7	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

GRAPHS

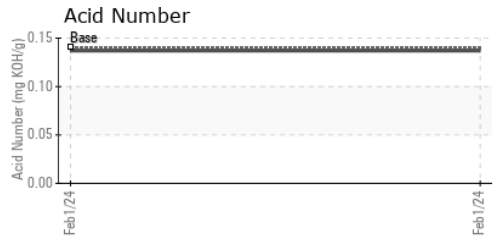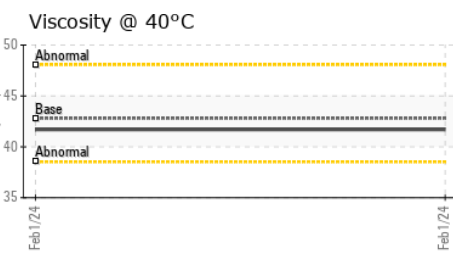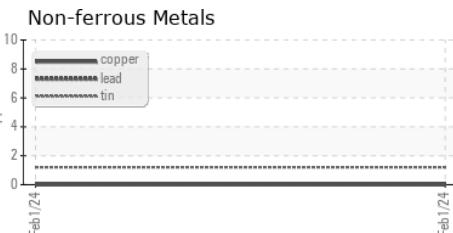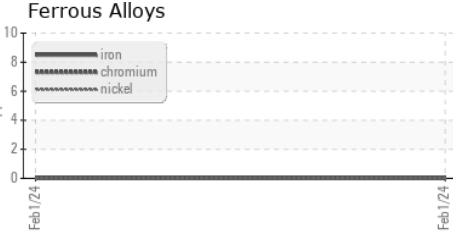

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : UCS06214824
Lab Number : 06214824
Unique Number : 11087688
Test Package : IND 2 (Additional Tests: KF)

ELITE COMPRESSED AIR SYSTEMS INC
 MCDONOUGH, GA
 US 30252

To discuss this sample report, contact Customer Service at 1-800-237-1369.

Contact: RONNY MINNIX
 elitecompressed@gmail.com
 T: (770)898-9594

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: