


OIL ANALYSIS REPORT

ACI-46 **BOGE 5083597 - ARMES PRECISION** Component Compressor

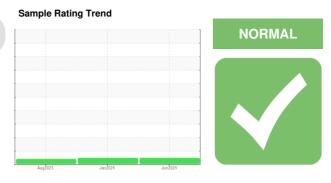

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


| SAMPLE INFORM | MATION | method | limit/base | current | history1 | history2 |
|------------------|----------|-------------|------------|-------------|-------------|-------------|
| Sample Number | | Client Info | | UAC06214836 | UAC06071796 | UAC05942350 |
| Sample Date | | Client Info | | 13 Jun 2024 | 24 Jan 2024 | 24 Aug 2023 |
| Machine Age | hrs | Client Info | | 47653 | 44275 | 40717 |
| Oil Age | hrs | Client Info | | 8000 | 7920 | 0 |
| Oil Changed | | Client Info | | Changed | Not Changd | Not Changd |
| Sample Status | | | | NORMAL | NORMAL | ATTENTION |
| CONTAMINATIO | N | method | limit/base | current | history1 | history2 |
| Water | | WC Method | >0.1 | NEG | NEG | NEG |
| WEAR METALS | | method | limit/base | current | history1 | history2 |
| Iron | ppm | ASTM D5185m | >50 | 0 | 0 | <1 |
| Chromium | ppm | ASTM D5185m | >10 | 0 | 0 | 0 |
| Nickel | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Titanium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Silver | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Aluminum | ppm | ASTM D5185m | >25 | 0 | 0 | 0 |
| Lead | ppm | ASTM D5185m | >25 | 0 | 0 | 0 |
| Copper | ppm | ASTM D5185m | >50 | <1 | <1 | 2 |
| Tin | ppm | ASTM D5185m | >15 | <1 | 0 | 0 |
| Vanadium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Cadmium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| ADDITIVES | | method | limit/base | current | history1 | history2 |
| Boron | ppm | ASTM D5185m | 1.5 | 0 | 0 | 0 |
| Barium | ppm | ASTM D5185m | 0 | 0 | 0 | 0 |
| Molybdenum | ppm | ASTM D5185m | 0 | 0 | 0 | 0 |
| Manganese | ppm | ASTM D5185m | 0.3 | <1 | <1 | <1 |
| Magnesium | ppm | ASTM D5185m | 0 | 0 | 0 | 0 |
| Calcium | ppm | ASTM D5185m | 0 | 0 | <1 | <1 |
| Phosphorus | ppm | ASTM D5185m | 406 | 169 | 193 | 31 |
| Zinc | ppm | ASTM D5185m | 0 | 0 | 0 | 17 |
| Sulfur | ppm | ASTM D5185m | 1283 | 882 | 800 | 22 |
| CONTAMINANTS | ; | method | limit/base | current | history1 | history2 |
| Silicon | ppm | ASTM D5185m | >25 | <1 | <1 | 0 |
| Sodium | ppm | ASTM D5185m | | <1 | 0 | 1 |
| Potassium | ppm | ASTM D5185m | >20 | 2 | 0 | <1 |
| FLUID DEGRADA | NOITA | method | limit/base | current | history1 | history2 |
| Acid Number (AN) | mg KOH/g | ASTM D8045 | 0.463 | 0.074 | 0.14 | 0.29 |



OIL ANALYSIS REPORT

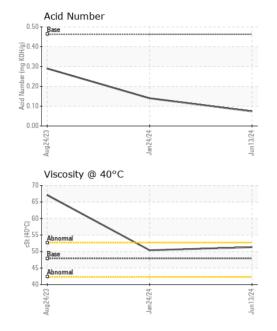

| VISUAL | | method | limit/base | current | history1 | history2 |
|-------------------------|--------|-----------|------------|---------|----------|----------|
| White Metal | scalar | *Visual | NONE | NONE | NONE | NONE |
| Yellow Metal | scalar | *Visual | NONE | NONE | NONE | NONE |
| Precipitate | scalar | *Visual | NONE | NONE | NONE | NONE |
| Silt | scalar | *Visual | NONE | NONE | NONE | NONE |
| Debris | scalar | *Visual | NONE | NONE | NONE | NONE |
| Sand/Dirt | scalar | *Visual | NONE | NONE | NONE | NONE |
| Appearance | scalar | *Visual | NORML | NORML | NORML | NORML |
| Odor | scalar | *Visual | NORML | NORML | NORML | NORML |
| Emulsified Water | scalar | *Visual | >0.1 | NEG | NEG | NEG |
| Free Water | scalar | *Visual | | NEG | NEG | NEG |
| FLUID PROPERTIES | | method | limit/base | current | history1 | history2 |
| Visc @ 40°C | cSt | ASTM D445 | 47.9 | 51.3 | 50.4 | 67.1 |
| SAMPLE IMAGES | | method | limit/base | current | history1 | history2 |
| Color | | | | | a | |

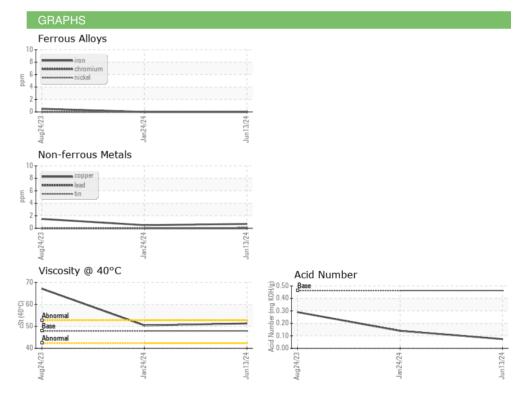





Certificate 12367

Laboratory Sample No.

Lab Number : 06214836 Unique Number : 11087700

Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : UAC06214836

To discuss this sample report, contact Customer Service at 1-800-237-1369.

Bottom

: 19 Jun 2024 Received **Tested** Diagnosed

: 20 Jun 2024 : 21 Jun 2024 - Sean Felton **ATLANTIC COMPRESSORS - ACI** 2144 SALEM INDUSTRIAL DRIVE SALEM, VA

US 24153 Contact: BILL RIMER

bill@atlanticcompressors.com T: (540)728-1147

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (757)216-0134 Contact/Location: BILL RIMER - UCATLSAL