


# OIL ANALYSIS REPORT

Sample Rating Trend



**NORMAL**

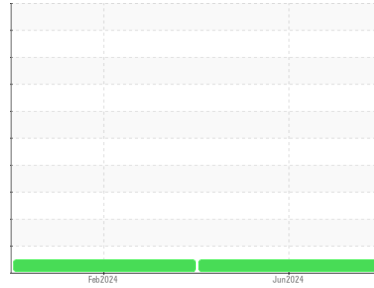

Area

**RAGE U46**

Machine Id

**SULLAIR 003-85053 - MALNOVE**

Component

**Compressor**

**DIAGNOSIS**

**Recommendation**

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

**Wear**

All component wear rates are normal.

**Contamination**

Moderate concentration of visible dirt/debris present in the oil.

**Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

**SAMPLE INFORMATION** method limit/base current history1 history2

Sample Number	Client Info	<b>UCS06214851</b>	UCS06103153	---
Sample Date	Client Info	<b>10 Jun 2024</b>	20 Feb 2024	---
Machine Age	hrs	<b>48583</b>	48553	---
Oil Age	hrs	<b>30</b>	2500	---
Oil Changed	Client Info	<b>Not Changed</b>	Changed	---
Sample Status		<b>NORMAL</b>	NORMAL	---

**CONTAMINATION** method limit/base current history1 history2

Water	WC Method	>0.1	<b>NEG</b>	NEG	---
-------	-----------	------	------------	-----	-----

**WEAR METALS** method limit/base current history1 history2

Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	---
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m		<b>0</b>	0	---
Titanium	ppm	ASTM D5185m		<b>0</b>	0	---
Silver	ppm	ASTM D5185m		<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m	>25	<b>&lt;1</b>	0	---
Lead	ppm	ASTM D5185m	>25	<b>0</b>	0	---
Copper	ppm	ASTM D5185m	>50	<b>&lt;1</b>	0	---
Tin	ppm	ASTM D5185m	>15	<b>&lt;1</b>	<1	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	<1	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	---

**ADDITIVES** method limit/base current history1 history2

Boron	ppm	ASTM D5185m		<b>0</b>	<1	---
Barium	ppm	ASTM D5185m		<b>3</b>	3	---
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	---
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
Magnesium	ppm	ASTM D5185m		<b>0</b>	<1	---
Calcium	ppm	ASTM D5185m		<b>0</b>	0	---
Phosphorus	ppm	ASTM D5185m		<b>192</b>	9	---
Zinc	ppm	ASTM D5185m		<b>0</b>	0	---
Sulfur	ppm	ASTM D5185m		<b>715</b>	46	---


**CONTAMINANTS** method limit/base current history1 history2

Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	3	---
Sodium	ppm	ASTM D5185m		<b>1</b>	<1	---
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	0	---

**FLUID DEGRADATION** method limit/base current history1 history2

Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.39</b>	0.33	---
------------------	----------	------------	--	-------------	------	-----


# OIL ANALYSIS REPORT

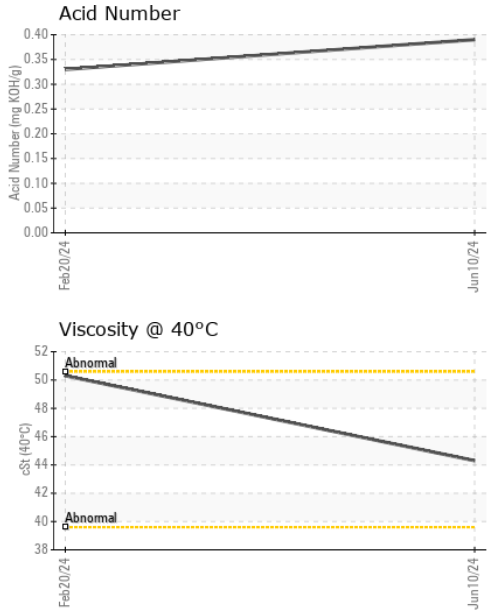





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	<b>MODER</b>	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	<b>44.3</b>	50.3	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

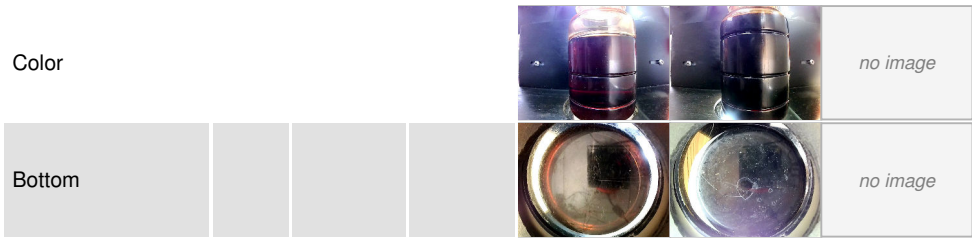

## GRAPHS

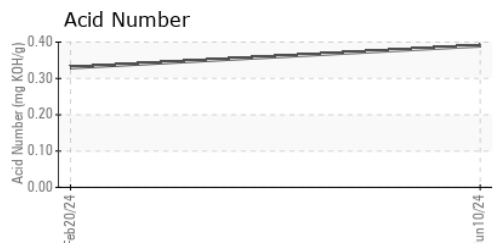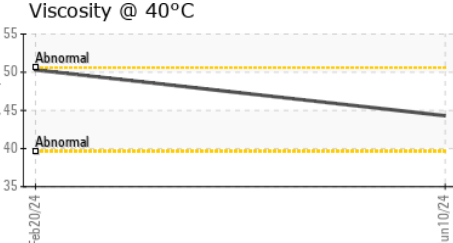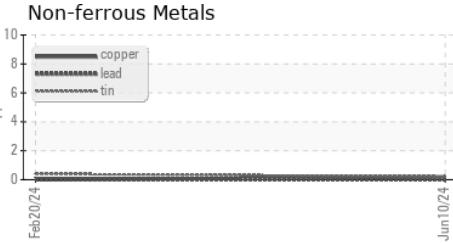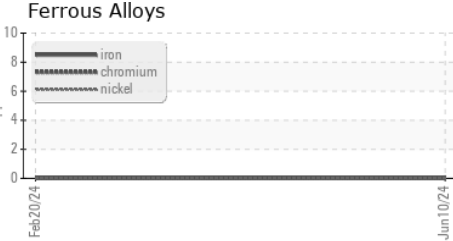

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCS06214851      **Received** : 19 Jun 2024  
**Lab Number** : **06214851**      **Tested** : 20 Jun 2024  
**Unique Number** : 11087715      **Diagnosed** : 21 Jun 2024 - Sean Felton  
**Test Package** : IND 2

**RASMUSSEN AIR & GAS ENERGY - RAGE**  
 655 240TH STREET  
 WATERLOO, NE  
 US 68069  
 Contact: CHASE SVOBODA  
 chase.svoboda@rage-energy.com  
 T: (402)614-9926  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)