




OIL ANALYSIS REPORT



Machine Id
BRCM01BE (S/N GZJ00658)
 Component
Biogas Engine
 Fluid
CHEVRON HDAX 9500 GAS ENGINE OIL 40 (--- GAL)

Sample Rating Trend

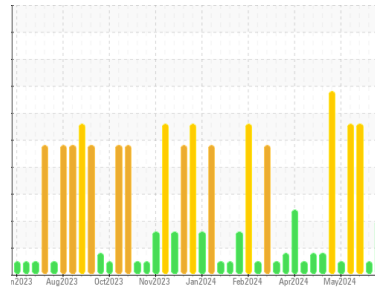

DIAGNOSIS

Recommendation
 No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear
 The high ferrous density (PQ) index indicates that abnormal wear is occurring.

Contamination
 There is no indication of any contamination in the oil.

Fluid Condition
 The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0938381	WC0938382	WC0760839
Sample Date	Client Info		14 Jun 2024	07 Jun 2024	04 Jun 2024
Machine Age	hrs	Client Info	77322	77233	77169
Oil Age	hrs	Client Info	112	23	654
Oil Changed	Client Info		Not Chngd	Not Chngd	Not Chngd
Sample Status			ABNORMAL	NORMAL	SEVERE

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<1.0	<1.0	<1.0
Water	WC Method		NEG	NEG	NEG
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184		▲ 21	15	15
Iron	ppm	ASTM D5185m >14	1	2	2
Chromium	ppm	ASTM D5185m >3	0	<1	0
Nickel	ppm	ASTM D5185m	0	0	0
Titanium	ppm	ASTM D5185m	<1	<1	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >5	1	2	2
Lead	ppm	ASTM D5185m >8	0	1	<1
Copper	ppm	ASTM D5185m >5	1	<1	<1
Tin	ppm	ASTM D5185m >3	0	<1	▲ 5
Vanadium	ppm	ASTM D5185m	<1	<1	<1
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	18	18	8
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	11	11	12
Manganese	ppm	ASTM D5185m	<1	<1	<1
Magnesium	ppm	ASTM D5185m	38	34	29
Calcium	ppm	ASTM D5185m	1800	1769	1910
Phosphorus	ppm	ASTM D5185m	284	288	290
Zinc	ppm	ASTM D5185m	345	346	369
Sulfur	ppm	ASTM D5185m	2048	2185	2781

CONTAMINANTS






	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >180	92	41	▲ 265
Sodium	ppm	ASTM D5185m >20	2	2	1
Potassium	ppm	ASTM D5185m >20	2	2	4

INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	0	0	0.1
Nitration	Abs/cm	*ASTM D7624	5.5	5.2	6.4
Sulfation	Abs:.1mm	*ASTM D7415	16.1	15.0	22.1



OIL ANALYSIS REPORT




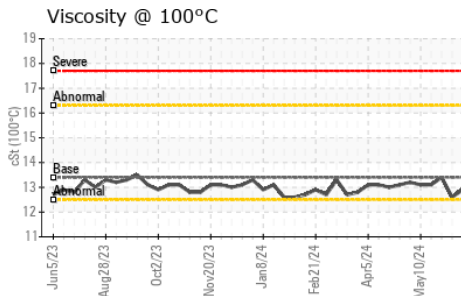
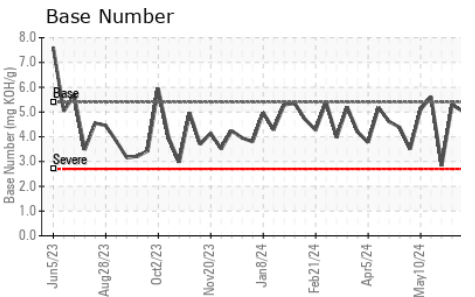
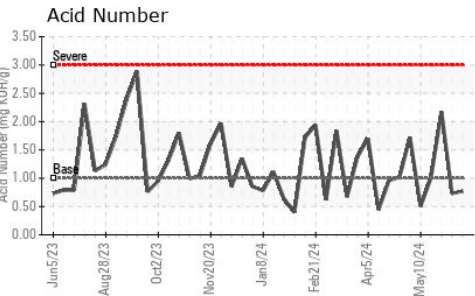
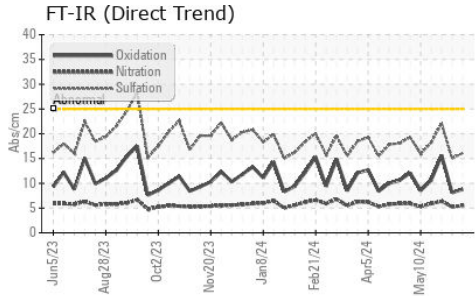
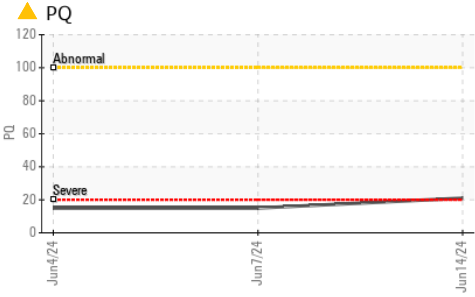


FLUID DEGRADATION	method	limit/base	current	history1	history2
Oxidation	Abs./1mm	*ASTM D7414	8.8	8.1	15.6
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.73	2.17
Base Number (BN)	mg KOH/g	ASTM D2896	5.4	5.29	2.83

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	NEG	NEG	NEG
Free Water	scalar	*Visual	NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.4	12.6	13.4

GRAPHS

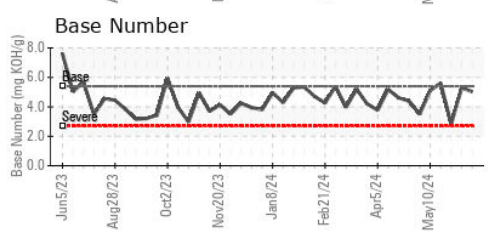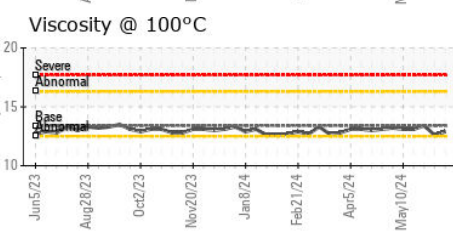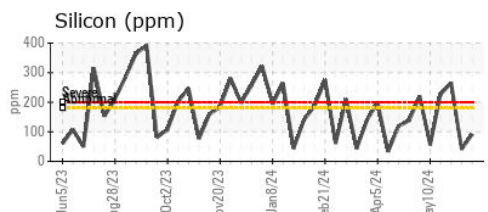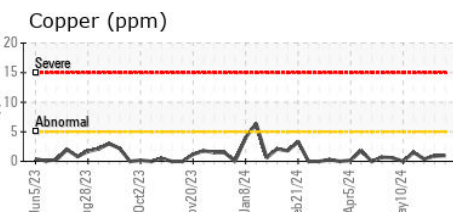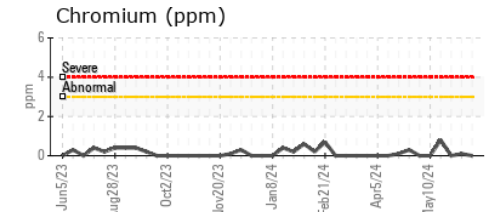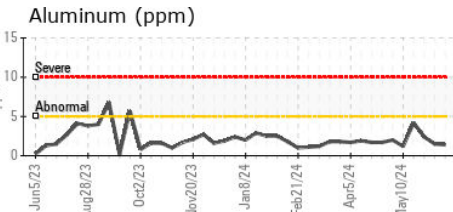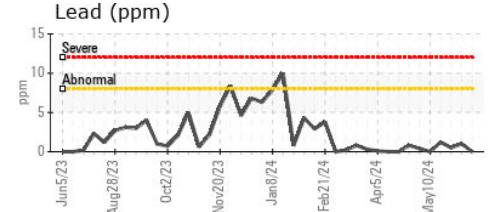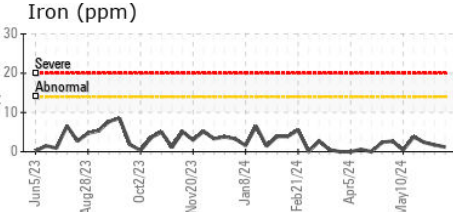

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0938381 **Received** : 19 Jun 2024
Lab Number : 06214919 **Tested** : 20 Jun 2024
Unique Number : 11087783 **Diagnosed** : 21 Jun 2024 - Sean Felton
Test Package : MOB 2 (Additional Tests: PQ)

EDL NA Recips-Brown County
 BROWN COUNTY POWER STATION, 9427 BEYERS RD
 GEORGETOWN, OH
 US 45121
 Contact: MITCHELL BUTLER
 Mitchell.Butler@edlenergy.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)