OIL ANALYSIS REPORT

Sample Rating Trend

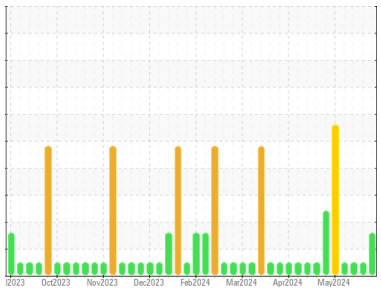

DIRT

Machine Id
MTNM01BE
Component
Biogas Engine
Fluid
SHELL MYSELLA S5 N 40 (160 GAL)

DIAGNOSIS

Recommendation
No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear
All component wear rates are normal.

Contamination
Elemental level of silicon (Si) above normal.

Fluid Condition
The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**WC0775201**	WC0775202	WC0775194
Sample Date		Client Info		**17 Jun 2024**	13 Jun 2024	28 May 2024
Machine Age	hrs	Client Info		**43228**	43136	43106
Oil Age	hrs	Client Info		**443**	351	391
Oil Changed		Client Info		**N/A**	N/A	N/A
Sample Status				**ABNORMAL**	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Fuel		WC Method	>4.0	**<1.0**	<1.0	<1.0
Water		WC Method		**NEG**	NEG	NEG
Glycol		WC Method		**NEG**	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184		**18**	17	---
Iron	ppm	ASTM D5185m	>14	**5**	4	4
Chromium	ppm	ASTM D5185m	>3	**0**	0	0
Nickel	ppm	ASTM D5185m		**0**	0	0
Titanium	ppm	ASTM D5185m		**<1**	<1	0
Silver	ppm	ASTM D5185m		**0**	0	0
Aluminum	ppm	ASTM D5185m	>5	**3**	3	3
Lead	ppm	ASTM D5185m	>8	**0**	0	0
Copper	ppm	ASTM D5185m	>5	**2**	1	1
Tin	ppm	ASTM D5185m	>3	**1**	0	4
Vanadium	ppm	ASTM D5185m		**<1**	<1	0
Cadmium	ppm	ASTM D5185m		**0**	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		**6**	6	2
Barium	ppm	ASTM D5185m		**0**	0	0
Molybdenum	ppm	ASTM D5185m		**2**	2	1
Manganese	ppm	ASTM D5185m		**<1**	<1	<1
Magnesium	ppm	ASTM D5185m		**25**	22	17
Calcium	ppm	ASTM D5185m		**1889**	1743	1795
Phosphorus	ppm	ASTM D5185m	300	**374**	340	392
Zinc	ppm	ASTM D5185m		**469**	430	476
Sulfur	ppm	ASTM D5185m		**3859**	3579	4065

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>180	▲ **185**	130	173
Sodium	ppm	ASTM D5185m	>20	**3**	3	1
Potassium	ppm	ASTM D5185m	>20	**<1**	1	0

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		**0.1**	0.1	0.1
Nitration	Abs/cm	*ASTM D7624	>16	**5.3**	4.5	5.1
Sulfation	Abs/.1mm	*ASTM D7415		**23.6**	20.4	23.2

OIL ANALYSIS REPORT

FT-IR (Direct Trend)

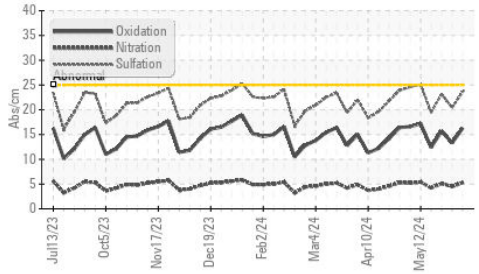

Acid Number

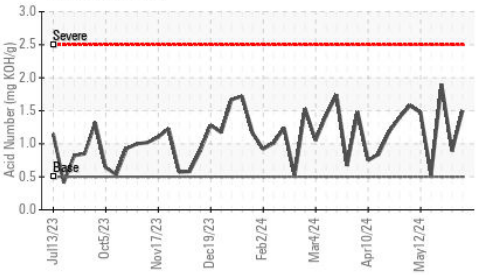

PQ

Base Number

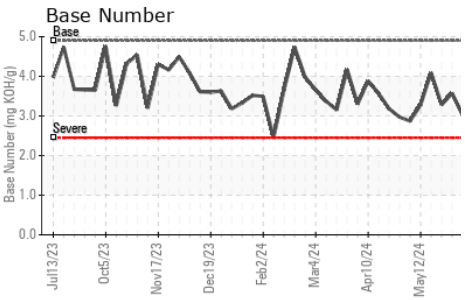

Viscosity @ 100°C

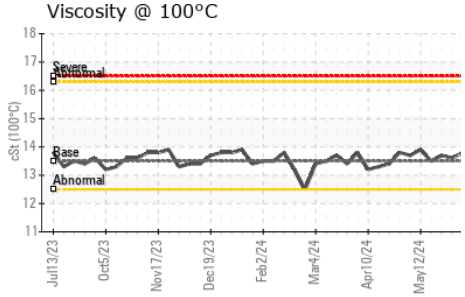

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414		**16.3**	13.3	15.7
Acid Number (AN)	mg KOH/g	ASTM D8045	0.5	**1.50**	0.89	1.90
Base Number (BN)	mg KOH/g	ASTM D2896	4.9	**3.02**	3.57	3.28

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**NONE**	LIGHT	NONE
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	NONE
Silt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Debris	scalar	*Visual	NONE	**NONE**	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Appearance	scalar	*Visual	NORML	**NORML**	NORML	NORML
Odor	scalar	*Visual	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	*Visual		**NEG**	NEG	NEG
Free Water	scalar	*Visual		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.5	**13.8**	13.6	13.7

GRAPHS

Iron (ppm)

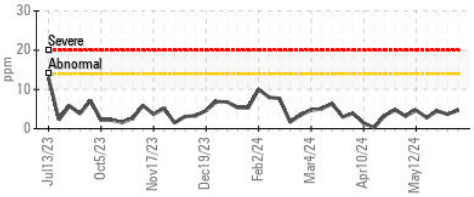

Lead (ppm)

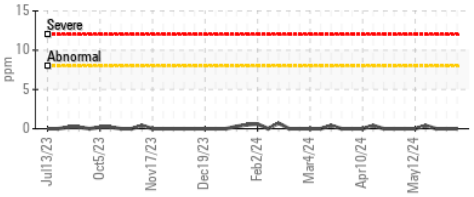

Aluminum (ppm)

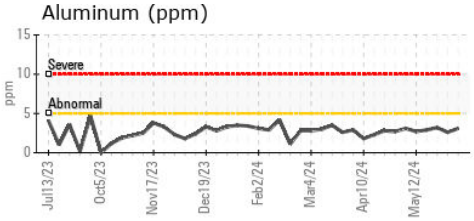

Chromium (ppm)

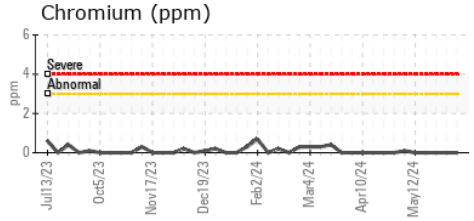

Copper (ppm)

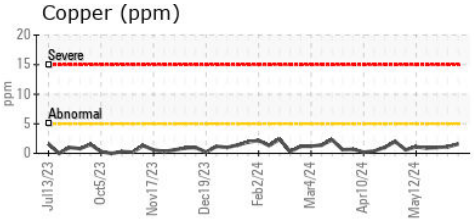

Silicon (ppm)

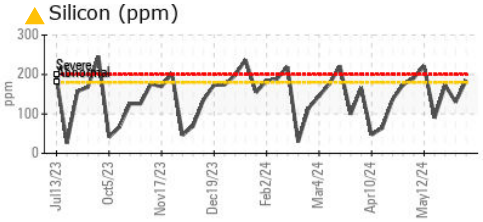

Viscosity @ 100°C

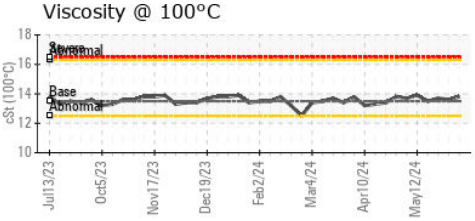

Base Number

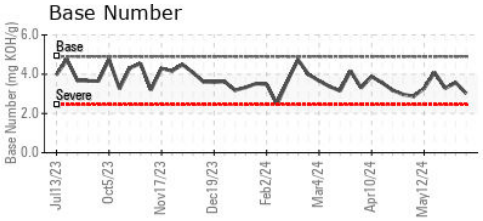

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0775201
Lab Number : 06214923
Unique Number : 11087787
Test Package : MOB 2 (Additional Tests: PQ)

Received : 19 Jun 2024
Tested : 20 Jun 2024
Diagnosed : 21 Jun 2024 - Sean Felton

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

EDL NA Recips-Morgantown
Morgantown Powerstation, 950 Shiloh
Morgantown, PA
US 19543
Contact: ARON GUNN
aron.gunn@edlenergy.com
T:
F: