




# OIL ANALYSIS REPORT

Sample Rating Trend

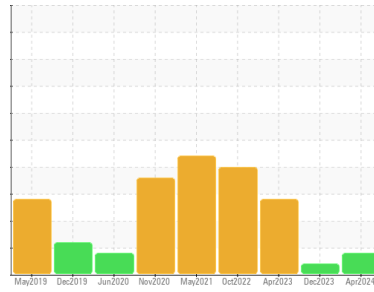

SEDIMENT



Machine Id  
**CE1203 EAST (S/N CORN LEG 1)**  
 Component  
**Gearbox**  
 Fluid  
**MOBIL SHC 630 (--- GAL)**

## DIAGNOSIS

### Recommendation

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of visible silt present in the sample.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

| method        | limit/base  | current            | history1    | history2    |
|---------------|-------------|--------------------|-------------|-------------|
| Sample Number | Client Info | <b>USP0013159</b>  | USP0004276  | USP246063   |
| Sample Date   | Client Info | <b>30 Apr 2024</b> | 26 Dec 2023 | 30 Apr 2023 |
| Machine Age   | hrs         | <b>0</b>           | 0           | 0           |
| Oil Age       | hrs         | <b>0</b>           | 0           | 0           |
| Oil Changed   | Client Info | <b>N/A</b>         | N/A         | N/A         |
| Sample Status |             | <b>ABNORMAL</b>    | ABNORMAL    | ABNORMAL    |

## WEAR METALS

| method   | limit/base | current          | history1     | history2 |    |
|----------|------------|------------------|--------------|----------|----|
| Iron     | ppm        | ASTM D5185m >200 | <b>15</b>    | 13       | 43 |
| Chromium | ppm        | ASTM D5185m >15  | <b>0</b>     | 0        | 0  |
| Nickel   | ppm        | ASTM D5185m >15  | <b>&lt;1</b> | 0        | 0  |
| Titanium | ppm        | ASTM D5185m      | <b>0</b>     | 0        | 0  |
| Silver   | ppm        | ASTM D5185m      | <b>0</b>     | 0        | 0  |
| Aluminum | ppm        | ASTM D5185m >25  | <b>&lt;1</b> | 0        | 0  |
| Lead     | ppm        | ASTM D5185m >100 | <b>0</b>     | 0        | 0  |
| Copper   | ppm        | ASTM D5185m >200 | <b>0</b>     | 0        | 0  |
| Tin      | ppm        | ASTM D5185m >25  | <b>0</b>     | 0        | 0  |
| Vanadium | ppm        | ASTM D5185m      | <b>0</b>     | 0        | 0  |
| Cadmium  | ppm        | ASTM D5185m      | <b>0</b>     | 0        | 0  |

## ADDITIVES

| method     | limit/base | current     | history1     | history2 |     |
|------------|------------|-------------|--------------|----------|-----|
| Boron      | ppm        | ASTM D5185m | <b>0</b>     | 0        | 0   |
| Barium     | ppm        | ASTM D5185m | <b>0</b>     | 0        | 0   |
| Molybdenum | ppm        | ASTM D5185m | <b>0</b>     | 0        | 0   |
| Manganese  | ppm        | ASTM D5185m | <b>&lt;1</b> | <1       | 0   |
| Magnesium  | ppm        | ASTM D5185m | <b>&lt;1</b> | 0        | 0   |
| Calcium    | ppm        | ASTM D5185m | <b>&lt;1</b> | <1       | 2   |
| Phosphorus | ppm        | ASTM D5185m | <b>459</b>   | 396      | 510 |
| Zinc       | ppm        | ASTM D5185m | <b>8</b>     | 0        | <1  |
| Sulfur     | ppm        | ASTM D5185m | <b>0</b>     | 14       | 0   |

## CONTAMINANTS

| method    | limit/base | current          | history1     | history2 |       |
|-----------|------------|------------------|--------------|----------|-------|
| Silicon   | ppm        | ASTM D5185m >50  | <b>21</b>    | 20       | 30    |
| Sodium    | ppm        | ASTM D5185m      | <b>1</b>     | <1       | 0     |
| Potassium | ppm        | ASTM D5185m >20  | <b>4</b>     | 0        | 0     |
| Water     | %          | ASTM D6304 >0.2  | <b>0.019</b> | 0.025    | 0.100 |
| ppm Water | ppm        | ASTM D6304 >2000 | <b>192</b>   | 251      | 1000  |

## FLUID CLEANLINESS




| method          | limit/base             | current    | history1 | history2   |
|-----------------|------------------------|------------|----------|------------|
| Particles >4µm  | ASTM D7647 >20000      | <b>---</b> | ---      | ▲ 146113   |
| Particles >6µm  | ASTM D7647 >5000       | <b>---</b> | ---      | ▲ 52244    |
| Particles >14µm | ASTM D7647 >640        | <b>---</b> | ---      | ▲ 2586     |
| Particles >21µm | ASTM D7647 >160        | <b>---</b> | ---      | ▲ 578      |
| Particles >38µm | ASTM D7647 >40         | <b>---</b> | ---      | 14         |
| Particles >71µm | ASTM D7647 >10         | <b>---</b> | ---      | 0          |
| Oil Cleanliness | ISO 4406 (c) >21/19/16 | <b>---</b> | ---      | ▲ 24/23/19 |

## FLUID DEGRADATION

| method           | limit/base | current    | history1    | history2 |      |
|------------------|------------|------------|-------------|----------|------|
| Acid Number (AN) | mg KOH/g   | ASTM D8045 | <b>0.38</b> | 0.46     | 0.44 |



# OIL ANALYSIS REPORT

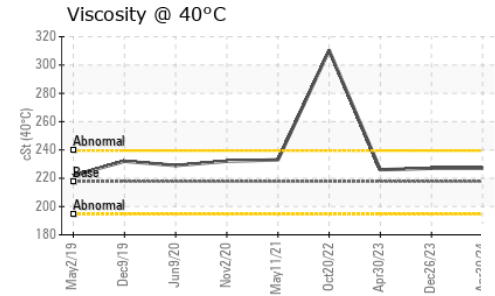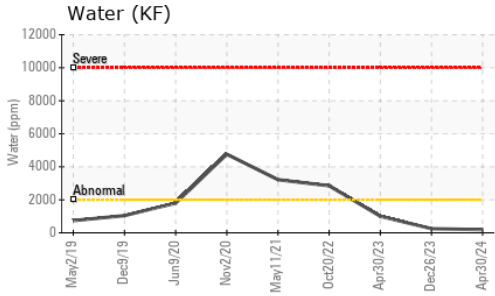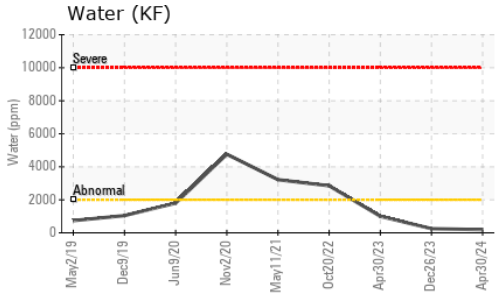





| VISUAL           | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal      | scalar | *Visual    | NONE    | NONE     | NONE     |
| Yellow Metal     | scalar | *Visual    | NONE    | NONE     | NONE     |
| Precipitate      | scalar | *Visual    | NONE    | NONE     | NONE     |
| Silt             | scalar | *Visual    | ▲ MODER | NONE     | NONE     |
| Debris           | scalar | *Visual    | NONE    | ▲ MODER  | LIGHT    |
| Sand/Dirt        | scalar | *Visual    | NONE    | NONE     | NONE     |
| Appearance       | scalar | *Visual    | NORML   | NORML    | ● HAZY   |
| Odor             | scalar | *Visual    | NORML   | NORML    | NORML    |
| Emulsified Water | scalar | *Visual    | >0.2    | NEG      | 0.2%     |
| Free Water       | scalar | *Visual    | NEG     | NEG      | NEG      |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| Visc @ 40°C      | cSt    | ASTM D445  | 217.7   | 227      | 226      |

### SAMPLE IMAGES

|        | method | limit/base | current | history1 | history2 |
|--------|--------|------------|---------|----------|----------|
| Color  |        |            |         |          |          |
| Bottom |        |            |         |          |          |

### GRAPHS

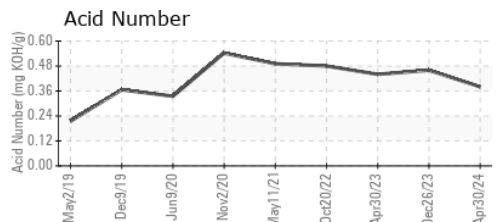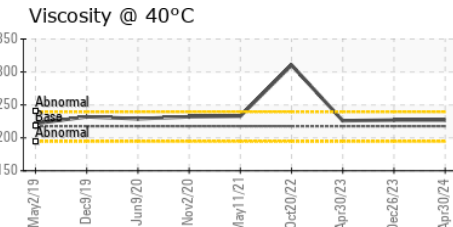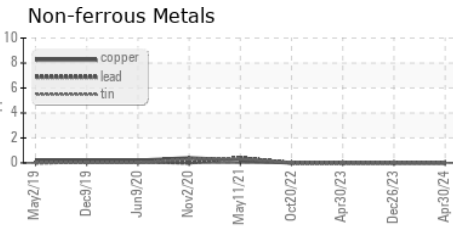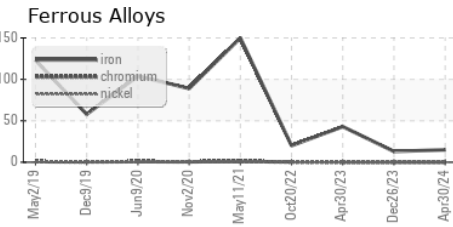

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USP0013159      **Received** : 20 Jun 2024  
**Lab Number** : 06215800      **Tested** : 24 Jun 2024  
**Unique Number** : 11088664      **Diagnosed** : 24 Jun 2024 - Doug Bogart  
**Test Package** : IND 2

**POET BIO PROCESSING**  
 1277 102ND ST  
 FAIRBANK, IA  
 US 50662  
 Contact: JASON GOEDKEN  
 Jason.Goedken@POET.COM  
 T: (319)284-2621  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)