




# OIL ANALYSIS REPORT

Sample Rating Trend

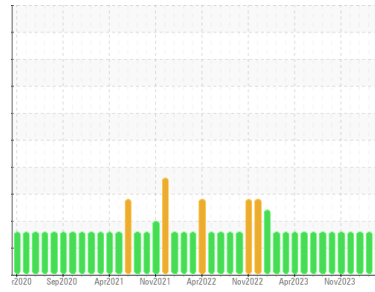

WATER



Machine Id  
**CF6302 (S/N 00881-003-1-01-01)**  
 Component  
**Gearbox**  
 Fluid  
**MOBIL GLYGOYLE 100 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a light concentration of water present in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>USP0013162</b>	USP0013163	USP0008351
Sample Date	Client Info		<b>04 Jun 2024</b>	01 May 2024	20 Mar 2024
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>ATTENTION</b>	ATTENTION	ATTENTION

## WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>200	<b>0</b>	<1	10
Chromium	ppm	ASTM D5185m	>15	<b>0</b>	0	<1
Nickel	ppm	ASTM D5185m	>15	<b>&lt;1</b>	<1	1
Titanium	ppm	ASTM D5185m		<b>0</b>	0	<1
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>25	<b>&lt;1</b>	<1	4
Lead	ppm	ASTM D5185m	>100	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m	>200	<b>0</b>	0	<1
Tin	ppm	ASTM D5185m	>25	<b>&lt;1</b>	<1	1
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	<1
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	<1

## ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	<1
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m		<b>2</b>	1	<1
Calcium	ppm	ASTM D5185m		<b>0</b>	0	4
Phosphorus	ppm	ASTM D5185m		<b>584</b>	574	488
Zinc	ppm	ASTM D5185m		<b>3</b>	3	2
Sulfur	ppm	ASTM D5185m		<b>825</b>	820	555

## CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>50	<b>&lt;1</b>	<1	46
Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	11
Potassium	ppm	ASTM D5185m	>20	<b>5</b>	4	2
Water	%	ASTM D6304	>0.2	<b>0.355</b>	0.462	0.322
ppm Water	ppm	ASTM D6304	>2000	<b>3550</b>	4620	3220

## FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	<b>8665</b>	7556	19425
Particles >6µm	ASTM D7647	>5000	<b>2018</b>	1124	3944
Particles >14µm	ASTM D7647	>640	<b>221</b>	33	313
Particles >21µm	ASTM D7647	>160	<b>85</b>	7	88
Particles >38µm	ASTM D7647	>40	<b>9</b>	0	7
Particles >71µm	ASTM D7647	>10	<b>0</b>	0	1
Oil Cleanliness	ISO 4406 (c)	>21/19/16	<b>20/18/15</b>	20/17/12	21/19/15

## FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.25</b>	0.24	0.32




# OIL ANALYSIS REPORT

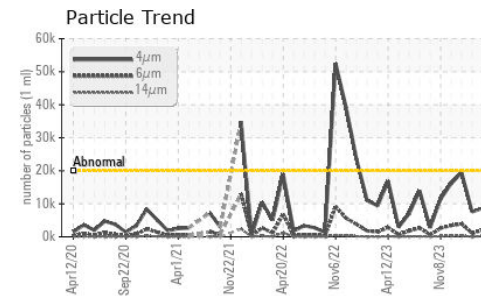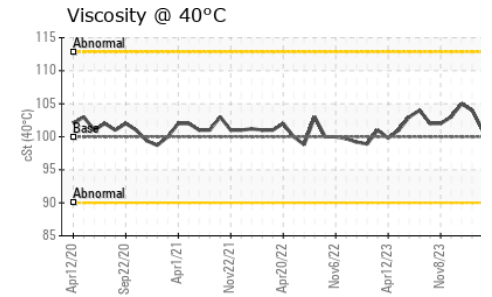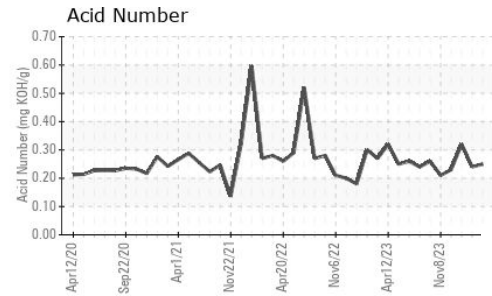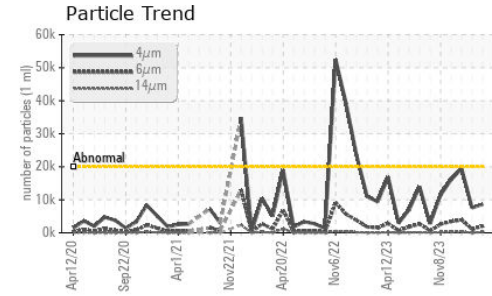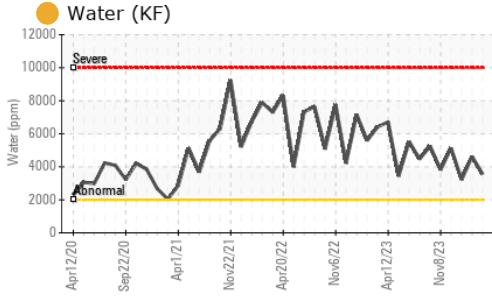






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	100.0	104	105

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

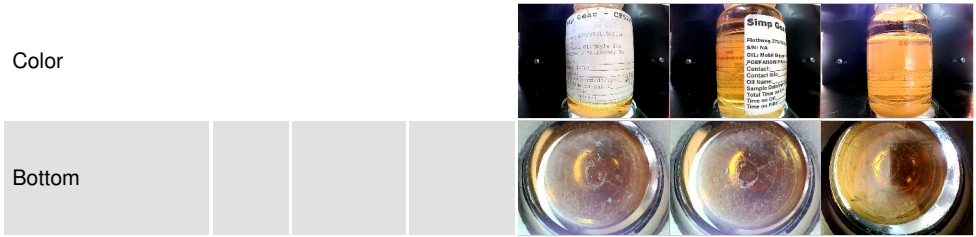

## GRAPHS

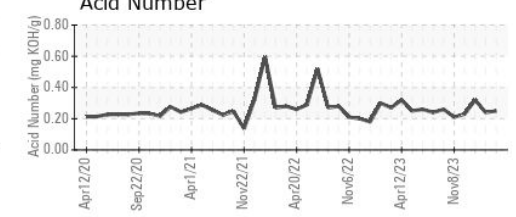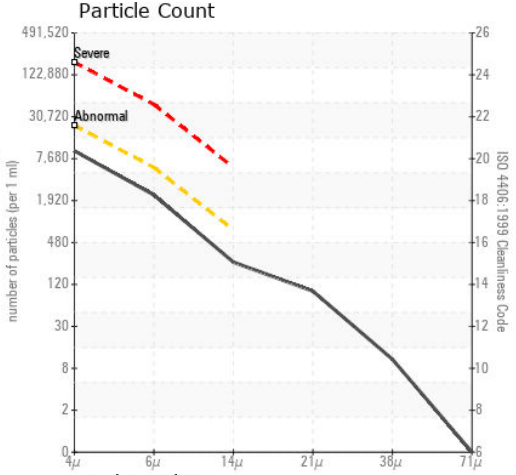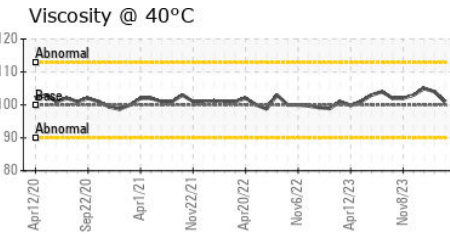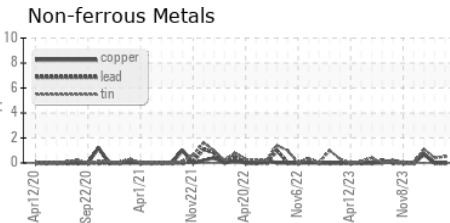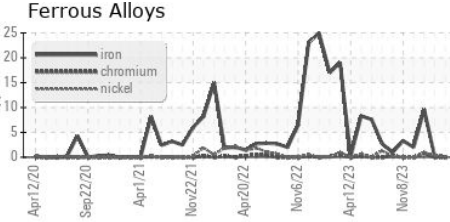

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USP0013162  
**Lab Number** : 06215810  
**Unique Number** : 11088674  
**Test Package** : IND 2

**Received** : 20 Jun 2024  
**Tested** : 21 Jun 2024  
**Diagnosed** : 24 Jun 2024 - Doug Bogart

**POET BIO PROCESSING**  
 1277 102ND ST  
 FAIRBANK, IA  
 US 50662  
 Contact: JASON GOEDKEN  
 Jason.Goedken@POET.COM  
 T: (319)284-2621  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)