



OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Area

NOT GIVEN

Machine Id

ATLAS COPCO API840360 - RMC

Component

Compressor

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

Moderate concentration of visible dirt/debris present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

| SAMPLE INFORMATION | | method | limit/base | current | history1 | history2 |
|--------------------|-------------|-------------|------------|--------------------|----------|----------|
| Sample Number | Client Info | | | UCH06215838 | --- | --- |
| Sample Date | Client Info | | | 17 May 2024 | --- | --- |
| Machine Age | hrs | Client Info | | 18849 | --- | --- |
| Oil Age | hrs | Client Info | | 0 | --- | --- |
| Oil Changed | Client Info | | | Changed | --- | --- |
| Sample Status | | | | NORMAL | --- | --- |

| WEAR METALS | | method | limit/base | current | history1 | history2 |
|-------------|-----|-------------|------------|--------------|----------|----------|
| Iron | ppm | ASTM D5185m | >50 | 0 | --- | --- |
| Chromium | ppm | ASTM D5185m | >5 | 0 | --- | --- |
| Nickel | ppm | ASTM D5185m | | <1 | --- | --- |
| Titanium | ppm | ASTM D5185m | | 0 | --- | --- |
| Silver | ppm | ASTM D5185m | | 0 | --- | --- |
| Aluminum | ppm | ASTM D5185m | >15 | 0 | --- | --- |
| Lead | ppm | ASTM D5185m | >65 | 0 | --- | --- |
| Copper | ppm | ASTM D5185m | >65 | 2 | --- | --- |
| Tin | ppm | ASTM D5185m | >10 | 0 | --- | --- |
| Vanadium | ppm | ASTM D5185m | | 0 | --- | --- |
| Cadmium | ppm | ASTM D5185m | | 0 | --- | --- |

| ADDITIVES | | method | limit/base | current | history1 | history2 |
|------------|-----|-------------|------------|--------------|----------|----------|
| Boron | ppm | ASTM D5185m | 5 | 0 | --- | --- |
| Barium | ppm | ASTM D5185m | 5 | 8 | --- | --- |
| Molybdenum | ppm | ASTM D5185m | 5 | 0 | --- | --- |
| Manganese | ppm | ASTM D5185m | | <1 | --- | --- |
| Magnesium | ppm | ASTM D5185m | 5 | <1 | --- | --- |
| Calcium | ppm | ASTM D5185m | 12 | 0 | --- | --- |
| Phosphorus | ppm | ASTM D5185m | 12 | 20 | --- | --- |
| Zinc | ppm | ASTM D5185m | 12 | 11 | --- | --- |
| Sulfur | ppm | ASTM D5185m | 1000 | 107 | --- | --- |



| CONTAMINANTS | | method | limit/base | current | history1 | history2 |
|--------------|-----|-------------|------------|------------|----------|----------|
| Silicon | ppm | ASTM D5185m | >35 | 5 | --- | --- |
| Sodium | ppm | ASTM D5185m | | 2 | --- | --- |
| Potassium | ppm | ASTM D5185m | >20 | 3 | --- | --- |
| Water | % | ASTM D6304 | >0.1 | NEG | --- | --- |

| FLUID DEGRADATION | | method | limit/base | current | history1 | history2 |
|-------------------|----------|------------|------------|-------------|----------|----------|
| Acid Number (AN) | mg KOH/g | ASTM D8045 | 0.10 | 0.10 | --- | --- |

| VISUAL | | method | limit/base | current | history1 | history2 |
|------------------|--------|---------|------------|--------------|----------|----------|
| White Metal | scalar | *Visual | NONE | NONE | --- | --- |
| Yellow Metal | scalar | *Visual | NONE | NONE | --- | --- |
| Precipitate | scalar | *Visual | NONE | NONE | --- | --- |
| Silt | scalar | *Visual | NONE | NONE | --- | --- |
| Debris | scalar | *Visual | NONE | MODER | --- | --- |
| Sand/Dirt | scalar | *Visual | NONE | NONE | --- | --- |
| Appearance | scalar | *Visual | NORML | NORML | --- | --- |
| Odor | scalar | *Visual | NORML | NORML | --- | --- |
| Emulsified Water | scalar | *Visual | >0.1 | NEG | --- | --- |
| Free Water | scalar | *Visual | | NEG | --- | --- |



OIL ANALYSIS REPORT



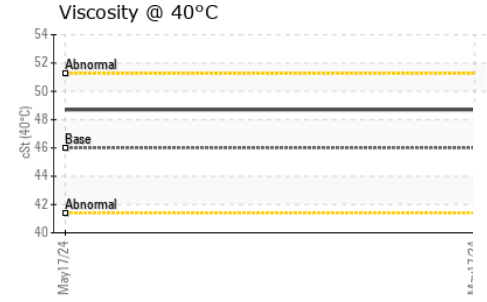
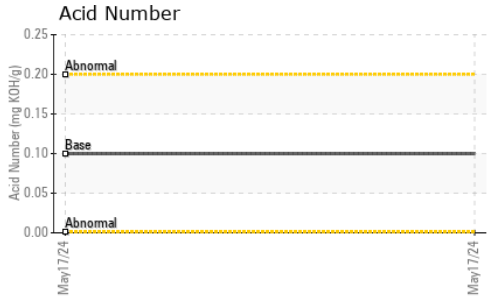


| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|--------------|---------|----------|----------|
| Visc @ 40°C | cSt | ASTM D445 46 | 48.7 | --- | --- |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

| | | | | | |
|--------|--|--|--|----------|----------|
| Color | | | | no image | no image |
| Bottom | | | | no image | no image |

GRAPHS

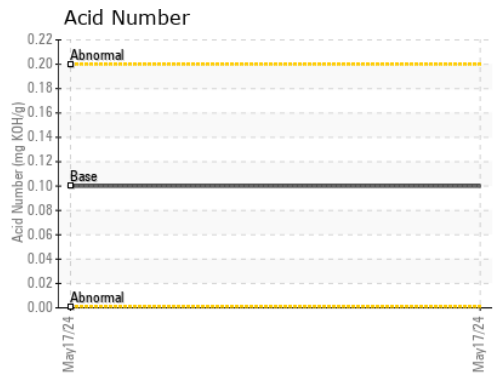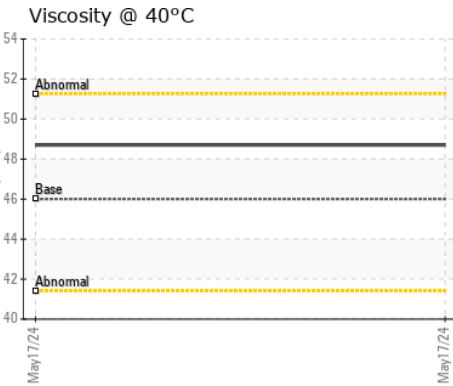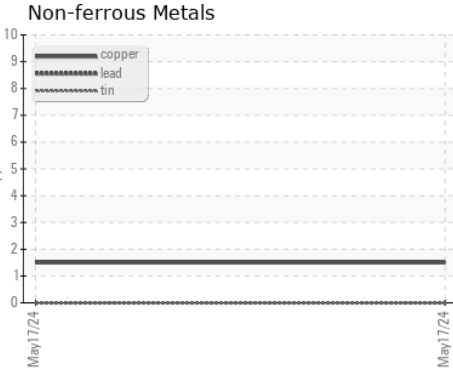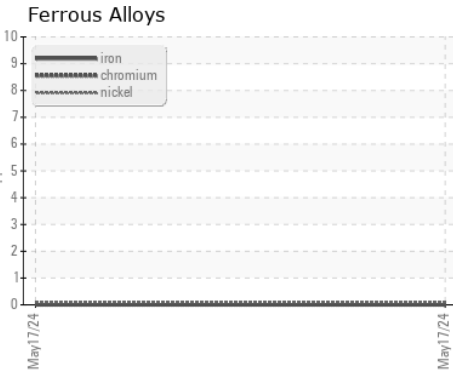

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : UCH06215838 **Received** : 20 Jun 2024
Lab Number : 06215838 **Tested** : 22 Jun 2024
Unique Number : 11088702 **Diagnosed** : 22 Jun 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: KF)

AIRMATIC COMPRESSOR SYSTEMS
 700 WASHINGTON AVE
 CARLSTADT, NJ
 US 07072
 Contact: ELVIN DIAZ
 ediaz@airmaticcompressor.com; canastasio@wearcheckusa.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (800)864-7621
F: (201)342-6241