


OIL ANALYSIS REPORT

ROTO XTEND [CSA979] ATLAS COPCO CAI616501 - MICHIGAN MILK

Component Compressor





Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the


Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH06215843		
Sample Date		Client Info		23 May 2024		
Machine Age	hrs	Client Info		79971		
Oil Age	hrs	Client Info		2592		
Oil Changed		Client Info		Not Changd		
Sample Status				NORMAL		
CONTAMINATION		method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>5	0		
Nickel	ppm	ASTM D5185m		<1		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>15	<1		
Lead	ppm	ASTM D5185m	>65	0		
Copper	ppm	ASTM D5185m	>65	0		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m		<1		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m		47		
Zinc	ppm	ASTM D5185m		155		
Sulfur	ppm	ASTM D5185m		151		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>35	<1		
Sodium	ppm	ASTM D5185m		2		
Potassium	ppm	ASTM D5185m	>20	3		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.14	0.24		





OIL ANALYSIS REPORT

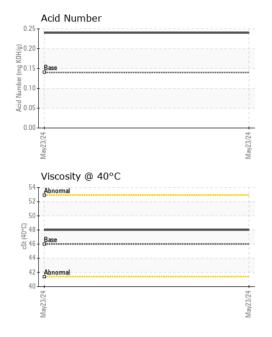


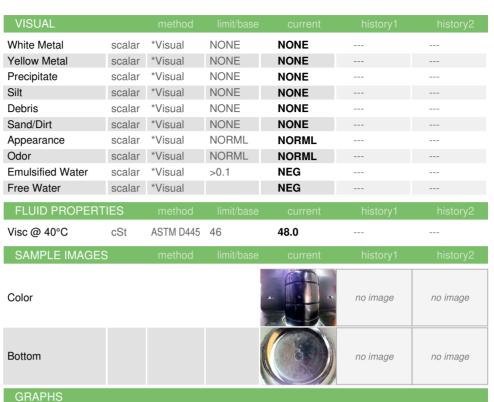


Ferrous Alloys













Certificate 12367

Laboratory Sample No.

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Lab Number : 06215843 Unique Number : 11088707

Test Package : IND 2

To discuss this sample report, contact Customer Service at 1-800-237-1369.

: UCH06215843

Received : 20 Jun 2024 **Tested** Diagnosed

: 21 Jun 2024 : 21 Jun 2024 - Wes Davis AIR TECHNOLOGIES INC (GR)

160 84TH STREET SW SUITE 1 BYRON CENTER, MI US 49315

Contact: STEPHANIE CLAYPOOL stephanie.claypool@aircompressors.com T:

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (616)281-6737 Contact/Location: STEPHANIE CLAYPOOL - UCAIRBYR