


## **OIL ANALYSIS REPORT**

# NOT GIVEN **ATLAS COPCO HOL022907 - FINE PRINT OF NE**

Component Compressor

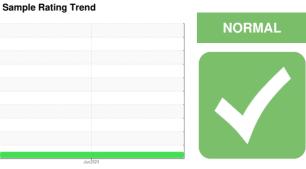

### Recommendation

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH06215852		
Sample Date		Client Info		13 Jun 2024		
Machine Age	hrs	Client Info		57629		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
CONTAMINATION	٧	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>5	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>15	<1		
Lead	ppm	ASTM D5185m	>65	<1		
Copper	ppm	ASTM D5185m	>65	3		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		3		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m		<1		
Calcium	ppm	ASTM D5185m		8		
Phosphorus	ppm	ASTM D5185m		174		
Zinc	ppm	ASTM D5185m		149		
Sulfur	ppm	ASTM D5185m		112		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>35	<1		
Sodium	ppm	ASTM D5185m		7		
Potassium	ppm	ASTM D5185m	>20	4		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.61		



## **OIL ANALYSIS REPORT**

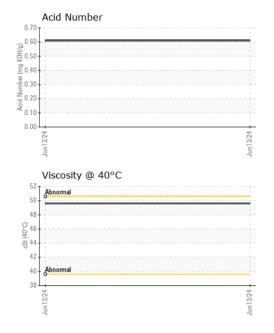


VIOLIAI			11 11 11			111
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE		
Yellow Metal	scalar	*Visual	NONE	NONE		
Precipitate	scalar	*Visual	NONE	NONE		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	NONE		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML		
<b>Emulsified Water</b>	scalar	*Visual	>0.1	NEG		
Free Water	scalar	*Visual		NEG		
FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445		49.6		
SAMPLE IMAGES		method	limit/base	current	history1	history2


Color




## **GRAPHS**









no image

no image





Certificate 12367

Laboratory Sample No.

Test Package : IND 2

Lab Number : 06215852 Unique Number : 11088716

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : UCH06215852

To discuss this sample report, contact Customer Service at 1-800-237-1369.

Received **Tested** Diagnosed

: 20 Jun 2024 : 21 Jun 2024 : 21 Jun 2024 - Wes Davis

700 WASHINGTON AVE CARLSTADT, NJ

**AIRMATIC COMPRESSOR SYSTEMS** 

US 07072 Contact: ELVIN DIAZ ediaz@airmaticcompressor.com;canastasio@wearcheckusa.com

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) F: (201)342-6241

Report Id: UCAIRCAR [WUSCAR] 06215852 (Generated: 06/23/2024 05:24:08) Rev: 1

Contact/Location: ELVIN DIAZ - UCAIRCAR

T: (800)864-7621