


OIL ANALYSIS REPORT

PG-46 [290422] PNEUTECH AK100021763 - METAL EDGE INTL

Component Compressor





Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


				Jun 2024		
SAMPLE INFORM	AATION.	method	limit/base	ourront	history1	history?
	MATION		IIIIIVbase	current	history1	history2
Sample Number		Client Info		UFD0001647		
Sample Date		Client Info		14 Jun 2024		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		1495		
Oil Changed		Client Info		Not Changd		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m		<1		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	<1		
Lead	ppm	ASTM D5185m	>25	0		
Copper	ppm	ASTM D5185m	>50	0		
Tin	ppm	ASTM D5185m	>15	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	5	0		
Barium	ppm	ASTM D5185m	5	1		
Molybdenum	ppm	ASTM D5185m	5	0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	5	1		
Calcium	ppm	ASTM D5185m	12	0		
Phosphorus	ppm	ASTM D5185m	12	22		
Zinc	ppm	ASTM D5185m	12	9		
Sulfur	ppm	ASTM D5185m	1000	293		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	9		
Sodium	ppm	ASTM D5185m		3		
Potassium	ppm	ASTM D5185m	>20	4		
Water	%	ASTM D6304	>0.1	NEG		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.10	0.07		
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE		
Yellow Metal	scalar	*Visual	NONE	NONE		
Precipitate	scalar	*Visual	NONE	NONE		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	NONE		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML		
Emulsified Water	scalar	*Visual	>0.1	NEG		
Free Water	scalar	*Visual		NEG	Service Manage	er - U <u>C</u> FLUMOR
						Dogg 1 of 2





OIL ANALYSIS REPORT

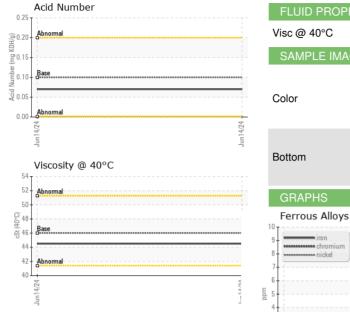
















Laboratory Sample No.

Lab Number : 06215873

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : UFD0001647 Unique Number : 11088737

Received : 20 Jun 2024 **Tested** Diagnosed

: 23 Jun 2024 : 23 Jun 2024 - Don Baldridge

FLUID-AIRE DYNAMICS 36 MOUNTAIN VIEW RD MORGANTOWN, PA US 19543

Contact: Service Manager

Test Package : IND 2 (Additional Tests: KF) Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: Service Manager - UCFLUMOR

T:

F: