




OIL ANALYSIS REPORT

Sample Rating Trend

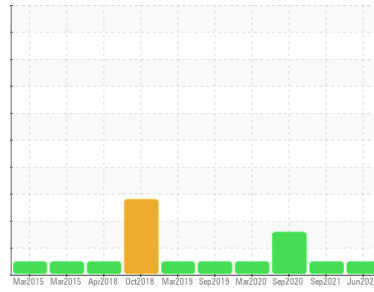

NORMAL



Machine Id
SULLAIR 003-136514 - DUBOSE
 Component
Compressor
 Fluid
PG-32 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0947071	WC0602212	WC0425715
Sample Date	Client Info			03 Jun 2024	22 Sep 2021	10 Sep 2020
Machine Age	hrs	Client Info		20499	0	16535
Oil Age	hrs	Client Info		0	4000	5473
Oil Changed	Client Info			N/A	Not Changd	N/A
Sample Status				NORMAL	NORMAL	ABNORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.1	NEG	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m		<1	0	<1
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	<1	0
Aluminum	ppm	ASTM D5185m	>25	<1	0	0
Lead	ppm	ASTM D5185m	>25	0	0	<1
Copper	ppm	ASTM D5185m	>50	0	0	0
Tin	ppm	ASTM D5185m	>15	1	<1	0
Antimony	ppm	ASTM D5185m		---	0	<1
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		<1	<1	0


ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	4	3
Barium	ppm	ASTM D5185m		523	233	77
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m		<1	0	<1
Calcium	ppm	ASTM D5185m		4	<1	2
Phosphorus	ppm	ASTM D5185m		5	9	3
Zinc	ppm	ASTM D5185m		8	0	10
Sulfur	ppm	ASTM D5185m		803	524	287

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1	0	1
Sodium	ppm	ASTM D5185m		26	47	47
Potassium	ppm	ASTM D5185m	>20	6	0	0

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.103	0.193	0.307



OIL ANALYSIS REPORT

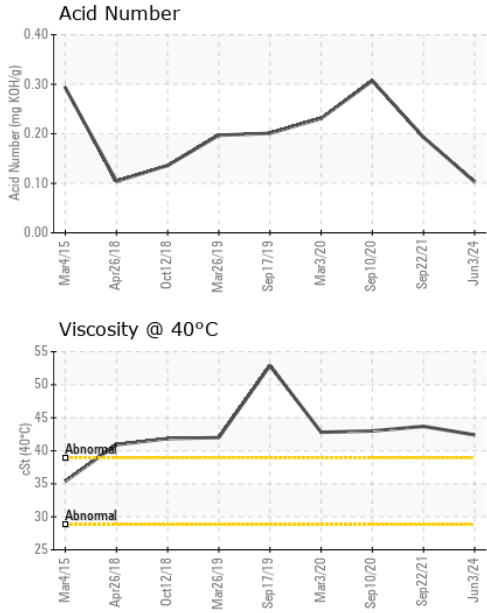





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	0.2%
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	42.4	43.7	43.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					



GRAPHS

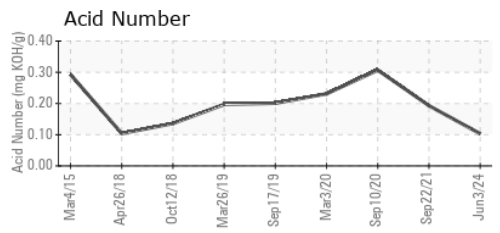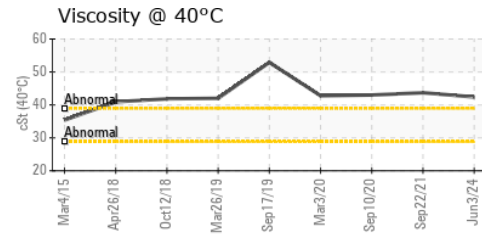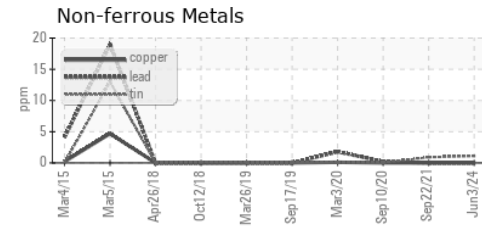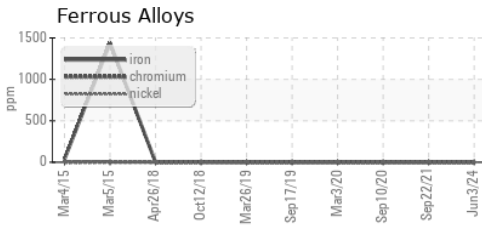

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0947071 **Received** : 20 Jun 2024
Lab Number : **06215874** **Tested** : 21 Jun 2024
Unique Number : 11088738 **Diagnosed** : 23 Jun 2024 - Don Baldrige
Test Package : IND 2

FS-COMPRESSIO CO, LLC
 203 AERO COURT
 GREENSBORO, NC
 US 27409
 Contact: Dallas Burcham
 dallas.burcham@fs-compression.com
 T: (336)605-9622
 F: (336)605-9844

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)