




# OIL ANALYSIS REPORT

Sample Rating Trend

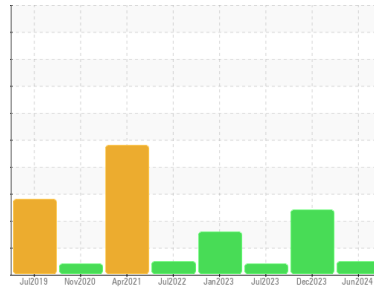

**NORMAL**



Machine Id  
**127334 - CODDINGTON**  
 Component  
**Diesel Engine**  
 Fluid  
 **DIESEL ENGINE OIL SAE 10W30 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>RP0034240</b>	RP0030056	RP0031519
Sample Date	Client Info		<b>20 Jun 2024</b>	19 Dec 2023	20 Jul 2023
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	ABNORMAL	ABNORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>5	<b>&lt;1.0</b>	<1.0	<1.0
Glycol	WC Method		<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >100	<b>1</b>	1	1
Chromium	ppm	ASTM D5185m >20	<b>0</b>	0	<1
Nickel	ppm	ASTM D5185m >4	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185m	<b>0</b>	<1	0
Silver	ppm	ASTM D5185m >3	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >20	<b>&lt;1</b>	5	2
Lead	ppm	ASTM D5185m >40	<b>&lt;1</b>	0	1
Copper	ppm	ASTM D5185m >330	<b>1</b>	0	<1
Tin	ppm	ASTM D5185m >15	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	<1

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 250	<b>45</b>	87	92
Barium	ppm	ASTM D5185m 10	<b>0</b>	6	2
Molybdenum	ppm	ASTM D5185m 100	<b>47</b>	87	84
Manganese	ppm	ASTM D5185m	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m 450	<b>58</b>	42	66
Calcium	ppm	ASTM D5185m 3000	<b>2313</b>	2294	2089
Phosphorus	ppm	ASTM D5185m 1150	<b>996</b>	1177	976
Zinc	ppm	ASTM D5185m 1350	<b>1161</b>	1255	1141

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>13</b>	51	12
Sodium	ppm	ASTM D5185m	<b>&lt;1</b>	4	0
Potassium	ppm	ASTM D5185m >20	<b>0</b>	2	1
Water	%	ASTM D6304 >0.2	<b>NEG</b>	NEG	NEG

## INFRA-RED


	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844 >3	<b>0</b>	0.1	0.1
Nitration	Abs/cm	*ASTM D7624 >20	<b>5.8</b>	6.6	6.9
Sulfation	Abs/.1mm	*ASTM D7415 >30	<b>14.4</b>	16.3	16.2

## FLUID DEGRADATION


	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	<b>9.7</b>	12.0	12.8
Base Number (BN)	mg KOH/g	ASTM D2896 8.5	<b>9.22</b>	10.55	10.13

# OIL ANALYSIS REPORT


FT-IR (Direct Trend)

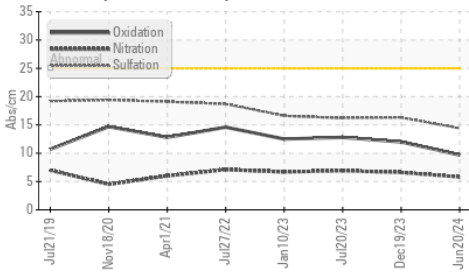


Base Number

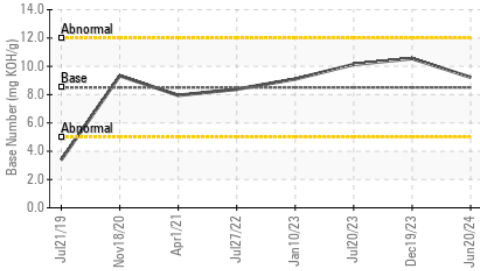


Water (KF)

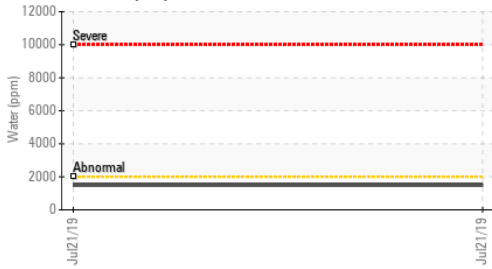

Water (KF)

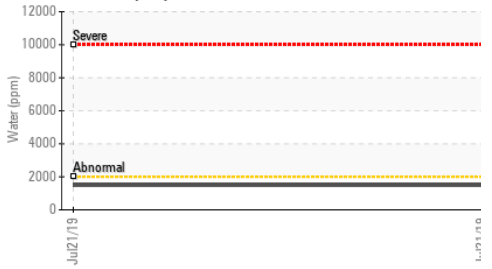

Viscosity @ 100°C

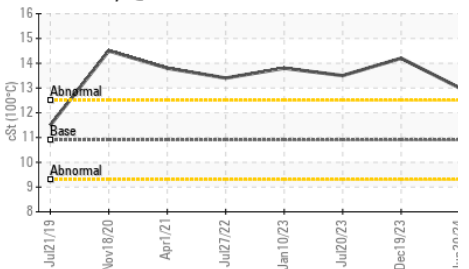


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	10.9	13.0	14.2

## GRAPHS


Ferrous Alloys

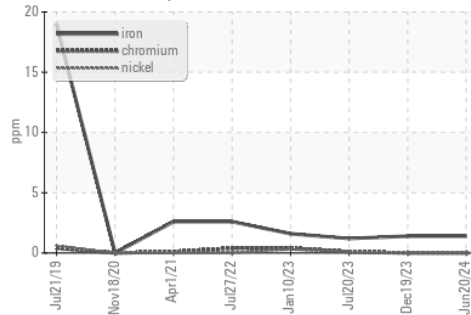


Non-ferrous Metals

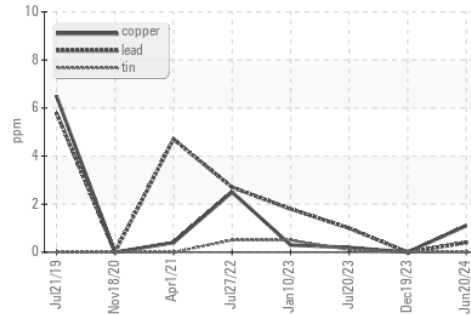

Viscosity @ 100°C

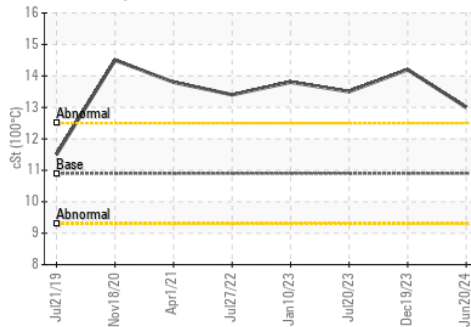

Acid Number

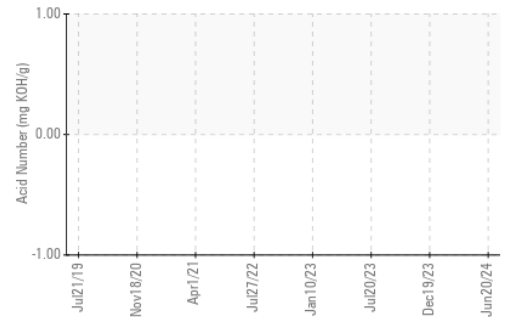

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : RP0034240 **Received** : 20 Jun 2024  
**Lab Number** : 06215937 **Tested** : 23 Jun 2024  
**Unique Number** : 11088801 **Diagnosed** : 23 Jun 2024 - Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: FT-IR, KV100, TBN )

**VEOLIA NEWPORT**  
 250 CONNELL HWY  
 NEWPORT, RI  
 US 02840

Contact: ANTHONY CALENDA  
 anthony.calenda@suez-na.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (401)439-8512

F: