




# OIL ANALYSIS REPORT

## Sample Rating Trend

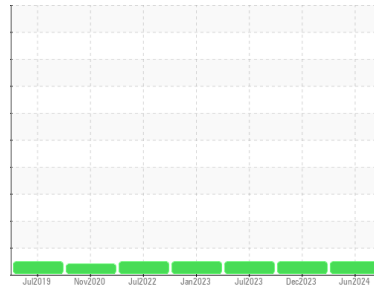

**NORMAL**



Machine Id  
**200-210-EG-01 - LONG WHARF (S/N 68133208)**  
 Component  
**Diesel Engine**  
 Fluid  
 **DIESEL ENGINE OIL SAE 10W30 (--- GAL)**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil.

#### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>RP0034234</b>	RP0030049	RP0031518
Sample Date	Client Info			<b>20 Jun 2024</b>	19 Dec 2023	20 Jul 2023
Machine Age	hrs	Client Info		<b>0</b>	0	0
Oil Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method	>5		<b>&lt;1.0</b>	<1.0	<1.0
Glycol	WC Method			<b>NEG</b>	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>100	<b>1</b>	1	1
Chromium	ppm	ASTM D5185m	>20	<b>0</b>	0	<1
Nickel	ppm	ASTM D5185m	>4	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185m		<b>0</b>	<1	0
Silver	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>20	<b>2</b>	3	2
Lead	ppm	ASTM D5185m	>40	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m	>330	<b>2</b>	<1	<1
Tin	ppm	ASTM D5185m	>15	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	250	<b>72</b>	89	108
Barium	ppm	ASTM D5185m	10	<b>0</b>	6	2
Molybdenum	ppm	ASTM D5185m	100	<b>81</b>	79	81
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m	450	<b>45</b>	77	104
Calcium	ppm	ASTM D5185m	3000	<b>2388</b>	1870	2042
Phosphorus	ppm	ASTM D5185m	1150	<b>1074</b>	995	1006
Zinc	ppm	ASTM D5185m	1350	<b>1276</b>	1090	1180


CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>11</b>	6	6
Sodium	ppm	ASTM D5185m		<b>2</b>	3	0
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	2	1
Water	%	ASTM D6304	>0.2	<b>NEG</b>	NEG	NEG

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	>3	<b>0.1</b>	0.1	0.1
Nitration	Abs/cm	*ASTM D7624	>20	<b>7.1</b>	6.8	7.0
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>16.1</b>	16.5	16.8


FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>12.4</b>	11.9	12.4
Base Number (BN)	mg KOH/g	ASTM D2896	8.5	<b>9.85</b>	9.96	10.24

# OIL ANALYSIS REPORT

FT-IR (Direct Trend)

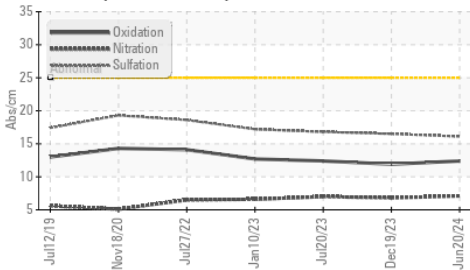


Base Number

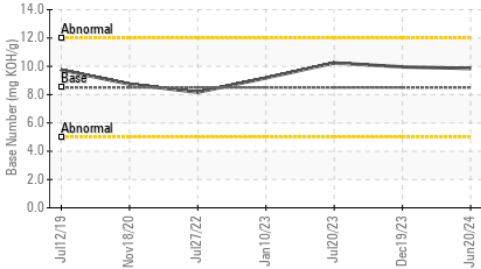


Water (KF)



Acid Number

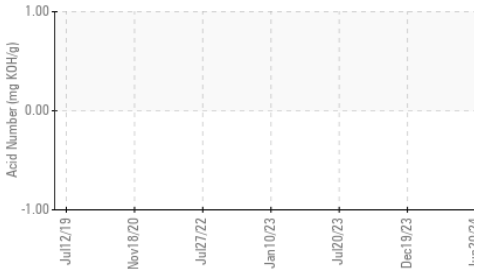

Water (KF)

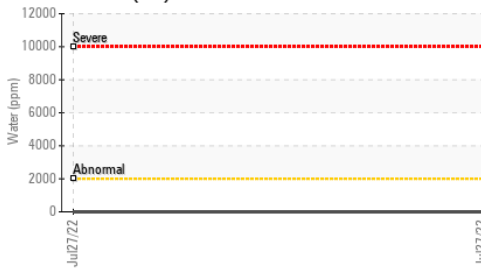


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	10.9	13.6	12.9

**GRAPHS**


Ferrous Alloys

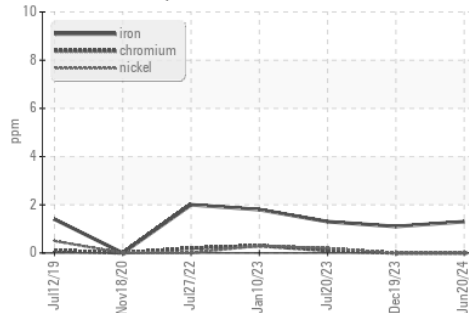


Non-ferrous Metals

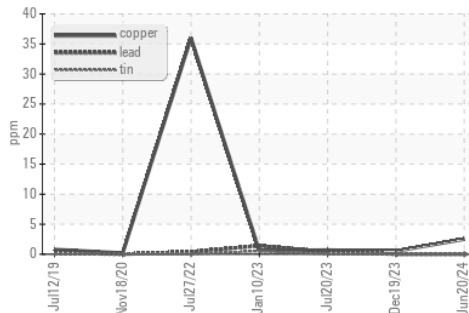

Viscosity @ 100°C

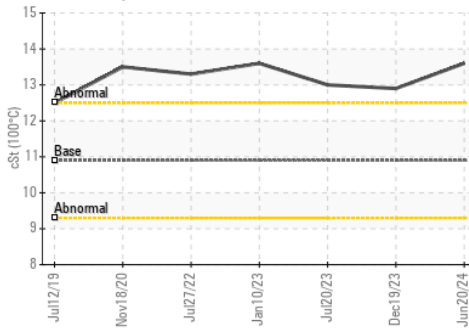

Acid Number

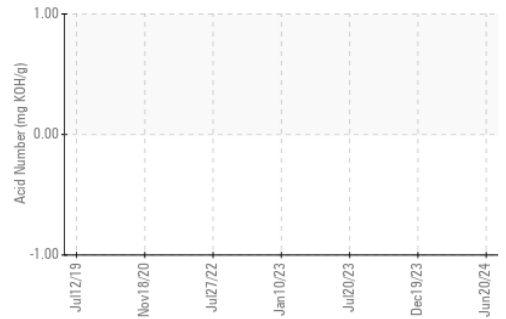

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : RP0034234  
**Lab Number** : 06215942  
**Unique Number** : 11088806  
**Test Package** : IND 2 ( Additional Tests: FT-IR, KV100, TBN )

**Received** : 20 Jun 2024  
**Tested** : 23 Jun 2024  
**Diagnosed** : 23 Jun 2024 - Don Baldrige

**VEOLIA NEWPORT**  
 250 CONNELL HWY  
 NEWPORT, RI  
 US 02840

Contact: ANTHONY CALENDA  
 anthony.calenda@suez-na.com  
 T: (401)439-8512

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)