



FUEL REPORT

Sample Rating Trend



ISO



Area

[CONHER]

Machine Id

UM - TRSM TM-227 (FULL) Diesel Fuel

Component

Diesel Fuel

Fluid

No.2 DIESEL FUEL (ULTRALOW SULPHUR) (1000 LTR)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time.

Corrosion

All metal levels are normal indicating no corrosion in the system.

Contaminants

There is a moderate amount of silt (particulates < 14 microns in size) present in the fuel. The water content is negligible.

Fuel Condition

The condition of the fuel is acceptable for the time in service.

| SAMPLE INFORMATION | | method | limit/base | current | history1 | history2 |
|--------------------|-------------|-------------|------------|--------------------|----------|----------|
| Sample Number | Client Info | | | KL0014593 | --- | --- |
| Sample Date | Client Info | | | 13 Jun 2024 | --- | --- |
| Machine Age | hrs | Client Info | | 0 | --- | --- |
| Sample Status | | | | ATTENTION | --- | --- |

| PHYSICAL PROPERTIES | | method | limit/base | current | history1 | history2 |
|---------------------|-----|-----------|------------|-------------|----------|----------|
| Visc @ 40°C | cSt | ASTM D445 | 3.0 | 2.24 | --- | --- |

| SULFUR CONTENT | | method | limit/base | current | history1 | history2 |
|----------------|-----|-------------|------------|------------|----------|----------|
| Sulfur | ppm | ASTM D5185m | 10 | 136 | --- | --- |

| CONTAMINANTS | | method | limit/base | current | history1 | history2 |
|--------------|-----|-------------|------------|--------------|----------|----------|
| Silicon | ppm | ASTM D5185m | <1.0 | 0 | --- | --- |
| Sodium | ppm | ASTM D5185m | <0.1 | 2 | --- | --- |
| Potassium | ppm | ASTM D5185m | <0.1 | 3 | --- | --- |
| Water | % | ASTM D6304 | <0.05 | 0.002 | --- | --- |
| ppm Water | ppm | ASTM D6304 | <500 | 20 | --- | --- |






| FLUID CLEANLINESS | | method | limit/base | current | history1 | history2 |
|-------------------|--|--------------|------------|--------------|----------|----------|
| Particles >4µm | | ASTM D7647 | | 2662 | --- | --- |
| Particles >6µm | | ASTM D7647 | >640 | 921 | --- | --- |
| Particles >14µm | | ASTM D7647 | >80 | 45 | --- | --- |
| Particles >21µm | | ASTM D7647 | >20 | 7 | --- | --- |
| Particles >38µm | | ASTM D7647 | >4 | 0 | --- | --- |
| Particles >71µm | | ASTM D7647 | >3 | 0 | --- | --- |
| Oil Cleanliness | | ISO 4406 (c) | >16/13 | 17/13 | --- | --- |

| HEAVY METALS | | method | limit/base | current | history1 | history2 |
|--------------|-----|-------------|------------|----------|----------|----------|
| Aluminum | ppm | ASTM D5185m | <0.1 | 0 | --- | --- |
| Nickel | ppm | ASTM D5185m | <0.1 | 0 | --- | --- |
| Lead | ppm | ASTM D5185m | <0.1 | 0 | --- | --- |
| Vanadium | ppm | ASTM D5185m | <0.1 | 0 | --- | --- |
| Iron | ppm | ASTM D5185m | <0.1 | 0 | --- | --- |
| Calcium | ppm | ASTM D5185m | <0.1 | 0 | --- | --- |
| Magnesium | ppm | ASTM D5185m | <0.1 | 0 | --- | --- |
| Phosphorus | ppm | ASTM D5185m | <0.1 | 0 | --- | --- |
| Zinc | ppm | ASTM D5185m | <0.1 | 3 | --- | --- |


| SAMPLE IMAGES | | method | limit/base | current | history1 | history2 |
|---------------|--|--------|------------|---------|----------|----------|
| Color | | | | | no image | no image |
| Bottom | | | | | no image | no image |



FUEL REPORT

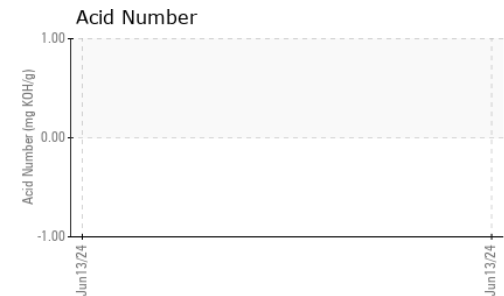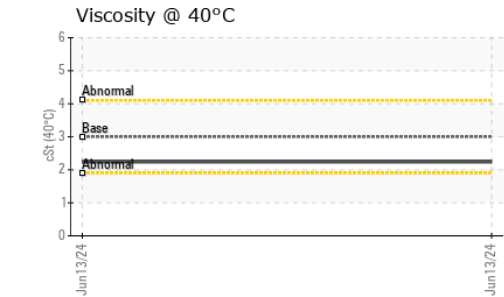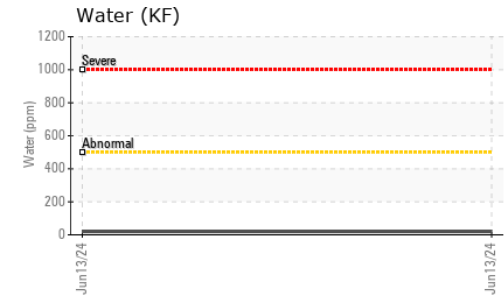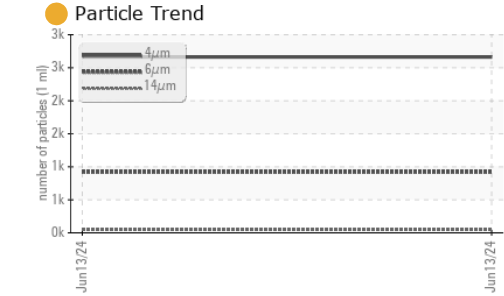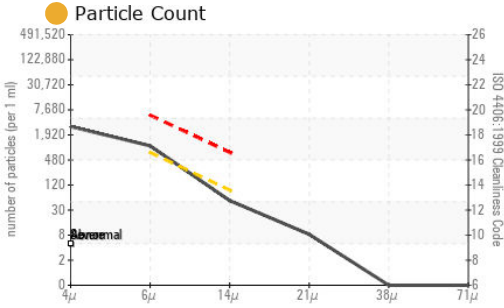

GRAPHS

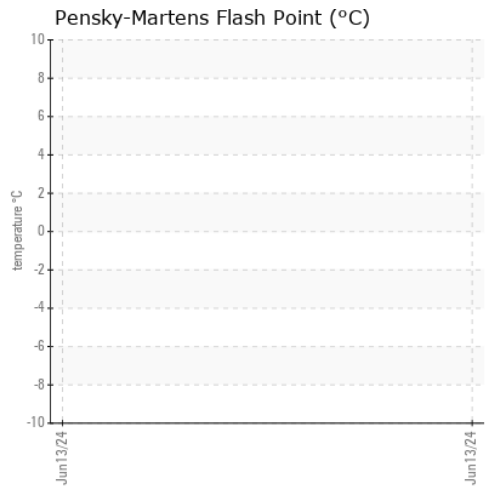

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KL0014593 **Received** : 20 Jun 2024
Lab Number : 06216242 **Tested** : 24 Jun 2024
Unique Number : 11089106 **Diagnosed** : 24 Jun 2024 - Doug Bogart
Test Package : MOB 2 (Additional Tests: KF, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

CONOR
 JUAREZ 348
 HERMOSILLO,
 MX 83140

Contact: EDUARDO GARCIA
 egarcia.comsa@gmail.com

T: (526)622-1581 x:81

F: x: