

**WEAR**



Machine Id  
**CUMMINS CAPTAIN JEFF IRBY**  
Component  
**Starboard Genset**  
Fluid  
**KENDALL SUPER-D XA 15W40 (--- GAL)**

**DIAGNOSIS**

**▲ Recommendation**

No corrective action is recommended at this time. Resample at the next service interval to monitor.

**▲ Wear**

The iron level is abnormal. All other component wear rates are normal.

**Contamination**

There is no indication of any contamination in the oil.

**Fluid Condition**

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>HRE0000282</b>	HRE0000280	---
Sample Date	Client Info			<b>17 Jun 2024</b>	05 Jun 2024	---
Machine Age	hrs	Client Info		<b>4930</b>	4920	---
Oil Age	hrs	Client Info		<b>500</b>	500	---
Oil Changed	Client Info			<b>Not Chngd</b>	Not Chngd	---
Sample Status				<b>ABNORMAL</b>	ABNORMAL	---

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method	>4.0		<b>&lt;1.0</b>	<1.0	---
Water	WC Method	>0.1		<b>NEG</b>	NEG	---
Glycol	WC Method			<b>NEG</b>	NEG	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>▲ 51</b>	▲ 53	---
Chromium	ppm	ASTM D5185m	>4	<b>1</b>	1	---
Nickel	ppm	ASTM D5185m	>2	<b>&lt;1</b>	<1	---
Titanium	ppm	ASTM D5185m		<b>50</b>	51	---
Silver	ppm	ASTM D5185m	>5	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m	>12	<b>2</b>	2	---
Lead	ppm	ASTM D5185m	>17	<b>2</b>	3	---
Copper	ppm	ASTM D5185m	>70	<b>11</b>	11	---
Tin	ppm	ASTM D5185m	>15	<b>1</b>	2	---
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	---





ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	50	<b>50</b>	57	---
Barium	ppm	ASTM D5185m		<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m		<b>8</b>	10	---
Manganese	ppm	ASTM D5185m		<b>1</b>	2	---
Magnesium	ppm	ASTM D5185m	270	<b>382</b>	382	---
Calcium	ppm	ASTM D5185m	1900	<b>1688</b>	1688	---
Phosphorus	ppm	ASTM D5185m	1000	<b>815</b>	681	---
Zinc	ppm	ASTM D5185m	1260	<b>1085</b>	988	---
Sulfur	ppm	ASTM D5185m	3400	<b>3079</b>	2831	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>7</b>	8	---
Sodium	ppm	ASTM D5185m		<b>24</b>	26	---
Potassium	ppm	ASTM D5185m	>20	<b>10</b>	10	---

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		<b>0.6</b>	0.6	---
Nitration	Abs/cm	*ASTM D7624	>20	<b>13.2</b>	13.3	---
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>25.4</b>	25.3	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>28.5</b>	28.5	---
Base Number (BN)	mg KOH/g	ASTM D2896	9.5	<b>6.4</b>	6.3	---





# OIL ANALYSIS REPORT

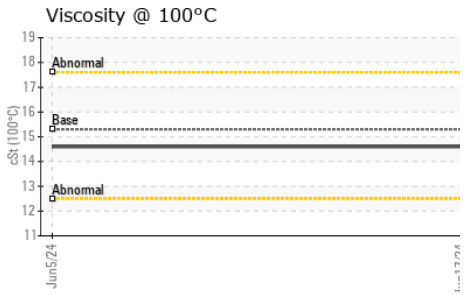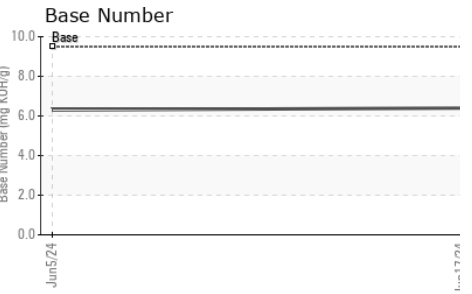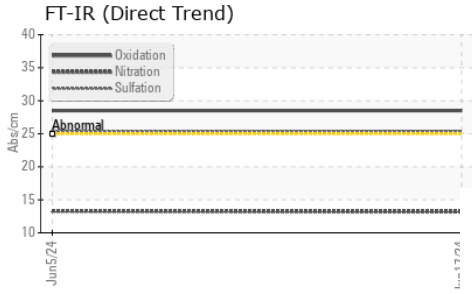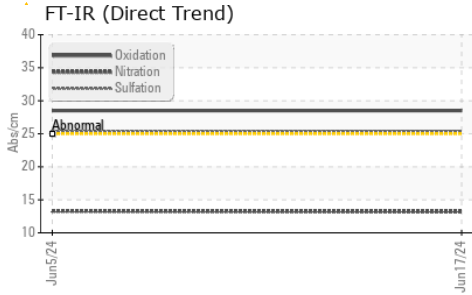

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D445	15.3	<b>14.6</b>	14.6	---

### GRAPHS

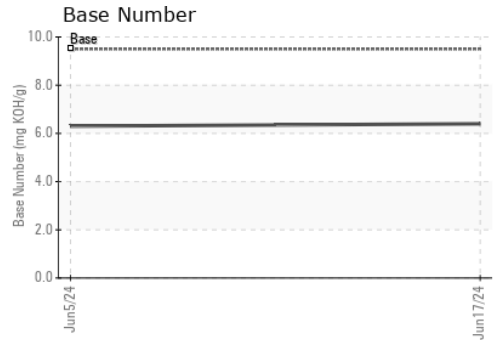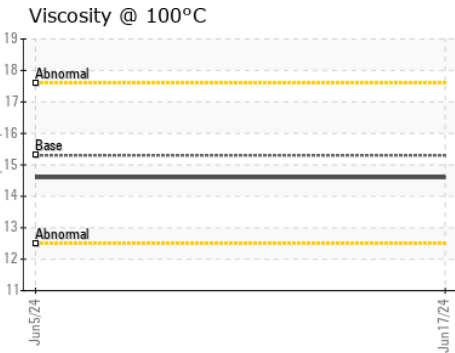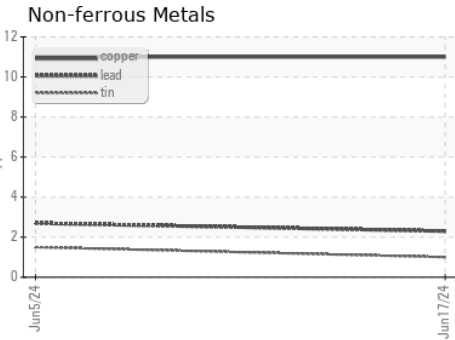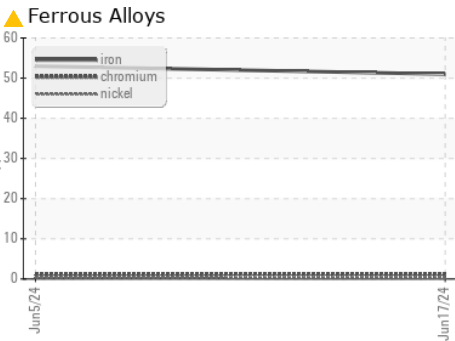

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : HRE0000282      **Received** : 20 Jun 2024  
**Lab Number** : **06216465**      **Tested** : 22 Jun 2024  
**Unique Number** : 11089329      **Diagnosed** : 23 Jun 2024 - Don Baldrige  
**Test Package** : FLEET

**SUPERIOR MARINE**  
 201 KELLY LANE  
 CHESAPEAKE, OH  
 US 45619

Contact: DARRELL KEARNS  
 darrellkearns@superiormarineinc.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: