FUEL REPORT

Sample Rating Trend

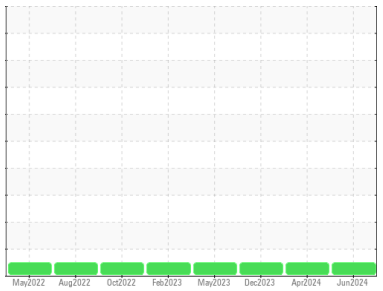

NORMAL

Area
MT/VA/Hospital/NOLA
Machine Id
VA HOSPITAL NEW ORLEANS TANK 6
Component
Diesel Fuel
Fluid
No.2 DIESEL FUEL (ULTRALOW SULPHUR) (--- QTS)

DIAGNOSIS

Recommendation
All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel.

Corrosion
All metal levels are normal indicating no corrosion in the system.

Contaminants
There is no bacteria or fungus (yeast and/or mold) indicated in the sample. The water content is negligible. There is no indication of any contamination in the fuel. The amount and size of particulates present in the system are acceptable.

Fuel Condition
Sulfur value derived by ASTM D5453 method for ULSD validation. Sulfur level is acceptable for ULSD specification.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**WC06216513**	WC06173072	WC06073464
Sample Date		Client Info		**13 Jun 2024**	01 Apr 2024	13 Dec 2023
Machine Age	hrs	Client Info		**0**	0	0
Sample Status				**NORMAL**	NORMAL	NORMAL

PHYSICAL PROPERTIES		method	limit/base	current	history1	history2
Specific Gravity		*ASTM D1298	0.839	**---**	---	0.827
Fuel Color	text	*Visual Screen	Yllow	**Red**	Red	Red
ASTM Color	scalar	*ASTM D1500		**L5.5**	L4.5	L4.0
Visc @ 40°C	cSt	ASTM D445	3.0	**2.2**	2.2	2.27
Pensky-Martens Flash Point	°C	*PMCC Calculated	52	**65.2**	64.5	---

SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m	10	**0**	18	0
Sulfur (UVF)	ppm	ASTM D5453		**6**	6	5

DISTILLATION		method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D86	165	**177**	177	172
5% Distillation Point	°C	ASTM D86		**196**	196	193
10% Distill Point	°C	ASTM D86	201	**202**	203	200
15% Distillation Point	°C	ASTM D86		**208**	209	206
20% Distill Point	°C	ASTM D86	216	**214**	215	212
30% Distill Point	°C	ASTM D86	230	**227**	227	224
40% Distill Point	°C	ASTM D86	243	**239**	239	237
50% Distill Point	°C	ASTM D86	255	**251**	252	250
60% Distill Point	°C	ASTM D86	267	**265**	265	264
70% Distill Point	°C	ASTM D86	280	**279**	279	278
80% Distill Point	°C	ASTM D86	295	**295**	295	294
85% Distillation Point	°C	ASTM D86		**305**	306	3034
90% Distill Point	°C	ASTM D86	310	**316**	317	316
95% Distillation Point	°C	ASTM D86		**334**	334	333
Final Boiling Point	°C	ASTM D86	341	**349**	349	344
Distillation Residue	%	ASTM D86	3.0	**---**	---	1.4
Distillation Loss	%	ASTM D86	3.0	**---**	---	0.5

IGNITION QUALITY	method	limit/base	current	history1	history2
API Gravity	ASTM D7777	37.7	**39**	39	39.6
Cetane Index	ASTM D4737	<40.0	**51**	51	51.3

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	**0**	<1	0
Sodium	ppm	ASTM D5185m	<0.1	**2**	0	0
Potassium	ppm	ASTM D5185m	<0.1	**2**	<1	0
Water	%	ASTM D6304	<0.05	**0.003**	0.003	0.005
ppm Water	ppm	ASTM D6304	<500	**36**	31	59
% Gasoline	%	*In-House	<0.50	**0.0**	0.0	0.0
% Biodiesel	%	*In-House	<20.0	**0.0**	0.0	0.0

FUEL REPORT

Fuel Distillation Curve

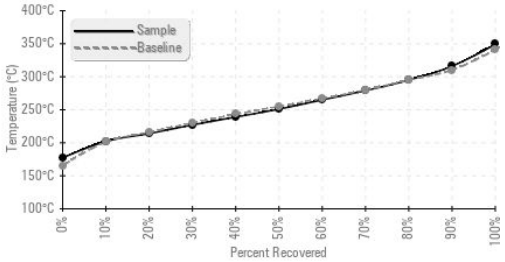

Particle Count

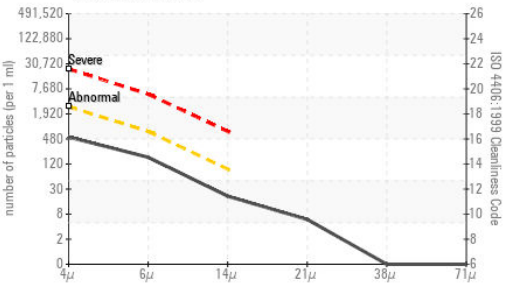

Water (KF)

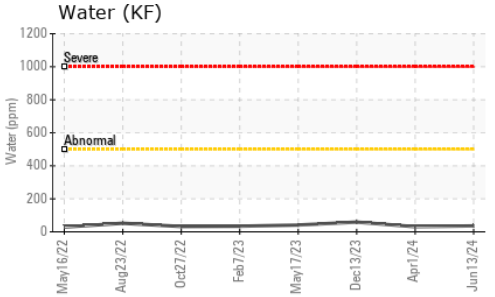

Viscosity @ 40°C

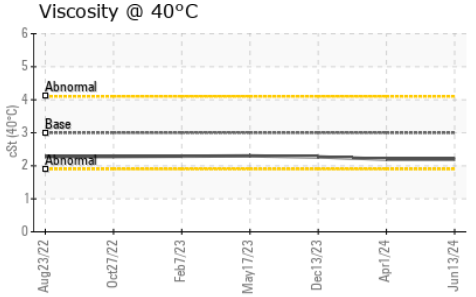

Particle Trend

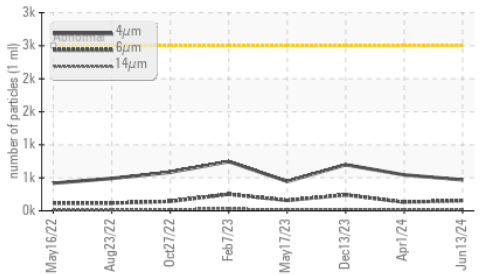

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>2500	**469**	544	698
Particles >6µm		ASTM D7647	>640	**154**	131	242
Particles >14µm		ASTM D7647	>80	**18**	17	25
Particles >21µm		ASTM D7647	>20	**5**	5	5
Particles >38µm		ASTM D7647	>4	**0**	0	0
Particles >71µm		ASTM D7647	>3	**0**	0	0
Oil Cleanliness		ISO 4406 (c)	>18/16/13	**16/14/11**	16/14/11	17/15/12

HEAVY METALS		method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m	<0.1	**0**	0	0
Nickel	ppm	ASTM D5185m	<0.1	**0**	0	0
Lead	ppm	ASTM D5185m	<0.1	**0**	0	0
Vanadium	ppm	ASTM D5185m	<0.1	**0**	0	0
Iron	ppm	ASTM D5185m	<0.1	**0**	0	0
Calcium	ppm	ASTM D5185m	<0.1	**0**	0	0
Magnesium	ppm	ASTM D5185m	<0.1	**0**	0	0
Phosphorus	ppm	ASTM D5185m	<0.1	**0**	0	0
Zinc	ppm	ASTM D5185m	<0.1	**3**	0	0

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom			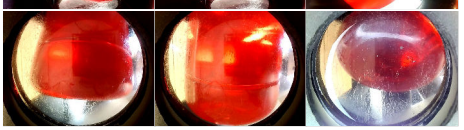		

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC06216513 **Received** : 20 Jun 2024
Lab Number : 06216513 **Tested** : 24 Jun 2024
Unique Number : 11089377 **Diagnosed** : 24 Jun 2024 - Jonathan Hester
Test Package : DF-2 (Additional Tests: Fuel, Screen)

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

ISP FUEL SYSTEMS
9 CHRIS COURT, SUITE F
DAYTON, NJ
US 08810
Contact: AJ THOMPSON
aj@ispfuelsystems.com
T:
F: