




FUEL REPORT

Sample Rating Trend

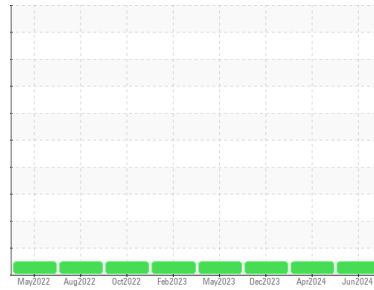

NORMAL



Area

MT/VA/Hospital/NOLA

Machine Id

VA HOSPITAL NEW ORLEANS TANK 7

Component

Diesel Fuel

Fluid

No.2 DIESEL FUEL (ULTRALOW SULPHUR) (--- QTS)

DIAGNOSIS

Recommendation

All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel.

Corrosion

All metal levels are normal indicating no corrosion in the system.

Contaminants

There is no bacteria or fungus (yeast and/or mold) indicated in the sample. The water content is negligible. There is no indication of any contamination in the fuel. The amount and size of particulates present in the system are acceptable.

Fuel Condition

Sulfur value derived by ASTM D5453 method for ULSD validation. Sulfur level is acceptable for ULSD specification.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC06216514	WC06173073	WC06073463
Sample Date	Client Info		13 Jun 2024	01 Apr 2024	13 Dec 2023
Machine Age	hrs	Client Info	0	0	0
Sample Status			NORMAL	NORMAL	NORMAL

PHYSICAL PROPERTIES

	method	limit/base	current	history1	history2
Specific Gravity	*ASTM D1298	0.839	---	---	0.833
Fuel Color	text	*Visual Screen	Red	Red	Red
ASTM Color	scalar	*ASTM D1500	L5.5	L4.5	L4.0
Visc @ 40°C	cSt	ASTM D445	2.54	2.5	2.5
Pensky-Martens Flash Point	°C	*PMCC Calculated	62.9	61.5	---

SULFUR CONTENT

	method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m	0	14	0
Sulfur (UVF)	ppm	ASTM D5453	7	7	6

DISTILLATION

	method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D86	174	173	169
5% Distillation Point	°C	ASTM D86	199	197	196
10% Distill Point	°C	ASTM D86	209	208	207
15% Distillation Point	°C	ASTM D86	217	216	215
20% Distill Point	°C	ASTM D86	225	224	223
30% Distill Point	°C	ASTM D86	239	238	235
40% Distill Point	°C	ASTM D86	251	250	249
50% Distill Point	°C	ASTM D86	263	262	261
60% Distill Point	°C	ASTM D86	276	275	274
70% Distill Point	°C	ASTM D86	290	289	288
80% Distill Point	°C	ASTM D86	304	303	304
85% Distillation Point	°C	ASTM D86	315	314	313
90% Distill Point	°C	ASTM D86	325	324	325
95% Distillation Point	°C	ASTM D86	343	341	342
Final Boiling Point	°C	ASTM D86	357	356	352
Distillation Residue	%	ASTM D86	3.0	---	1.4
Distillation Loss	%	ASTM D86	3.0	---	0.8

IGNITION QUALITY

	method	limit/base	current	history1	history2
API Gravity	ASTM D7777	37.7	38	38	38.4
Cetane Index	ASTM D4737	<40.0	51	51	51.6


CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	0	<1	0
Sodium	ppm	ASTM D5185m	2	0	0
Potassium	ppm	ASTM D5185m	2	<1	0
Water	%	ASTM D6304	0.004	0.003	0.005
ppm Water	ppm	ASTM D6304	43	35	59
% Gasoline	%	*In-House	0.0	0.0	0.0
% Biodiesel	%	*In-House	0.0	0.0	0.0




FUEL REPORT


Fuel Distillation Curve

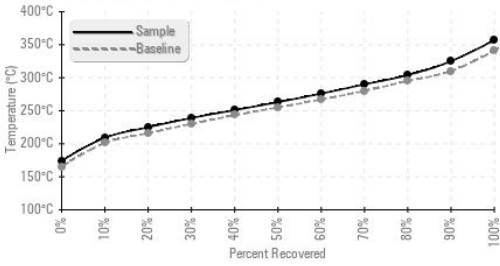


Particle Count

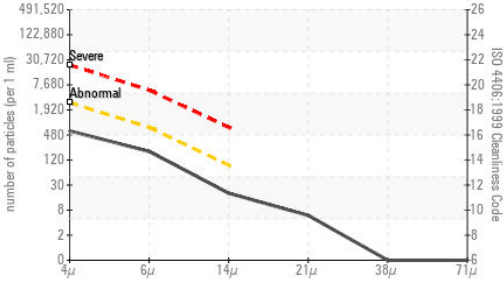


Water (KF)

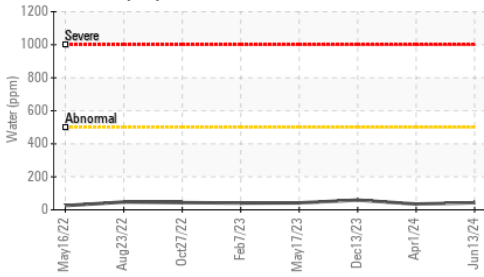

Viscosity @ 40°C

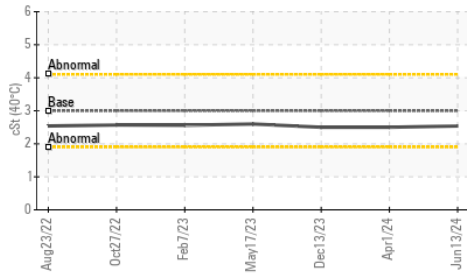


Particle Trend

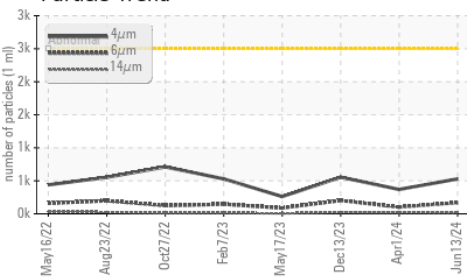

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>2500	529	369	555
Particles >6µm	ASTM D7647	>640	170	101	202
Particles >14µm	ASTM D7647	>80	17	18	23
Particles >21µm	ASTM D7647	>20	5	7	8
Particles >38µm	ASTM D7647	>4	0	1	0
Particles >71µm	ASTM D7647	>3	0	0	0
Oil Cleanliness	ISO 4406 (c)	>18/16/13	16/15/11	16/14/11	16/15/12

HEAVY METALS	method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m	<0.1	0	0
Nickel	ppm	ASTM D5185m	<0.1	0	0
Lead	ppm	ASTM D5185m	<0.1	0	0
Vanadium	ppm	ASTM D5185m	<0.1	0	0
Iron	ppm	ASTM D5185m	<0.1	0	0
Calcium	ppm	ASTM D5185m	<0.1	0	0
Magnesium	ppm	ASTM D5185m	<0.1	0	0
Phosphorus	ppm	ASTM D5185m	<0.1	0	0
Zinc	ppm	ASTM D5185m	<0.1	3	0

SAMPLE IMAGES

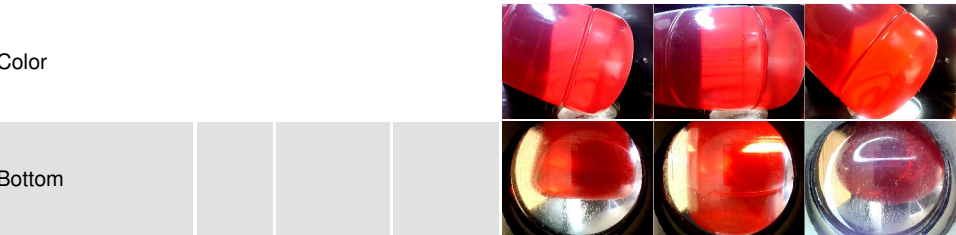

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC06216514 **Received** : 20 Jun 2024
Lab Number : **06216514** **Tested** : 24 Jun 2024
Unique Number : 11089378 **Diagnosed** : 24 Jun 2024 - Jonathan Hester
Test Package : DF-2 (Additional Tests: Fuel, Screen)

ISP FUEL SYSTEMS
 9 CHRIS COURT, SUITE F
 DAYTON, NJ
 US 08810
 Contact: AJ THOMPSON
 aj@ispfuelsystems.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)