




FUEL REPORT

Sample Rating Trend

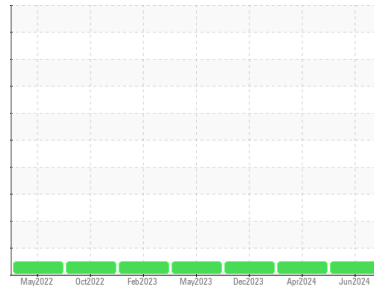

NORMAL



Area
MT/VA/Hospital/NOLA
 Machine Id
VA HOSPITAL NEW ORLEANS TANK 5
 Component
Diesel Fuel
 Fluid
No.2 DIESEL FUEL (ULTRALOW SULPHUR) (--- QTS)

DIAGNOSIS

Recommendation

All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel.

Corrosion

All metal levels are normal indicating no corrosion in the system.

Contaminants

There is no bacteria or fungus (yeast and/or mold) indicated in the sample. The water content is negligible. There is no indication of any contamination in the fuel. The amount and size of particulates present in the system are acceptable.

Fuel Condition

Sulfur value derived by ASTM D5453 method for ULSD validation. Sulfur level is acceptable for ULSD specification.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC06216515	WC06173071	WC06073465
Sample Date	Client Info			13 Jun 2024	01 Apr 2024	13 Dec 2023
Machine Age	hrs	Client Info		0	0	0
Sample Status				NORMAL	NORMAL	NORMAL

PHYSICAL PROPERTIES		method	limit/base	current	history1	history2
Specific Gravity		*ASTM D1298	0.839	---	---	0.837
Fuel Color	text	*Visual Screen	Yellow	Red	Red	Red
ASTM Color	scalar	*ASTM D1500		L5.5	L4.5	L4.0
Visc @ 40°C	cSt	ASTM D445	3.0	2.37	2.42	2.36
Pensky-Martens Flash Point	°C	*PMCC Calculated	52	60.6	59.4	---

SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m	10	0	13	0
Sulfur (UVF)	ppm	ASTM D5453		5	5	4

DISTILLATION		method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D86	165	171	169	162
5% Distillation Point	°C	ASTM D86		193	192	187
10% Distill Point	°C	ASTM D86	201	201	200	198
15% Distillation Point	°C	ASTM D86		209	208	206
20% Distill Point	°C	ASTM D86	216	216	215	213
30% Distill Point	°C	ASTM D86	230	230	229	226
40% Distill Point	°C	ASTM D86	243	244	243	241
50% Distill Point	°C	ASTM D86	255	258	256	256
60% Distill Point	°C	ASTM D86	267	272	271	270
70% Distill Point	°C	ASTM D86	280	286	285	286
80% Distill Point	°C	ASTM D86	295	302	301	302
85% Distillation Point	°C	ASTM D86		314	313	313
90% Distill Point	°C	ASTM D86	310	325	324	325
95% Distillation Point	°C	ASTM D86		345	343	344
Final Boiling Point	°C	ASTM D86	341	362	360	354
Distillation Residue	%	ASTM D86	3.0	---	---	1.4
Distillation Loss	%	ASTM D86	3.0	---	---	0.9


IGNITION QUALITY		method	limit/base	current	history1	history2
API Gravity		ASTM D7777	37.7	37	37	37.6
Cetane Index		ASTM D4737	<40.0	49	48	48.6

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	0	<1	0
Sodium	ppm	ASTM D5185m	<0.1	2	0	0
Potassium	ppm	ASTM D5185m	<0.1	2	0	0
Water	%	ASTM D6304	<0.05	0.004	0.004	0.005
ppm Water	ppm	ASTM D6304	<500	43	40	58
% Gasoline	%	*In-House	<0.50	0.0	0.0	0.0
% Biodiesel	%	*In-House	<20.0	0.0	0.0	0.0




FUEL REPORT


Fuel Distillation Curve

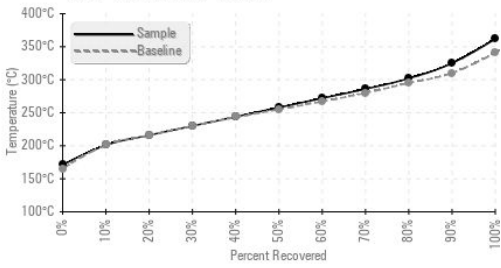


Particle Count

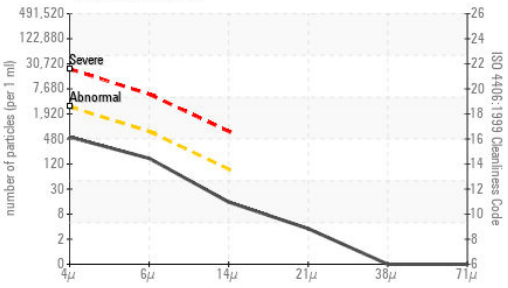


Water (KF)

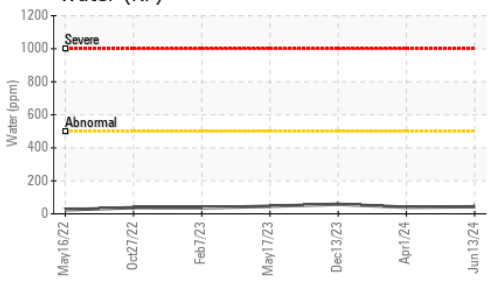

Viscosity @ 40°C

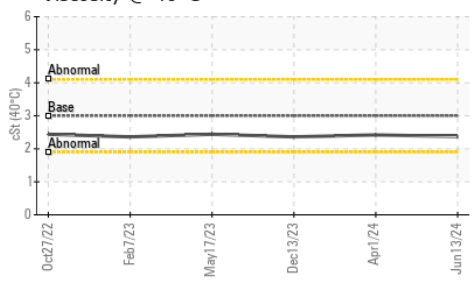


Particle Trend

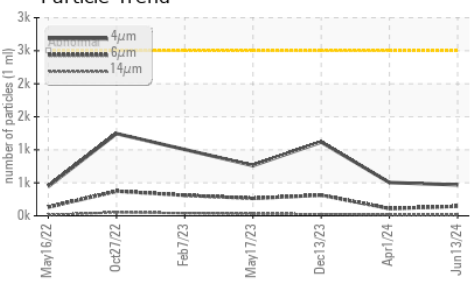

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>2500	469	504	1116
Particles >6µm	ASTM D7647	>640	145	110	314
Particles >14µm	ASTM D7647	>80	13	14	25
Particles >21µm	ASTM D7647	>20	3	4	7
Particles >38µm	ASTM D7647	>4	0	0	0
Particles >71µm	ASTM D7647	>3	0	0	0
Oil Cleanliness	ISO 4406 (c)	>18/16/13	16/14/11	16/14/11	17/15/12

HEAVY METALS	method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m <0.1	0	0	0
Nickel	ppm	ASTM D5185m <0.1	0	0	0
Lead	ppm	ASTM D5185m <0.1	0	0	0
Vanadium	ppm	ASTM D5185m <0.1	0	0	0
Iron	ppm	ASTM D5185m <0.1	0	0	0
Calcium	ppm	ASTM D5185m <0.1	0	0	0
Magnesium	ppm	ASTM D5185m <0.1	0	0	0
Phosphorus	ppm	ASTM D5185m <0.1	0	0	0
Zinc	ppm	ASTM D5185m <0.1	3	0	0

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

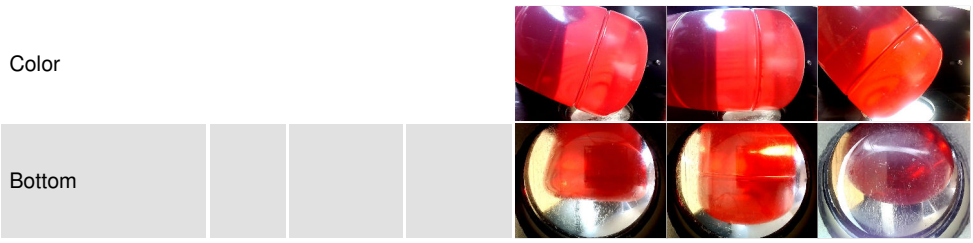

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC06216515 **Received** : 20 Jun 2024
Lab Number : **06216515** **Tested** : 24 Jun 2024
Unique Number : 11089379 **Diagnosed** : 24 Jun 2024 - Jonathan Hester
Test Package : DF-2 (Additional Tests: Fuel, Screen)

ISP FUEL SYSTEMS
 9 CHRIS COURT, SUITE F
 DAYTON, NJ
 US 08810
 Contact: AJ THOMPSON
 aj@ispfuelsystems.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)