




OIL ANALYSIS REPORT

Sample Rating Trend

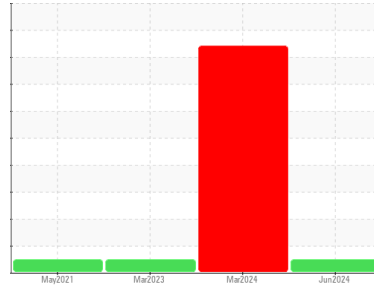

NORMAL



Area
DAKOTA RANGE III [200006928]
 Machine Id
16WEA87748 - C-05
 Component
Wind Turbine Gearbox
 Fluid
FUCHS RENOLIN UNISYN CLP 320 (--- LTR)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. Please note that this is a corrected copy for data entry updates.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		NX015954	NX015969	NX05852430
Sample Date	Client Info		12 Jun 2024	07 Mar 2024	28 Mar 2023
Machine Age	hrs	Client Info	21939	19754	1196
Oil Age	hrs	Client Info	21939	19754	0
Oil Changed	Client Info		Not Chngd	Not Chngd	N/A
Sample Status			NORMAL	SEVERE	NORMAL

WEAR METALS

	method	limit/base	current	history1	history2	
PQ	ASTM D8184	>50	14	14	12	
Iron	ppm	ASTM D5185m	>30	16	▲ 101	6
Chromium	ppm	ASTM D5185m	>3	<1	▲ 2	0
Nickel	ppm	ASTM D5185m	>3	<1	0	0
Titanium	ppm	ASTM D5185m	>10	<1	<1	0
Silver	ppm	ASTM D5185m		<1	<1	0
Aluminum	ppm	ASTM D5185m	>30	3	<1	<1
Lead	ppm	ASTM D5185m	>15	1	2	0
Copper	ppm	ASTM D5185m	>10	<1	6	0
Tin	ppm	ASTM D5185m	>10	<1	<1	0
Antimony	ppm	ASTM D5185m	>5	---	---	---
Vanadium	ppm	ASTM D5185m		<1	<1	0
Cadmium	ppm	ASTM D5185m		<1	<1	0

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		8	9	11
Barium	ppm	ASTM D5185m		1	0	0
Molybdenum	ppm	ASTM D5185m		2	2	<1
Manganese	ppm	ASTM D5185m		<1	2	<1
Magnesium	ppm	ASTM D5185m		1	<1	0
Calcium	ppm	ASTM D5185m		17	19	8
Phosphorus	ppm	ASTM D5185m		241	226	245
Zinc	ppm	ASTM D5185m		9	13	4
Sulfur	ppm	ASTM D5185m		4974	5600	6204

CONTAMINANTS






	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>+15	2	2	<1
Sodium	ppm	ASTM D5185m		2	4	<1
Potassium	ppm	ASTM D5185m	>20	2	2	0
Water	%	ASTM D6304	>0.02	0.008	0.003	0.015
ppm Water	ppm	ASTM D6304	>200	85	35	150.0

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		765	2899	8302
Particles >6µm	ASTM D7647	>320	233	▲ 1099	439
Particles >14µm	ASTM D7647	>40	10	▲ 113	14
Particles >21µm	ASTM D7647	>10	1	▲ 28	3
Particles >38µm	ASTM D7647	>3	0	1	0
Particles >71µm	ASTM D7647	>3	0	0	0
Oil Cleanliness	ISO 4406 (c)	>--/15/12	17/15/10	▲ 19/17/14	20/16/11



OIL ANALYSIS REPORT

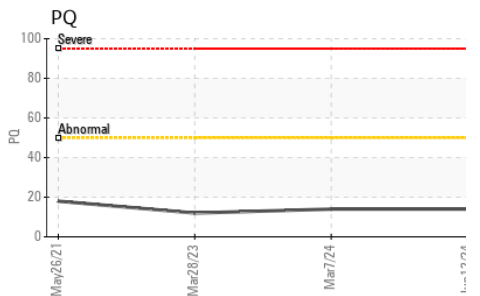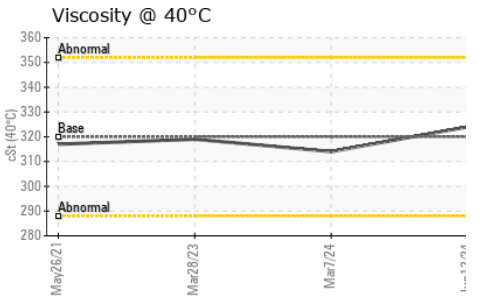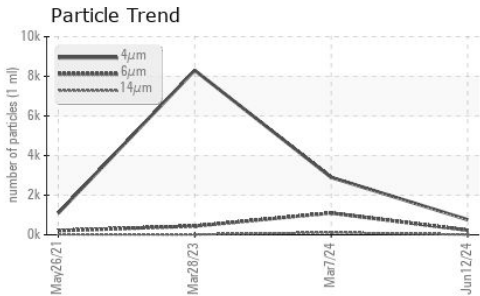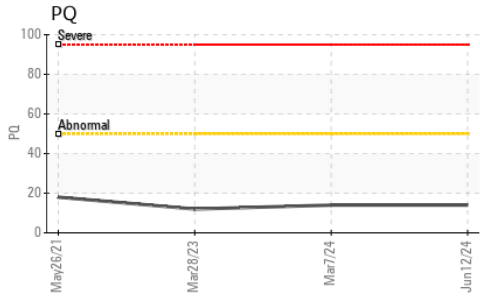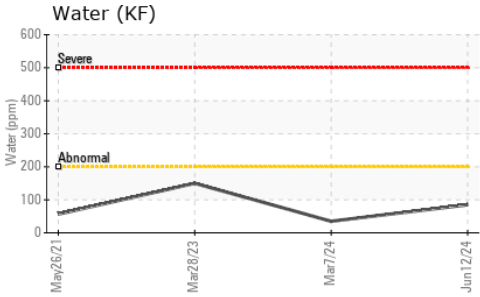


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.6	0.52	0.53	0.27






VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.02	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	320	324	314	319

SAMPLE IMAGES

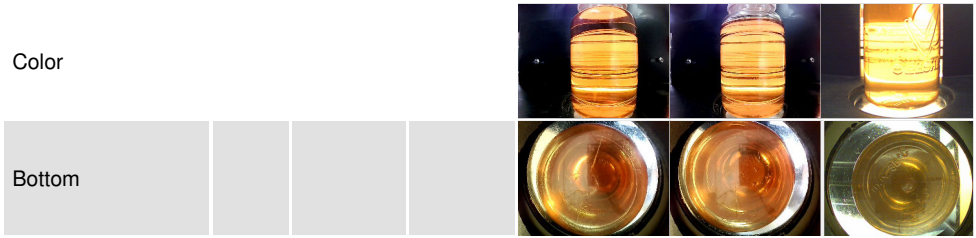

GRAPHS

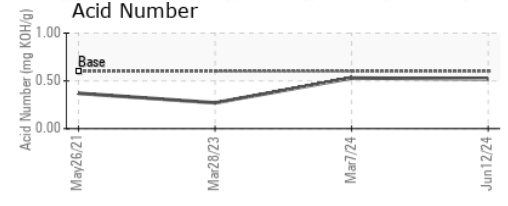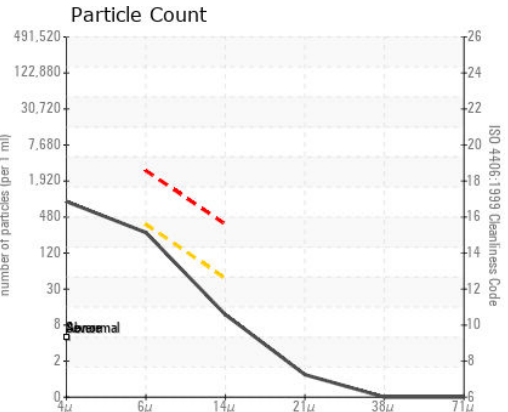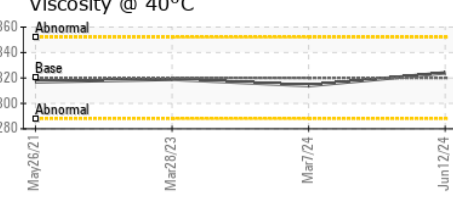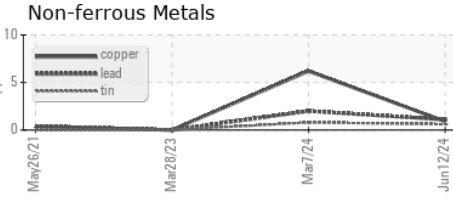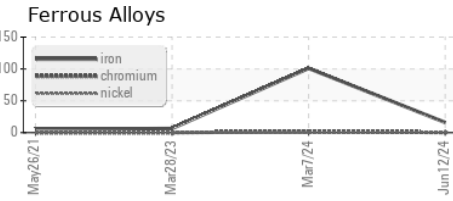

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : NX015954
Lab Number : 06216851
Unique Number : 11089715
Test Package : IND 2 (Additional Tests: KF, PQ, PrtCount)
Received : 21 Jun 2024
Tested : 27 Jun 2024
Diagnosed : 27 Jun 2024 - Doug Bogart

NORDEX USA - Chicago
 300 SOUTH WACKER DRIVE, SUITE 1500
 CHICAGO, IL 60606
 Contact: DEVIN LINEHAN
 DLinehan@nordex-online.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)